



Make-up air unit, full fresh air

ZEPHIR³

CPAN-XHE3 Size1 - Size6

TECHNICAL BULLETIN



Air flow from 1.000 to 14.000 m³/h (300 to 3.900 l/s)

Page	
3	Features and benefits
6	Standard unit technical specifications
8	Built-in options
11	Accessories separately supplied
13	General technical data
22	Option compatibility
23	Dimensional drawings
29	System selection and performance data

Features and benefits

Comfort, saving and system simplification

The whole Primary Air plant in a single stand-alone System


- ▶ The active thermodynamic circuit produces capacity amplifying the energy contained in the exhaust air
- ▶ Extracts and expels the stale air from the space and recovers its thermal energy
- ▶ It supplies Primary Air purified and air-conditioned
- ▶ It operates with 100% outdoor air
- ▶ For any applications
 - hydronic systems with terminals / fan-coils
 - direct expansion and VRF systems
 - radiant systems and chilled beams
 - refurbishment of air handling units
 - Renovation of existing systems



Packaged system

Industrial quality.

ZEPHIR³ contains all the components required to operate perfectly. These have already been optimised and tested by Clivet to ensure 100% efficient and reliable results.

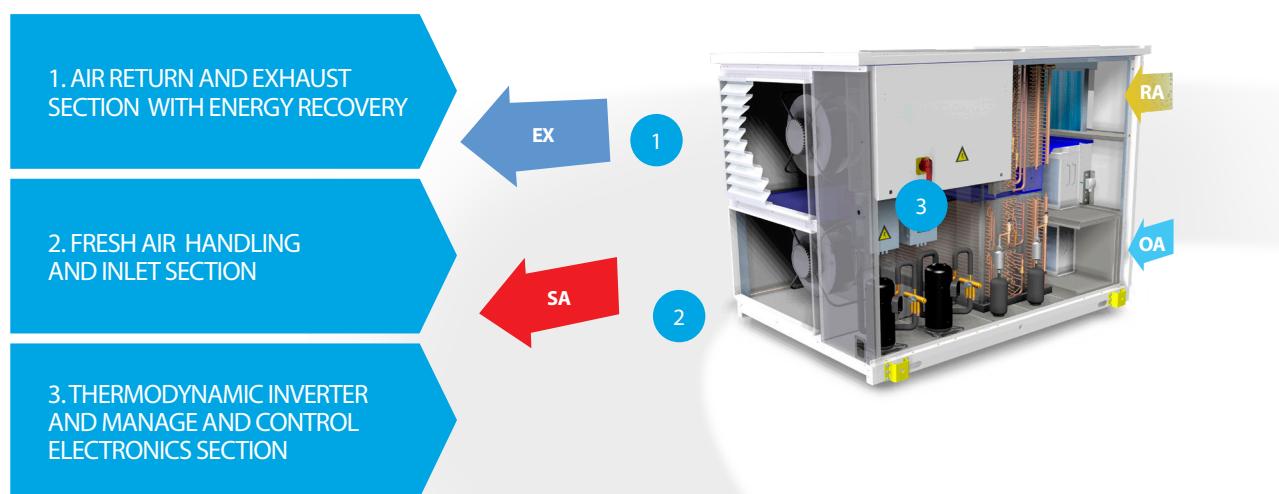


EX. Exhaust air
SA. Supply air

RA. Return air
OA. Outdoor air

Exhaust air as a favourable thermal source stable over time.

It halves the energy required for the compressors.


ZEPHIR³'s thermodynamic circuit uses this source to produce heating and cooling energy in a more efficient way compared to traditional generators that employ outdoor air as a source. Indeed with higher evaporating temperatures on the cold exchanger and lower condensing temperatures on the heat exchanger, it reduces the compressors' absorption by as much as 50%.

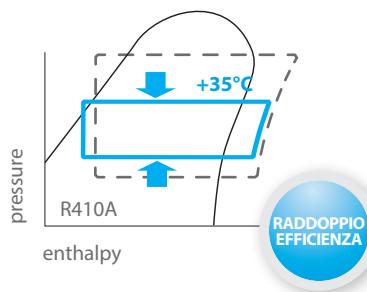

Continuous capacity control

Very high seasonal efficiency.

ZEPHIR³ supplies only the energy actually required. So further it increases its efficiency in partial load operation, which is the more frequently operate condition. The annual consumption of primary energy is reduced by 50% compared with traditional systems.

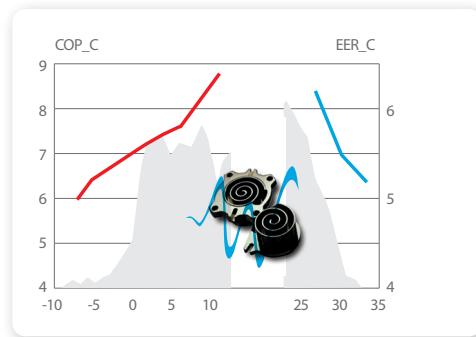

Dinamic Free-Cooling

Great savings on running costs.

With this ZEPHIR³ feature:

- It intakes fresh and clean outdoor air without the compressors activation
- It cools the spaces free of charge for a considerable amount of hours of operation
- It's even more effective in buildings with high space loads

High efficiency air circulation

Because the ventilation is always on.

The fan sections are equipped with electronically controlled motors directly coupled to the reverse blade impeller. They eliminate inefficiencies, wear and maintenance of traditional belt and pulley transmissions. As standard they are equipped with a "soft start" function, which drastically reduces inrush current and further limits the electric consumption of the system. At the same performances, ZEPHIR³ saves up to 30% compared with traditional ventilation systems.

Constant or variable air flow

Constant: just the amount required.

The nominal air flow is set on the display

- Simplified system calibration and testing
- Constant air flow, by adjusting the fan speed
- Offsets the constant clogging of filters
- For all air diffusion systems that cannot support variations in air flow, as in the majority of induction and chilled beam systems

Re-heat free of charge

It recovers the heat from hot gas.

During dehumidification:

- It eliminates the energy cost to pump and store hot water from the heating station or the heat recovery on the chiller.
- The energy efficiency of the thermodynamic circuit further increases due to favourable condensation
- Accurate modulating control of the supply temperature

Efficient recovery

Ventilation not reduced.

The ZEPHIR³ thermodynamic recovery eliminates the high pressure drops of passive recovery which in traditional systems requires more power for ventilation. This higher electrical consumption in an annual cycle often loses the savings on the recovered energy.

Variable: the quantity required only

It can automatically reduce the air flow in accordance with the actual crowding detected by the CO₂ probe


- Further increase of energy saving for air handling.
- Suitable also for other pollutants such as tobacco smoke, formaldehyde, cooking odours (VOC, Volatile Organic Compounds).

Features and benefits

Universal application in different climates and system types.


Mixed system with:

- Chiller
- hydronic terminal units
- Separate intake of primary air into the environment




Mixed system with:

- VRF unit
- Separate intake of primary air into the environment




Mixed system with:

- Chiller
- Radiant systems



Mixed system with:



- Chiller
- Supply to intake of local units



No waste filtration

High efficiency electronic filters

- Equivalent to the traditional H10
- Negligible pressure drops
- Savings on ventilation above 10% compared with conventional filters

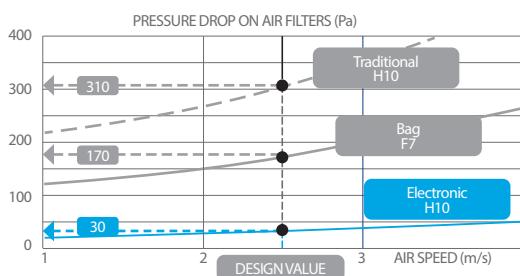

Important contribution to LEED credits

Energy and innovation

The ZEPHIR³ performance can help obtain LEED points precisely in the areas that are distinguished by the large number of possible credits:

- Energy and Atmosphere (EA)
- Internal Environment Quality (IEQ)
- Innovation and Design process (ID)



Simple and intuitive user interface

The remote control with user interface (for wall mounting) is supplied as standard and it can be easily used also by not specialized personnel. The connecting cable (not supplied) has a double function of serial communication and power supply.

Among the main functions it allows to:

- unit switching on and off, ventilation only mode;
- daily/weekly start-up or power-off programming of the unit;
- display the alarm code and the unit status;
- management temperature offset +/- 2°C
- selective key lock, unlocked with password.

The temperature and humidity measurement is made by probes into the unit: the remote control can therefore be installed also inside the technical control compartment.

When the centralised supervision system or an other remote control device is provided, the unit can be supplied without the remote control with the user interface.



CLIVET is committed to the promotion of the principles of sustainable building and is an ordinary member of GBC Italia.

Standard unit technical specifications

Compressor

SIZE 1

Inverter controlled rotary-type hermetic compressor equipped with a motor protection device for overheating, overcurrents and excessive temperatures of the supply gas. It is installed on anti-vibration mounts and it is equipped with oil charge. The compressor is wrapped in a sound-absorbing hood, that reduces its sound emissions.

An oil heater, which starts automatically, keeps the oil from being diluted by the refrigerant when the compressor stops.

A single compressor is installed on a single refrigerant circuit.

SIZE 2-3-4

Inverter controlled scroll-type hermetic compressor equipped with a motor protection device for overheating, overcurrents and excessive temperatures of the supply gas. Mounted on rubber vibration dampers complete with oil charge. An oil heater is automatically activated to prevent the oil from being diluted by the refrigerant when the compressor stops.

A single compressor is installed on a single refrigerant circuit (SIZE 2) or a single compressor for each of the two refrigerant circuits (SIZE 3-4)

SIZE 5-6

Inverter controlled scroll-type hermetic compressor equipped with a motor protection device for overheating, overcurrents and excessive temperatures of the supply gas. Mounted on rubber vibration dampers complete with oil charge. An oil heater is automatically activated to prevent the oil from being diluted by the refrigerant when the compressor stops.

Two controller compressors with inverter are installed on the main cooling circuit, complete with oil level equalizer, and a single compressor with ON/OFF regulation on the secondary cooling circuit.

Structure

The base is assembled with a painted and galvanized steel frame. The internal structure is made of a load-bearing frame, in corrugated steel sheet of the type "ALUZINC" while in SIZE 1 and SIZE 2 the cowling serves as the frame.

Aluzinc has high anti-corrosion features due to the galvanic protection typical of the aluminium-zinc combination.

Panelling

The inside of the compressor panels in sheet steel is painted with polyester powder colour RAL 9001 and lined with heat-insulating and sound-proof self-extinguishing material (20mm thickness, density 9.5kg/m³, flame resistant class 1 - DIN 53438).

Panels in the air treatment zone and the cover panels, in SIZE 3, SIZE 4, SIZE 5 and SIZE 6, sandwich-type double walled in sheet steel with polyurethane insulation (40 kg /m³), 6/10mm thick external sheet galvanised and painted with polyester powder colour RAL 9001, polyurethane thickness 40mm with thermal conductivity of 0.022W/mK, hot-dip galvanized internal sheet 5/10mm thickness. The panel also has a PVC profile for thermal insulation with a rubber gasket in EPDM which provides an air-tight seal, colour RAL 9001.

In SIZE 1, SIZE 2, the same type of panels are installed as those in the compressor space.

All panelling can easily be removed to allow complete accessibility to internal components.

Internal exchanger

- exchanger for the outdoor air handling
- exchanger for energy recovery of extracted air

Direct expansion finned coil exchanger made with copper pipes placed on staggered rows mechanically expanded to better adhere to the fin collar. The fins are made from aluminium with a corrugated surface and adequately distanced to ensure the maximum heat exchange efficiency.

Fan

- Supply fan
- Extraction fan

Fans (plug-fan type) without reversed blade screw, driven by directly coupled brushless DC motors with electronic control. The fan blades are designed to optimise aerodynamics and reduce running noise, and are made in a high performance plastic. No drive sizing is required.

Refrigeration circuit

Refrigeration circuit with:

- refrigerant charge (R-410A9)
- sight glass with moisture and liquid indicator

- high pressure safety pressure switch
- filter dryer
- high pressure safety valve
- electronic expansion valve
- non-return valve
- 4-way reverse cycle valve
- liquid receiver
- Reheating by hot gas recovery to modulation capacity

Filtration

1. outdoor air intake side

- Pleated filter for greater filtering surface, made of a galvanized sheet frame with a galvanized and electric-welded protective mesh, and regenerable filtering media made from polyester fibre sized with synthetic resins G4 (coarse 60% ISO 16890). Self-extinguishing type (flame resistant class 1 - DIN 53438).
- On the outdoor air intake side, a highly efficient second filtration stage is installed, by means of an aluminium alloy electronic filter complete with metal pre-filter, realized by active electrostatic filtering cells. The electronic control circuit is integrated with a watertight seal which allows it to be washed. The filtration efficiency is higher than 95% for particles with a diameter greater than 0.5 µm, and is equivalent to the H10 classification used in traditional filters.

2. extraction ambient side

- Pleated filter for greater filtering surface, made of a galvanized sheet frame with a galvanized and electric-welded protective mesh, and regenerable filtering media made from polyester fibre sized with synthetic resins G4 (coarse 60% ISO 16890). Self-extinguishing type (flame resistant class 1 - DIN 53438).

Tray

Condense collection tray made of 1050 H24 aluminium alloy with anti-condensation insulation, welded and equipped with siphon drain tube.

Electrical panel

The electrical panel is positioned inside the units, with access through a swing door that is opened by a special key.

The capacity section includes:

- main door lock isolator switch
- compressor circuit breaker
- compressor power supply remote control switch
- fan motor thermal protections of internal and external section
- circuit breaker to protect auxiliary circuit
- inverter for compressor control
- heating elements

The microprocessor control section includes:

- treated air temperature control
- daily, weekly programmer of temperature set-point and unit on/off
- compressor overload protection and timer
- self-diagnosis system with immediate display of the error code
- clean contacts for ON-OFF remote, fan mode, compressor mode and cumulative alarm
- supply humidity ratio offset in cooling mode

Control keypad, including:

- display to indicate operating status and mode
- display of the set values and the error codes
- PRG key for unit configuration and parameters display
- ALARM button to access the alarm management functions
- operating mode key
- On/Off and manual reset button for overload device activation
- UP and DOWN keys for the navigation of the menu and the submenu

segue.

Standard unit technical specifications

Accessories


- Hydronic recovery device for extended operating range
- Indoor installation
- Copper/aluminium exchanger on outdoor air with acrylic lining
- Copper/aluminium exchanger on exhaust air with acrylic lining
- Hot gas re-heating Cu/Al coil with capacity modulation and acrylic lining
- Variable flow for supply and exhaust air with CO₂ probe
- Variable flow for supply and exhaust air with CO₂+VOC probe
- Variable flow for supply and exhaust air with supply pressure probe
- RS485 Serial port with Modbus protocol
- Regolazione portata aria a pressione costante
- RS485 Serial port with LonWorks protocol
- Serial port RS485 with BACnet protocol
- Smoke detector
- Remote control with user interface: not required
- VRF gateway
- High efficiency F7 Air Filter (ISO 16890 ePM1 60%)

Accessories separately supplied

- Immersed electrodes steam humidifying module
- Steam-powered humidifying module
- Remote supply air sensor
- Rubber antivibration mounts
- Rubber antivibration mounts for unit and humidification module
(available only with options: MHSEX- MCHSX)


Test

Unit manufactured to ISO 9001 standard and commissioned upon production completion.

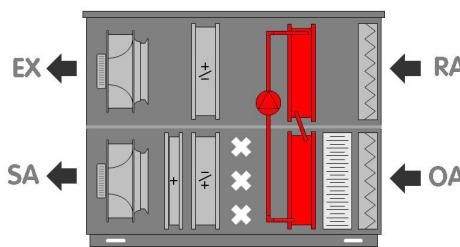Accessory		Description
RECH	Hydronic recovery device for extended operating range	<p>Option suitable for application in cold climate and in hot humid climate. It is a compact device within the System, thus keeping unchanged the unit dimensions and consequently its compactness.</p> <p>It is automatically activated only when requested by actual ambient conditions: they transfer heat from return air to outdoor air and keep optimal operation on the reverse cycle thermodynamic circuit.</p> <p>It includes two additional heat exchangers, connected by a water circuit complete of high efficiency pump, safety valve, manometer, expansion tank, water and ethylene glycol charge (35% in weight).</p> <p>The innovative predictive control keeps comfortable supply conditions even during defrost cycles, if any. They run without reverting the thermodynamic cycle: stop the device, increase the heat pump capacity, temporary reduce the airflow even by 40% to control evaporation, activate heat integration.</p> <p>All reported performance is net because it includes those effects and does not need any further correction.</p> <p>This option reduces the available static pressure (supply air side).</p> <p>!! This operation involves variation of the main electrical data of the unit.</p> <p>!! For the correct unit operation the temperature within the unit must be under 50 °C. Temperature of installed or stored units must not exceed 50°C. With the unit installed and connected to the air distribution system, protections and safeties work only with active electrical power supply and not severed sectionized unit.</p> <p>!! In the case of very cold climates it is necessary to use appropriate measures to prevent snow and ice accumulation in front of outdoor air inlet and exhaust air extraction.</p> 
II	Internal installation	<p>This option is required for indoor installation. On both outdoor and exhaust air, individual rectangular flanges are provided in lieu of standard grilles (while on both return and supply air standard rectangular flanges remain unchanged). This option is also suitable for outdoor installation, whenever it is advisable to keep far from the unit both outdoor intake and exhaust air.</p>
PVARC	Variable air flow on supply and exhaust with CO2 probe	<p>This option is recommended where population differs greatly at any given time, it automatically adjusts the air flow to the actual conditions and increases saving for ventilation.</p> <p>Complete with probe and integrated logic control. When CO2 concentration is lower than the set-point, the air flow is reduced according to the distance from the set-point.</p> <p>The probe is installed and wired built-in the unit and is located in the return air duct of the unit.</p> <p>!! The range of variation is from the selected supply air flow value to the minimum air flow value available on that size.</p>
PVARCV	Variable air flow on supply and exhaust with CO2+VOC probe	<p>Option shown in environments characterized by tobacco smoke, formaldehyde (coming for example from solvents, deodorants, glues, paints, detergents), cooking, etc.</p> <p>Automatically adjusts the air flow to the actual conditions of use and increases saving in ventilation. Complete with probe and integrated logic control.</p> <p>When CO₂ and VOC (volatile organic compounds) concentration is lower than the set-point, the air flow is reduced according to the distance from the set-point.</p> <p>The probe is installed and wired built-in the unit and is located in the return air duct of the unit.</p> <p>!! The range of variation is from the selected supply air flow value to the minimum air flow value available on that size.</p>

Built-in options

Accessory		Description
PVARP	Variable flow for supply and exhaust air with supply pressure probe	<p>This option is recommended in applications for multi zone where is required the variability of the air flow, in accordance on the actual conditions of use, in some rooms. Suitable for aeraulic system equipped with VAV/CAV dampers. Complete with differential pressure switch and integrated logic control installed and wired on board the machine. Allows, fixed in the user display the desired external static pressure, in case of variation of the aeraulic load profile of the system to automatically change the air flow rate to maintain the set external static pressure.</p> <p>!! For effective control, the set external static pressure must be bigger than 100 Pa</p> <p>!! The range of variation is from the selected supply air flow value to the minimum air flow value available on that size</p>
DESM	Smoke detector	<p>Option that detects smoke in the space and intervenes on the operation of the unit. Complete with sensor, electronic control unit and relative integrated logic control. When alarm or sensor failure occurs, ventilation stops. The ON-OFF remote control and the start-up/shut-down keyboard control are disabled. The unit is reactivated manually. Smoke detection in the space is done through the analysis of the return air. The Tyndall effect smoke detector's increased sensitivity can detect the presence of smoke in high speed air flows, by means of a photo-optical system with a labyrinth detection chamber. The device is installed inside the unit.</p>
NCRC	Remote control with user interface: not required	<p>This option is recommended in the presence of a centralized supervision system or other remote management equipment. The unit will maintain their functions unchanged, but is supplied without a user interface.</p> <p>!! During ordinary maintenance, the authorized service technician must be equipped with properly configured personal computer or a compatible service interface.</p>
MOB	RS485 Serial port with Modbus protocol	<p>It allows the serial connection to supervision systems, using Modbus as the communication protocol. It allows the access to the complete list of operating variables, controls and alarms. The device is installed and wired built-in the unit.</p>  <p>!! The total length of each serial line do not exceed 1000 meters and the line must be connected in bus typology (in/out)</p>
LON	RS485 Serial port with LonWorks protocol	<p>It allows the serial connection to supervision systems, using LonWorks as the communication protocol. It allows access to a list of operating variables, control and alarms compliant with the Echelon standard. The device is installed and wired built-in the unit.</p>  <p>!! The configuration and management activities for the LonWorks networks are the responsibility of the client..</p> <p>!! LonWorks technology uses the LonTalk® protocol for communicating between the network nodes. Contact the service supplier for further information.</p> <p>!! The total length of each serial line do not exceed 1000 meters and the line must be connected in bus typology (in/out)</p>
BACIP	BACnet-IP serial communication module	<p>It allows the serial connection to supervision systems, using BACnet as the communication protocol. It allows the access to the complete list of operating variables, controls and alarms. The device is installed and wired built-in the unit.</p>  <p>!! The configuration and management activities for the BACnet networks are the responsibility of the client..</p> <p>!! The total length of each serial line do not exceed 1000 meters and the line must be connected in bus typology (in/out)</p>

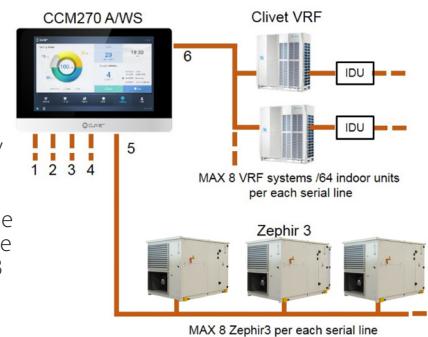Accessory		Description
VRF	VRF gateway	<p>Option that allows integration of Zephir3 in Clivet VRF systems. In air conditioning applications, Zephir3 takes care of the primary air, while the air conditioning is completed by the internal units of the VRF system. The device is a gateway wired and built-in inside the electrical panel of Zephir3, it has to be connected to the centralized control system CCM-270A / WS used for the management of Clivet VRF systems.</p> <p>The centralized controller allows the following functions on Zephir3:</p> <ul style="list-style-type: none"> • unit on/off, • delivery temperature with offset +/- 4 °C from the set point set • daily/weekly time schedule • mode of operation: automatic / ventilation only • output cumulative alarm <p>The centralized controller CCM-270A / WS allows the connection of six serial lines and each up to manage eight units, for a total of 48 systems. (e.g. 48 Zephir3 or 48 VRF systems to which up to 384 indoor units are connected).</p> <p>!! <i>The total length of each serial line do not exceed 1000 meters and the line must be connected in bus typology (in/out). Connection provided by the customer</i></p> 
CEA	Copper/aluminium exchanger on outdoor air with acrylic lining	Coils with copper pipes and aluminium fins with acrylic lining. Resist bi-metallic corrosion and allow for application in coastal areas.
CCA	Copper/aluminium exchanger on exhaust air with acrylic lining	Coils with copper pipes and aluminium fins with acrylic lining. Resist bi-metallic corrosion and allow for application in coastal areas.
CPHGM	Hot gas re-heating Cu/Al coil with capacity modulation and acrylic lining	Coils with copper pipes and aluminium fins with acrylic lining. Resist bi-metallic corrosion and allow for application in coastal areas.
PTCO	Set up for shipping via container	<p>Option that allows shipping via container. It includes the sheet steel slide application for an easy unit scrolling, packaging with protective angle brackets and nylons, anchoring systems. If necessary the lateral lifting brackets and the main isolator switch handle can be removed to avoid damages during transport (components removed and put inside the unit). For particular requirements, please contact Clivet Shipping Department</p>
F7B	High efficiency F7 Air Filter (ISO 16890 ePM1 60%)	<p>The multi-dihedral filters with rigid pockets F7 class ePM1 60% (ISO 16890), are filtering components that are in addition to the standard G4 ISO Coarse 60% (ISO 16890) filters, for more effective filtering. They are widely used in air conditioning systems and industrial applications that require suitable performance concerning fine dusts and particles with dimensions greater than 1 µm. Class F7 filters are made of fibreglass paper, pleated with constant calibrated spacing, mounted on frames with a sturdy structure in extruded moulded polyester; the ample filtering surface reduces air side pressure drops. Class F7 filters must be replaced after reaching their limits of dirtiness with scheduled periodic maintenance.</p> <p>!! <i>This option reduces the available static pressure (supply air side).</i></p>

Accessories separately supplied

Accessories specifications

MHSEX - Immersed electrode and steam humidification module

This device is suitable for winter operation when humidity is required for the ambient without cooling the air flow.

The automatic modulating control allows you to adjust the steam production and its relative management costs to the actual requirements.

Sized in accordance with the various capacities, the device is suitable for use with un-softened water of medium conductivity and is complete with: solenoid valve feed, disposable cylinder, solenoid valve water discharge, steam distribution tube, electronic control panel with water level monitor, conductivity monitor, defoamer, manual drain force. To ensure maximum hygiene, the cylinder is automatically emptied after a preset period of stand-by.

The option is installed in a separate module external to the unit and with its own electrical board and distinct electricity supply.

The control of the device, regulated by the unit, is realized through a 0-10V signal.

A return probe already assembled and wired built-in the unit is used to control the humidity level.

The option is also suitable for remote installation, on the air supply duct. Maximum distance 30 m.

!! The modulating capacity control depends on return air conditions.

!! This option involves variation of the main electrical data of the unit.

!! This accessory requires the presence of a water circuit and drain on board the unit. By the customer.

!! Installation provided by the Customer.



Matching with immersed electrode and steam humidification


Size	SIZE 1	SIZE 2	SIZE 3	SIZE 4	SIZE 5	SIZE 6
Size immersed electrode steam humidifier	HSE8 (8kg/h)	HSE9 (15kg/h)	HSE25 (25kg/h)	HSE35 (35kg/h)	HSE45 (45kg/h)	HSE45 (45kg/h)

Electrical input

Size	SIZE 1	SIZE 2	SIZE 3	SIZE 4	SIZE 5	SIZE 6
F.L.A. - Full load current at max admissible conditions						
F.L.A. MHSEX - Immersed electrode and steam humidification module	A	8,7	16,2	27,0	38,0	48,8
F.L.I. - Full load power input at max admissible conditions						
F.L.I. MHSEX - Immersed electrode and steam humidification module	kW	6,0	11,3	18,8	26,3	33,8

Sizes of immersed electrode and steam humidification module

Size	SIZE 1	SIZE 2	SIZE 3	SIZE 4	SIZE 5	SIZE 6
A mm	640	640	900	900	900	900
B mm	800	800	960	1060	1060	1060
C mm	905	905	1700	1700	1920	2225

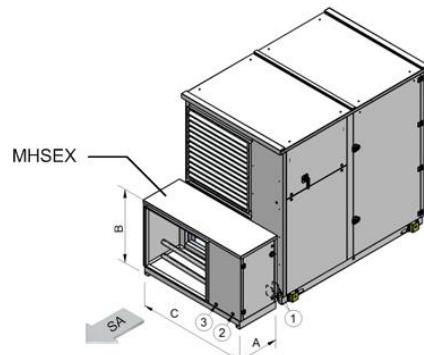

1. Supply line input
2. Steam inlet
3. Condensate discharge

Specifiche accessori

MCHSX - Centralised steam humidification module

This device allows to supply the humidity to the space by withdrawing mains steam at an appropriate pressure. Useful in applications where mains steam supply is available and where a significant amount of moisture is required in the winter season such as in hospitals or manufacturing.

It includes the following stainless steel components: distribution steam tube, modulating solenoid valve, condensation drain device, steam filter, hydraulic connections. It also includes the necessary control and functions. The operating pressure is 1 bar.

The device allows for an accurate delivery of moisture to the space and simplifies unit installation and management. The option is installed in a separate external module outside the unit and is connected to the electrical panel of the unit. The control of the device, which is set by the unit, is via a 0-10 V output signal from the electrical panel, which is used to control the regulating valve.

The option is also suitable for remote installation, on the air supply duct. Maximum distance 30 m.

!! The modulating capacity control depends on return air conditions.

!! This option involves variation of the main electrical data of the unit.

!! A shut-off valve in the unit's steam input line is to be provided (responsibility of the customer). Install the steam line in a position higher to the unit.

!! If the available steam supply exceeds the pressure operating range indicated, the required de-pressurization must take place outside the unit (provided by the Customer)

!! Installation provided by the Customer.


Matching with centralised steam humidification module

Size		SIZE 1	SIZE 2	SIZE 3	SIZE 4	SIZE 5	SIZE 6
Centralized steam humidification size		1	CHS 10kg/h	CHS 15kg/h	CHS 25kg/h	CHS 35kg/h	CHS 45kg/h

1. Maximum steam flow, refers to the pressure of 1 bar

Sizes of centralised steam humidification module

Size		SIZE 1	SIZE 2	SIZE 3	SIZE 4	SIZE 5	SIZE 6
A	mm	640	640	900	900	900	900
B	mm	800	800	960	1060	1060	1060
C	mm	905	905	1700	1700	1920	2225

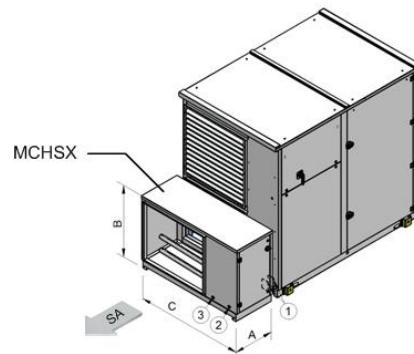

1. Power input
2. Steam inlet
3. Condensate discharge

RSSX - Remote supply air sensor

This option detects the actual conditions in the air supply duct, to be used by the automatic control in lieu of the on-board sensor. Complete with duct probe for internal temperature and humidity sensing, surface mount plastic case, 10 m long cable, plug for quick connection to the System.

!! The device is designed to be installed outside the unit (to be carried out by the Customer)

!! Use only the supplied cable. For proper operation, do not cut the cable.

!! Installation provided by the Customer.

AMRX - Rubber antivibration mounts

AMRUX - Rubber antivibration mounts for unit and humidification module (available only with options: MHSEX- MCHSX)

The rubber anti-vibrating dampers are to be mounted on designated areas on the support brackets. Their function is to dampen the vibrations produced by the unit by reducing the noise transmitted to the support structures. They are elastic bodies that can dampen axial and tangential stress and their physical and mechanical properties remain constant over time thanks to the highly resistant materials they are made of. Alternatively, rubberized neoprene anti-vibration strips may be used on the unit longitudinal support members (not supplied by Clivet).

!! Installation provided by the Customer



General technical data

Performance

Size			Size 1	Size 2	Size 3	Size 4	Size 5	Size 6
Operation with constant supply temperature								
Standard air flow								
Standard air flow		l/s	361	611	1278	2000	2638	3333
Standard air flow		m ³ /h	1300	2200	4600	7200	9500	12000
Max external static pressure (supply)		Pa	630	630	630	600	420	630
Max external static pressure (extraction)		Pa	630	630	630	630	540	630
Cooling								
Total cooling capacity	1	kW	10,6	17,5	38,7	58,4	79,0	95,9
Re-heating capacity	1	kW	2,70	4,20	10,9	14,9	21,3	22,9
Compressor power input	1	kW	2,91	4,92	11,1	15,7	20,4	23,2
EER_C	1	-	4,57	4,41	4,47	4,67	4,91	5,12
Heating								
Heating capacity	2	kW	5,93	10,00	21,0	32,9	43,4	54,9
Compressor power input	2	kW	0,71	1,35	2,54	4,22	5,75	8,77
COP_C	2	-	8,38	7,45	8,28	7,80	7,55	6,26
Operation at the maximum available capacity								
Standard air flow								
Standard air flow		l/s	361	611	1278	2000	2638	3333
Standard air flow		m ³ /h	1300	2200	4600	7200	9500	12000
Max external static pressure (supply)		Pa	630	630	630	600	420	630
Max external static pressure (extraction)		Pa	630	630	630	630	540	630
Cooling								
Total cooling capacity	3	kW	10,6	17,5	38,7	58,4	79,0	95,9
Compressor power input	3	kW	3,26	5,52	12,5	17,7	22,9	26,1
Additional available capacity to space	3	kW	3,57	5,67	14,0	19,8	27,7	30,9
EER_C	3	-	3,25	3,18	3,10	3,31	3,45	3,68
Heating								
Heating capacity	4	kW	10,5	17,8	37,1	58,2	76,8	96,9
Compressor power input	4	kW	2,28	3,77	7,13	11,2	14,4	18,3
COP_C	4	-	4,61	4,72	5,21	5,20	5,33	5,29
Operation with high airflow								
Higt air flow								
Nominal air flow		l/s	528	972	1944	2556	3194	3889
Nominal air flow		m ³ /h	1900	3500	7000	9200	11500	14000
Max external static pressure (supply)		Pa	630	470	630	455	345	615
Max external static pressure (extraction)		Pa	630	530	630	535	400	630
Cooling								
Total cooling capacity	5	kW	9,20	18,2	31,9	45,1	62,0	80,6
Compressor power input	5	kW	1,56	3,38	4,46	6,97	13,8	17,8
EER_C	5	-	5,89	5,38	7,15	6,48	4,50	4,51
Heating								
Heating capacity	6	kW	6,00	11,1	22,10	29,1	36,3	44,2
Compressor power input	6	kW	0,54	1,31	2,48	3,11	3,40	5,44
COP_C	6	-	11,1	8,46	8,91	9,36	10,7	8,14

DB = dry bulb

WB = wet bulb

EER_C = Thermodynamic efficiency of the system in cooling mode

COP_C = Thermodynamic efficiency of the system in heating mode

1. Outdoor air temperature: 35°C D.B./24°C W.B.. Extracted air temperature 26°C D.B.. Supply air humidity ratio: 11g/kg. Supply air temperature 24°C D.B.

2. Outdoor air temperature 7°C D.B./6,0°C W.B.. External air temperature 20°C D.B./12°C W.B.. Supply air temperature 20°C D.B.

3. Outdoor air temperature 35°C D.B./24°C W.B.. Extracted air temperature: 26°C D.B.. Supply air humidity ratio: 11g/kg

4. Outdoor air: 7°C D.B./6,0°C W.B.. Extracted air temperature: 20°C D.B./12°C W.B.. Supply air temperature: 30°C D.B.

5. Outdoor air temperature 35°C D.B./24°C W.B.. Extracted air temperature 26°C D.B.. Supply air temperature 22°C D.B.

6. Outdoor air temperature: 7°C D.B./6,0°C W.B.. Extracted air temperature: 20°C D.B./12°C W.B.. Supply air temperature: 16°C D.B.

Construction

Size			Size 1	Size 2	Size 3	Size 4	Size 5	Size 6
Compressor								
Type of compressors			ROT	Scroll	Scroll	Scroll	Scroll	Scroll
No. of compressors	Nr		1	1	2	2	3	3
Std Capacity control steps	Nr		20-100%	20-100%	10-100%	10-100%	8-100%	8-100%
Refrigeration circuits	Nr		1	1	2	2	2	2
Refrigerant charge	7	kg	4.3	5.6	19	24	28	37.5
Air Handling Section Fans (Supply)								
Type of supply fan			RAD	RAD	RAD	RAD	RAD	RAD
Number of supply fans	Nr		1	1	1	1	1	2
Fan diameter	mm		310	355	500	630	630	500
Minimum air flow	l/s		278	444	917	1444	2083	2639
Minimum air flow	m ³ /h		1000	1600	3300	5200	7500	9500
Maximum air flow	l/s		528	972	1944	2556	3194	3889
Maximum air flow	m ³ /h		1900	3500	7000	9200	11500	14000
Installed unit power	kW		0,80	0,90	2,70	2,80	2,80	2,70
Max. static pressure supply fan	8	Pa	630	630	630	580	420	630
Fans (Exhaust)								
Type of exhaust fan			RAD	RAD	RAD	RAD	RAD	RAD
Number of exhaust fans	Nr		1	1	1	1	1	2
Fan diameter	mm		310	355	500	630	630	500
Exhaust air flow	l/s		361	611	1278	2000	2638	3333
Installed unit power	kW		0,80	0,90	2,70	2,80	2,80	2,70
Max. exhaust static pressure	8	Pa	630	630	630	630	520	630
Connections								
Condensate discharge			1"GAS	1"GAS	1"GAS	1"GAS	1"GAS	1"GAS
Power supply								
Standard power supply		V	400/3/50	400/3/50	400/3/50	400/3/50	400/3/50	400/3/50
Dimensions								
A - Length	mm		1895	1895	2465	2465	2465	2465
B - Width	mm		950	950	1735	1735	2025	2330
C - Height	mm		1025	1625	1810	2260	2260	2260
Standard unit weights								
Shipping weight		kg	320	450	1070	1285	1450	1670
Operating weight		kg	320	450	1070	1285	1450	1670

ROT = rotary compressor

SCROLL = scroll compressor

RAD = radial fan

(7) Indicative values for standard units with possible +/-10% variation. The actual data are indicated on the unit label.

(8) Data referred to the standard flow rate

General technical data

Electrical data

Size		Size 1	Size 2	Size 3	Size 4	Size 5	Size 6
F.L.A. - Full load current at max admissible conditions							
F.L.A. - Compressor 1	A	15,1	17,4	17,4	34,5	34,5	34,5
F.L.A. - Compressor 2	A	-	-	17,4	34,5	34,5	34,5
F.L.A. - Compressor 3	A	-	-	-	-	15,4	30,9
F.L.A. - Single supply fan	A	1,6	1,7	4,2	4,3	4,3	4,2
F.L.A. - Single exhaust air fan	A	1,6	1,7	4,2	4,3	4,3	4,2
F.L.A. - Heating elements	A	4,8	6,5	13	17,3	26	34,6
F.L.A. - Total	A	23,5	27,8	56,7	95,4	119,5	151,7
L.R.A. - Locked rotor amperes							
L.R.A. - Compressor 1	A	15,1	17,4	17,4	34,5	34,5	34,5
L.R.A. - Compressor 2	A	-	-	17,4	34,5	34,5	34,5
L.R.A. - Compressor 3	A	-	-	-	-	101	174
L.R.A. - Single supply fan	A	1,6	1,7	4,2	4,3	4,3	4,2
L.R.A. - Single exhaust air fan	A	1,6	1,7	4,2	4,3	4,3	4,2
L.R.A. - Heating elements	A	4,9	7,2	14,3	19	28,6	38
F.L.I. - Full load power input at max admissible conditions							
F.L.I. - Compressor 1	kW	5,60	10,3	10,3	20,0	20,0	20,0
F.L.I. - Compressor 2	kW	-	-	10,3	20,0	20,0	20,0
F.L.I. - Compressor 3	kW	-	-	-	-	9,1	17,2
F.L.I. - Single supply fan	kW	0,8	0,9	2,7	2,8	2,8	2,7
F.L.I. - Single exhaust air fan	kW	0,8	0,9	2,7	2,8	2,8	2,7
F.L.I. - Heating elements	kW	3	4,5	9	12	18	24
F.L.I. - Total	kW	10,5	17,0	35,5	57,8	72,9	92,2
M.I.C. Maximum inrush current							
M.I.C. - Value	A	23,5	27,8	56,7	95,4	186	291,2

Data refer to standard units.

Power supply: 400/3/50 Hz +/- 10%

Voltage unbalance: max 2 %

Values not including accessories

RECH option electrical data

Size		Size 1	Size 2	Size 3	Size 4	Size 5	Size 6
High efficiency circulator							
F.L.A. - Absorbed current	A	0,55	0,55	1,9	1,9	1,9	1,9
F.L.I. - Power input	kW	0,13	0,13	0,39	0,39	0,39	0,39

Sound levels - ST

The sound pressure level refers to a distance of 1 meter from the outer surface of the unit operating in open field.

Static pressure 50 Pa (UNI EN ISO 9614-2)

For the standard air supply the total sound power levels for the diverse values of available static pressure are shown.

Please note that when the unit is installed in conditions different from nominal test conditions (e.g. near walls or obstacles in general), the sound levels may undergo substantial variations.

Air supply minimum (50 Pa)

Size	Sound power level (dB)								Sound pressure level	Sound power level		
	Octave band (Hz)											
	63	125	250	500	1000	2000	4000	8000				
Size 1	54	52	56	59	68	69	62	70	58	74		
Size 2	55	53	57	60	69	70	63	71	59	75		
Size 3	60	58	61	64	72	73	66	74	61	78		
Size 4	66	68	66	66	71	72	66	73	59	78		
Size 5	67	69	67	67	72	73	67	74	60	79		
Size 6	69	68	70	73	75	74	69	74	62	80		

Air supply standard (50 Pa)

Size	Sound power level (dB)								Sound pressure level	Sound power level		
	Octave band (Hz)											
	63	125	250	500	1000	2000	4000	8000				
Size 1	59	60	65	69	72	72	63	69	60	77		
Size 2	60	61	66	70	73	73	65	70	61	77		
Size 3	66	65	67	70	73	74	67	74	61	79		
Size 4	67	69	67	67	72	73	67	74	60	79		
Size 5	74	75	75	74	75	74	69	74	62	80		
Size 6	74	75	77	79	78	76	71	73	64	83		

(100, 200, 300 Pa)

Size	Sound power level (dB)		
	Available static pressure (Pa)		
	100	200	300
Size 1	77	77	78
Size 2	78	78	79
Size 3	80	80	81
Size 4	80	80	81
Size 5	83	84	84
Size 6	85	85	86

Maximum air supply (50 Pa)

Size	Sound power level (dB)								Sound pressure level	Sound power level		
	Octave band (Hz)											
	63	125	250	500	1000	2000	4000	8000				
Size 1	65	69	75	77	77	73	65	68	64	81		
Size 2	66	70	76	78	78	74	66	69	65	82		
Size 3	74	75	77	79	78	77	72	74	66	83		
Size 4	77	78	77	76	77	77	71	75	64	83		
Size 5	78	80	79	78	77	76	71	74	64	83		
Size 6	77	78	80	82	81	79	74	75	67	86		

Operation with constant supply temperature

$T_{OA} = 35/24^{\circ}\text{C}$

$T_{RA} = 26^{\circ}\text{C}$

$T_{SA} = 24^{\circ}\text{C}$

$X_{SA} = 11\text{g/kg}$

T_{OA} = Outdoor air temperature at Dry/Wet bulb [°C]

T_{OA} = Exhaust air temperature at Dry bulb [°C]

T_{SA} = Dry bulb supply air temperature [°C]

X_{SA} = Supply air humidity ratio [g/kg]


General technical data

Operating ranges (Cooling)

The limits are indicative and take into consideration:

- general and non specific sizes
- unit correctly installed and serviced

OUTDOOR AIR

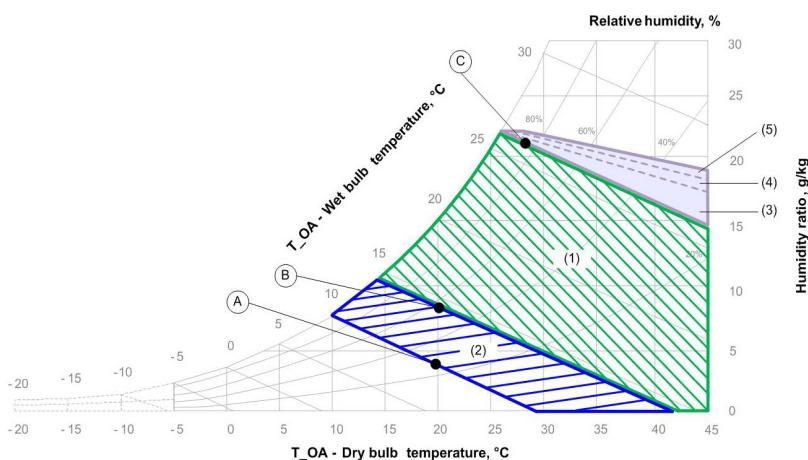


- 1 = Normal operating range
 2 = Operating range with capacity modulation
 3 = With option RECH - "Hydronic recovery device", with $T_{RA} = 26^{\circ}\text{D.B.}$
 4 = With option RECH - "Hydronic recovery device", with $T_{RA} = 24^{\circ}\text{D.B.}$
 5 = With option RECH - "Hydronic recovery device", with $T_{RA} = 22^{\circ}\text{D.B.}$
 T_{OA} = outdoor air temperature
 T_{RA} = extracted air temperature
 DB = dry bulb
 WB = wet bulb

Outdoor air temperature limit at wet bulb

		T_{OA} (W.B.)
A	°C	10
B	°C	14
C	°C	26

EXTRACTED AIR

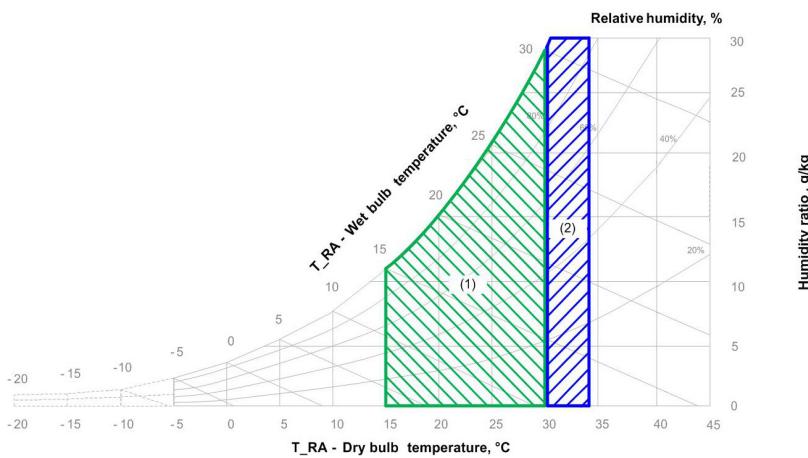


- 1 = Normal operating range
 2 = Operating range with capacity modulation
 T_{RA} = Extracted air temperature
 DB = Dry bulb
 WB = Wet bulb

Operating range (Heating)

The limits are indicative and take into consideration:

- general and non specific sizes
- unit correctly installed and serviced


OUTDOOR AIR

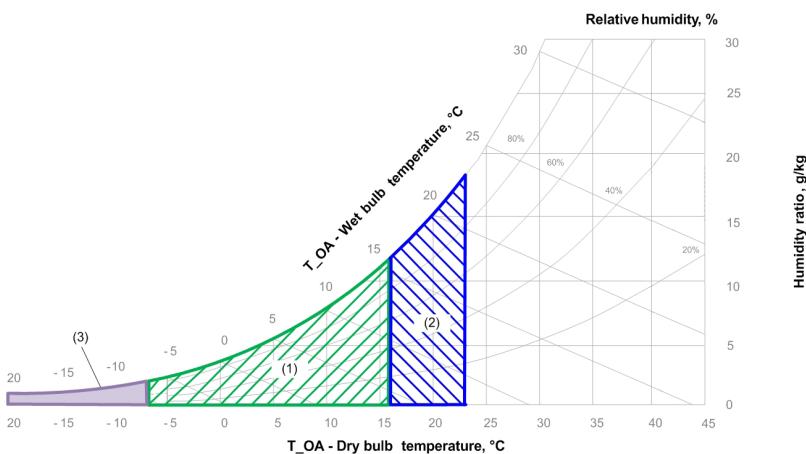

1 = Normal operating range
 2 = Operating range with capacity modulation
 3 = With "RECH - Hydronic recovery device"

T_OA = Outdoor air temperature
 DB = Dry bulb
 WB = Wet bulb

EXTRACTED AIR

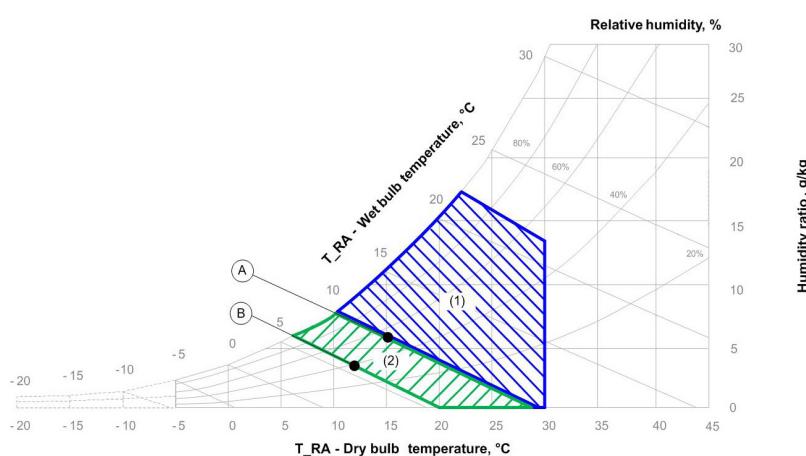

1 = Normal operating range
 2 = Operation in which they could be defrost cycles

T_RA = Extracted air temperature
 DB = Dry bulb
 WB = Wet bulb

Extracted air temperature limit at wet bulb

			T_RA (W.B)
A		°C	10,2
B		°C	6,0


!! Failure to comply with the lower limit of wet bulb temperature can cause the unit to stop.

General technical data

Fan performance

SIZE 1


Supply fans

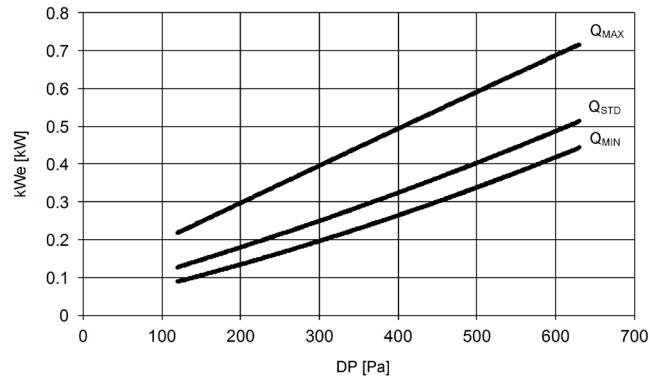

kWe = Total power input (kW)

DP = Static pressure in Pa

Exhaust fans

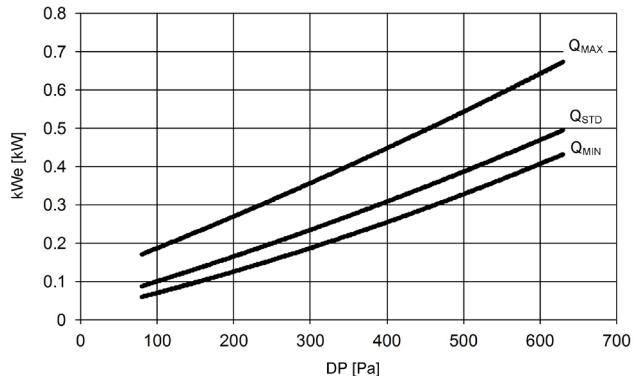

Q_{min} = 1.000 m³/h


Q_{std} = 1.300 m³/h

Q_{max} = 1.900 m³/h

Pressure drop of optional components		Qmin	Qstd	Qmax
RECH - Hydronic recovery device for extended operating range	Pa	33	48	83
F7B - High efficiency F7 Air Filter (ISO 16890 ePM1 60%)	Pa	60	88	148

SIZE 2


Supply fans

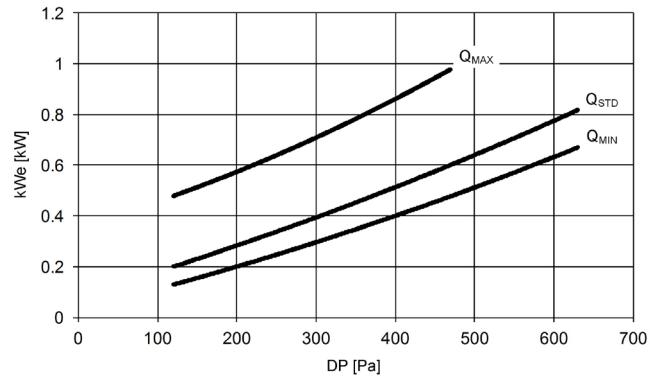

kWe = Total power input (kW)

DP = Static pressure in Pa

Exhaust fans

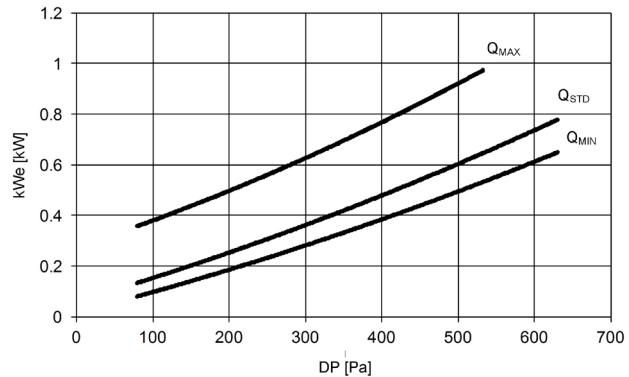

Q_{min} = 1.600 m³/h

Q_{std} = 2.200 m³/h

Q_{max} = 3.500 m³/h

Pressure drop of optional components		Qmin	Qstd	Qmax
RECH - Hydronic recovery device for extended operating range	Pa	29	45	89
F7B - High efficiency F7 Air Filter (ISO 16890 ePM1 60%)	Pa	65	91	177


!! The performance takes into account the pressure drops in the unit (pressure drops in treatment coil, standard filters, etc.).

!! To determine the performance required of the fans, you must add to the usable static pressure desired the pressure drops of any accessories.

Fan performance

SIZE 3


Supply fans

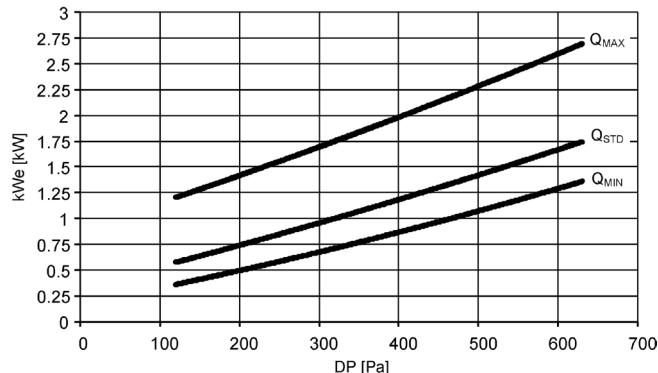

kW_e = Total power input (kW)

DP = Static pressure in Pa

Exhaust fans

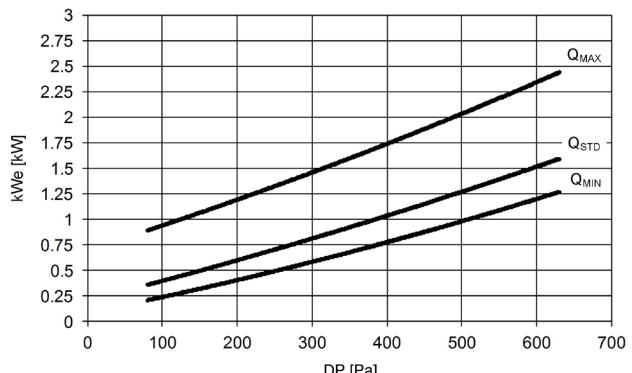

$Q_{min} = 3.300 \text{ m}^3/\text{h}$


$Q_{std} = 4.600 \text{ m}^3/\text{h}$

$Q_{max} = 7.000 \text{ m}^3/\text{h}$

Pressure drop of optional components		Q_{min}	Q_{std}	Q_{max}
RECH - Hydronic recovery device for extended operating range	Pa	30	48	88
F7B - High efficiency F7 Air Filter (ISO 16890 ePM1 60%)	Pa	49	73	125

SIZE 4


Supply fans

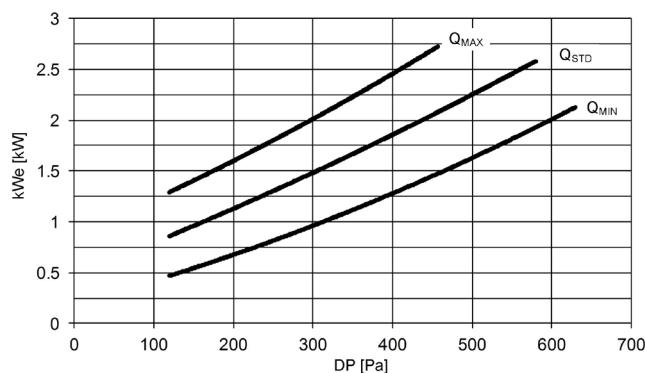

kW_e = Total power input (kW)

DP = Static pressure in Pa

Exhaust fans

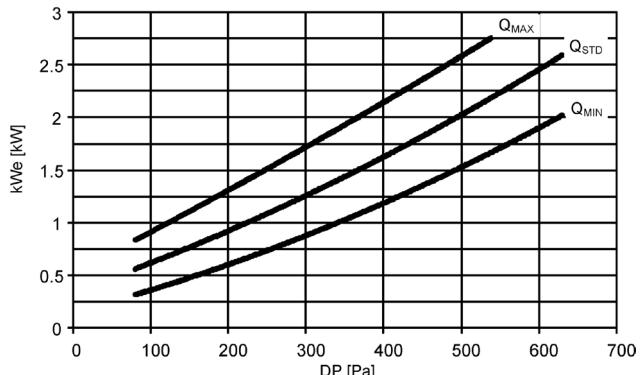

$Q_{min} = 5.200 \text{ m}^3/\text{h}$

$Q_{std} = 7.200 \text{ m}^3/\text{h}$

$Q_{max} = 9.200 \text{ m}^3/\text{h}$

Pressure drop of optional components		Q_{min}	Q_{std}	Q_{max}
RECH - Hydronic recovery device for extended operating range	Pa	40	64	92
F7B - High efficiency F7 Air Filter (ISO 16890 ePM1 60%)	Pa	70	104	151

!! The performance takes into account the pressure drops in the unit (pressure drops in treatment coil, standard filters, etc.).


!! To determine the performance required of the fans, you must add to the usable static pressure desired the pressure drops of any accessories.

General technical data

Fan performance

SIZE 5


Supply fans

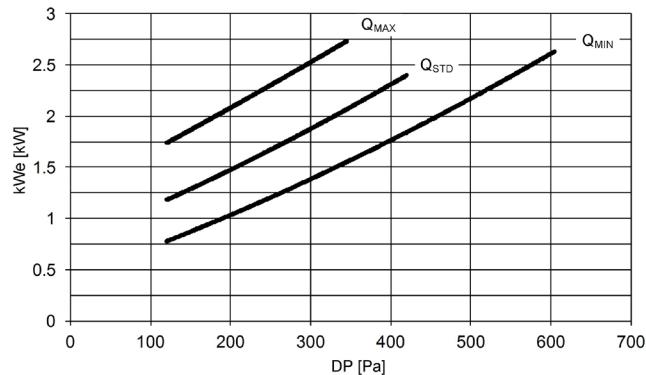

kWe = Total power input (kW)

DP = Static pressure in Pa

Exhaust fans

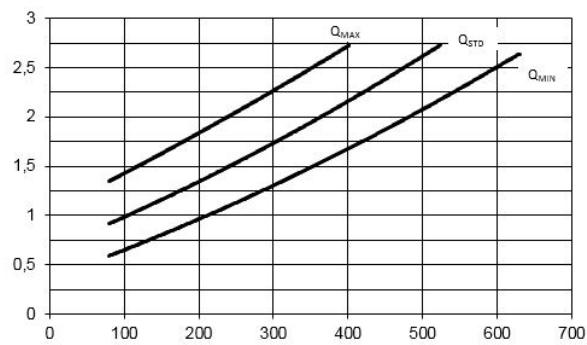

Q_{min} = 7.500 m³/h


Q_{std} = 9.500 m³/h

Q_{max} = 11.500 m³/h

Pressure drop of optional components		Qmin	Qstd	Qmax
RECH - Hydronic recovery device for extended operating range	Pa	47	67	88
F7B - High efficiency F7 Air Filter (ISO 16890 ePM1 60%)	Pa	83	104	151

SIZE 6


Supply fans

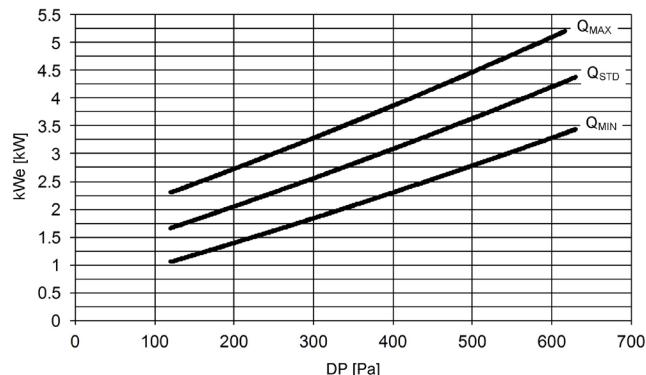

kWe = Total power input (kW)

DP = Static pressure in Pa

Exhaust fans

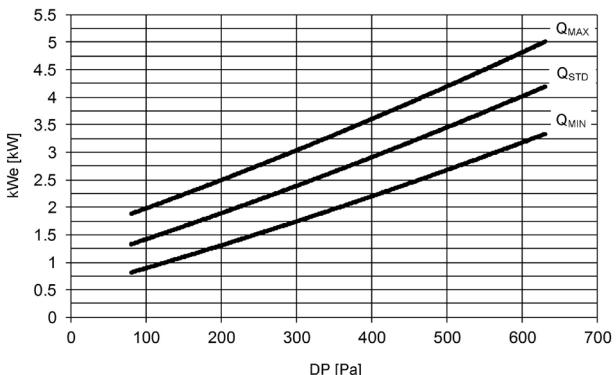

Q_{min} = 9.500 m³/h

Q_{std} = 12.000 m³/h

Q_{max} = 14.000 m³/h

Pressure drop of optional components		Qmin	Qstd	Qmax
RECH - Hydronic recovery device for extended operating range	Pa	50	70	88
F7B - High efficiency F7 Air Filter (ISO 16890 ePM1 60%)	Pa	88	109	153

!! The performance takes into account the pressure drops in the unit (pressure drops in treatment coil, standard filters, etc.).

!! To determine the performance required of the fans, you must add to the usable static pressure desired the pressure drops of any accessories.

Options compatibility

CPAN-XHE3 SERIES OPTIONS		
Option	Description	
Versione		
RTA	Active thermodynamic recovery	Standard
RECH	Hydronic recovery device for extended operating range	Option
Refrigeration circuit		
RCM	Cooling circuit with capacity modulation	Standard
EVE	Electronic expansion valves	Standard
CPHGM	hot gas re-heating coil with capacity modulation	Standard
CEA	Copper/aluminium exchanger on outdoor air with acrylic lining	Option
CCA	Copper/aluminium exchanger on exhaust air with acrylic lining	Option
CPHGM	Hot gas re-heating Cu/Al coil with capacity modulation and acrylic lining	Option
Air side features		
FG4EE	G4 class air filters on outdoor and exhaust air (coarse 60% ISO 16890)	Standard
FEL	Electronic filters	Standard
F7B	High efficiency F7 Air Filter (ISO 16890 ePM1 60%)	Option
PSTAF	Clogged filter differential pressure switch on extract and delivery	Standard
PCOSME	Air flow constant in delivery and expulsion	Standard
PVARC	Variable flow for supply and exhaust air with CO2 probe	Option
PVARCV	Variable flow for supply and exhaust air with CO2+VOC probe	Option
PVARP	Variable flow for supply and exhaust air with supply pressure probe	Option
MHSEX	Immersed electrodes steam humidifying module	◊
MCHSX	Steam-powered humidifying module	◊
RSSX	Remote supply air sensor	◊
Electric Circuit		
CTU	Temperature and humidity control	Standard
PM	Phase monitor	Standard
REX	Integration electric heaters	Standard
MODB	RS485 Serial port with Modbus protocol	Option
LONW	Serial port with LonWorks protocol	Option
BACIP	BACnet-IP serial communication module	Option
DESM	Smoke detector	Option
CRC	Remote control with user interface	Option
NCRC	Remote control with user interface: not required	Opzione
VSXSA	Modification of the supply humidity ratio setpoint "X_SA" by an external signal: enable/disable via external contact or setpoint changing via Modbus and BACnet-IP protocol	Standard*
Installation		
IO	Outdoor installation	Standard
II	Indoor installation	Option
AMRX	Rubber antivibration mounts	◊
AMRUX	Rubber antivibration mounts for unit and humidification module (available only with options: MHSEX-MCHSX)	◊

◊ Accessory separately supplied


* Enabling by the assistance center

Dimensional drawings

SIZE 1

DAA5Gsize1_MHSEX_0

Data: 07/07/2016

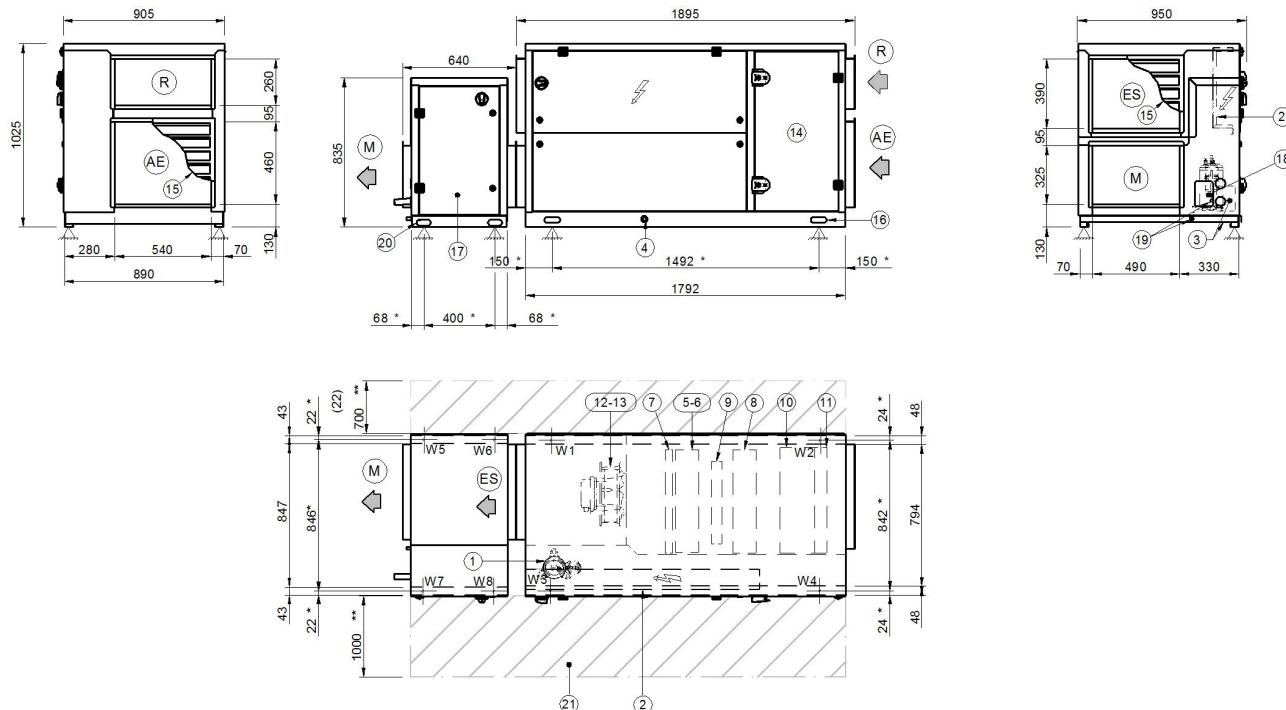

1. Inverter compressor
2. Electrical panel
3. Power input
4. Condensation drain pipe Ø 20 mm
5. Treatment coil (below)
6. Exhaust coil (above)
7. Post-heating coil
8. Hydronic recovery (Optional)
9. Electrical heaters
10. Electrostatic filters
11. Class G4 air filters
12. Supply electric fan (below)
13. Exhaust electric fan (above)
14. Filter maintenance access
15. Grid for outdoor installation (Optional)

16. Lifting holes
17. Humidifier (optional) to be connected to the unit during the installation
18. Humidifier connections
19. Humidifier condensate drain
20. Humidifier lifting holes
21. Functional clearances
22. If unit leaned against the wall provide a space for the electric fan substitution from the roof
- (R) Air return
- (M) Air supply
- (AE) Outdoor air intake
- (ES) Exhaust air
- (*) Vibration mounts position
- (**) Suggested clearance


WEIGHT DISTRIBUTION			
Size		Size 1	
W1 Supporting Point		kg	78
W2 Supporting Point		kg	82
W3 Supporting Point		kg	82
W4 Supporting Point		kg	78
Shipping weight		kg	320

HUMIDIFIER WEIGHT DISTRIBUTION			
Size		Size 1	
W5 Supporting Point		kg	9
W6 Supporting Point		kg	9
W7 Supporting Point		kg	16
W8 Supporting Point		kg	16
Operation weightt		kg	56
Shipping weight		kg	50

The presence of optional accessories may result in a substantial variation of the weights shown in the table.

SIZE 2

DAA5Gsize2_MHSEX_0
Data: 08/07/2016

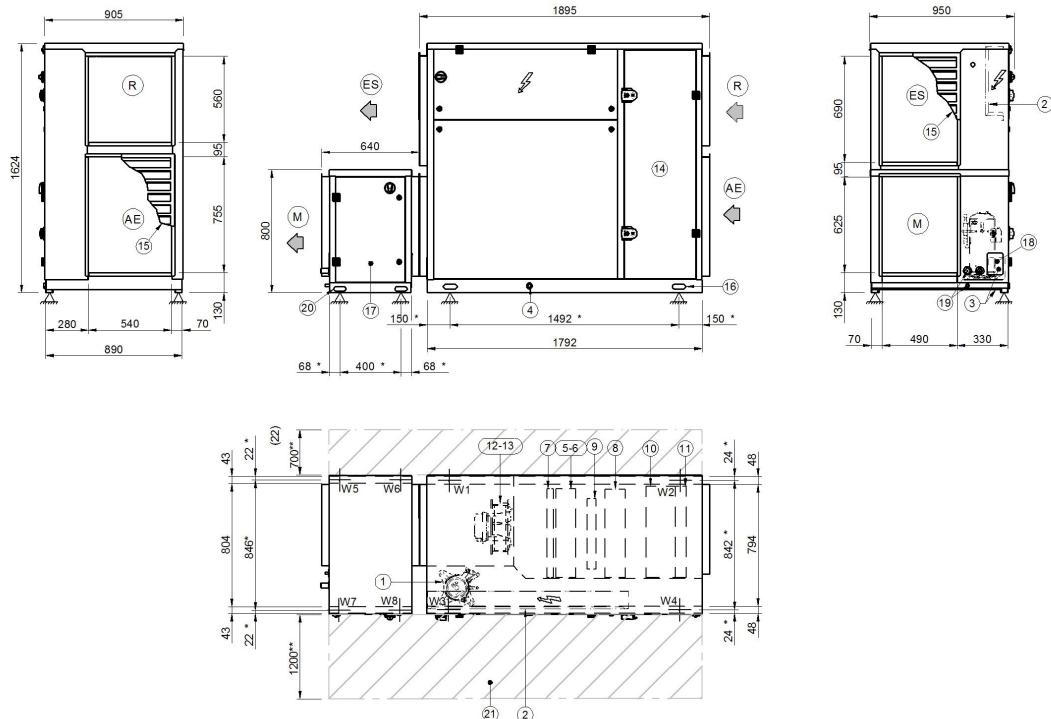

1. Inverter compressor
2. Electrical panel
3. Power input
4. Condensation drain pipe Ø 20 mm
5. Treatment coil (below)
6. Exhaust coil (above)
7. Post-heating coil
8. Hydronic recovery (Optional)
9. Electrical heaters
10. Electrostatic filters
11. Class G4 air filters
12. Supply electric fan (below)
13. Exhaust electric fan (above)
14. Filter maintenance access
15. Grid for outdoor installation (Optional)

16. Lifting holes
17. Humidifier (optional) to be connected to the unit during the installation
18. Humidifier connections
19. Humidifier condensate drain
20. Humidifier lifting holes
21. Functional clearances
22. If unit leaned against the wall provide a space for the electric fan substitution from the roof
- (R) Air return
- (M) Air supply
- (AE) Outdoor air intake
- (ES) Exhaust air
- (*) Vibration mounts position
- (**) Suggested clearance

WEIGHT DISTRIBUTION			
Size		Size 2	
W1 Supporting Point		kg	110
W2 Supporting Point		kg	115
W3 Supporting Point		kg	116
W4 Supporting Point		kg	109
Shipping weight		kg	450


HUMIDIFIER WEIGHT DISTRIBUTION			
Size		Size 2	
W5 Supporting Point		kg	13
W6 Supporting Point		kg	13
W7 Supporting Point		kg	20
W8 Supporting Point		kg	20
Operation weightt		kg	77
Shipping weight		kg	66

The presence of optional accessories may result in a substantial variation of the weights shown in the table.

Dimensional drawings

SIZE 3

DAA5Gsize3_MHSEX_0
Data: 08/07/2016

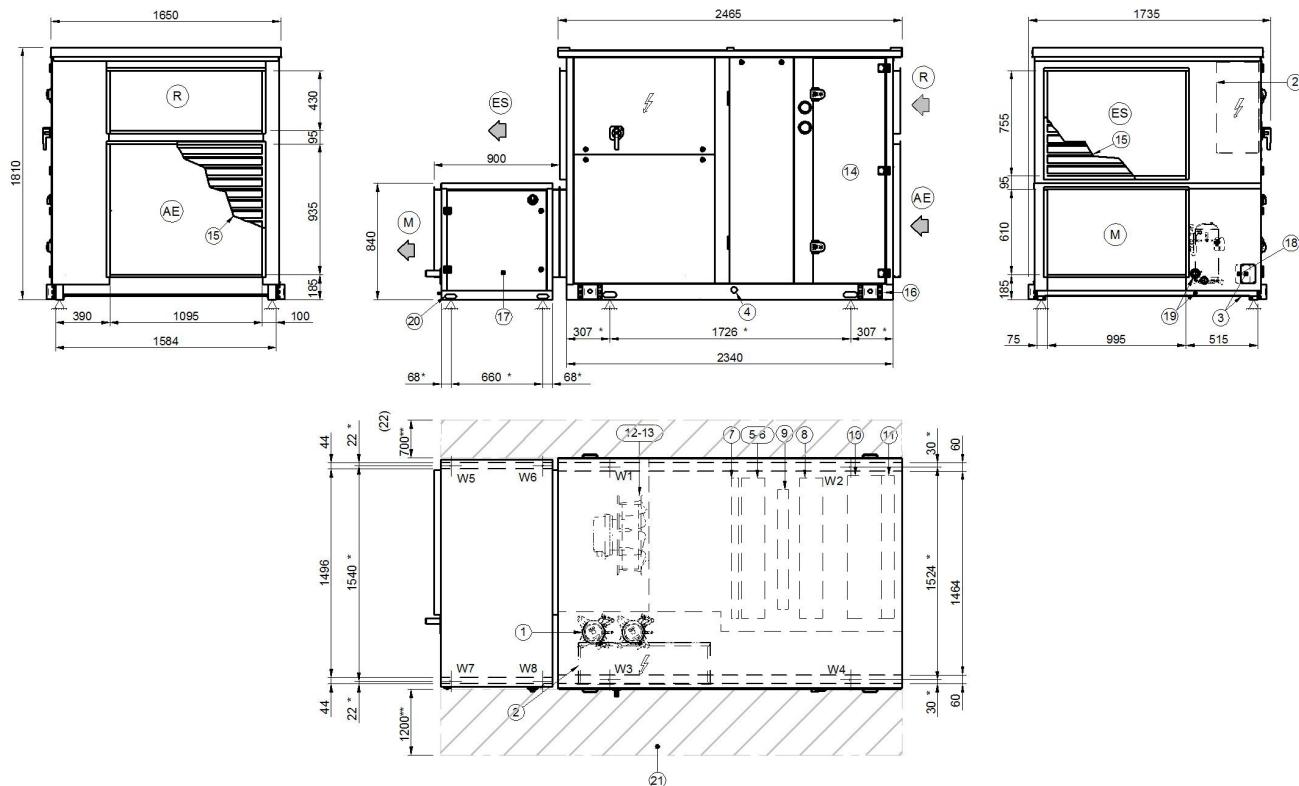

1. Inverter compressor
2. Electrical panel
3. Power input
4. Condensation drain pipe Ø 20 mm
5. Treatment coil (below)
6. Exhaust coil (above)
7. Post-heating coil
8. Hydronic recovery (Optional)
9. Electrical heaters
10. Electrostatic filters
11. Class G4 air filters
12. Supply electric fan (below)
13. Exhaust electric fan (above)
14. Filter maintenance access
15. Grid for outdoor installation (Optional)
16. Lifting brackets (removable)
17. Humidifier (optional) to be connected to the unit during the installation
18. Humidifier connections

19. Humidifier condensate drain
20. Humidifier lifting holes
21. Functional clearances
22. If unit leaned against the wall provide a space for the electric fan substitution from the roof
- (R) Air return
- (M) Air supply
- (AE) Outdoor air intake
- (ES) Exhaust air
- (*) Vibration mounts position
- (**) Suggested clearance

WEIGHT DISTRIBUTION

Size		Size 3	
W1 Supporting Point		kg	259
W2 Supporting Point		kg	273
W3 Supporting Point		kg	289
W4 Supporting Point		kg	249
Shipping weight		kg	1070

HUMIDIFIER WEIGHT DISTRIBUTION


Size		Size 3	
W5 Supporting Point		kg	20
W6 Supporting Point		kg	20
W7 Supporting Point		kg	35
W8 Supporting Point		kg	35
Operation weightt		kg	142
Shipping weight		kg	110

The presence of optional accessories may result in a substantial variation of the weights shown in the table.

SIZE 4

DAA5Gsize4_MHSEX_0

Data: 11/07/2016

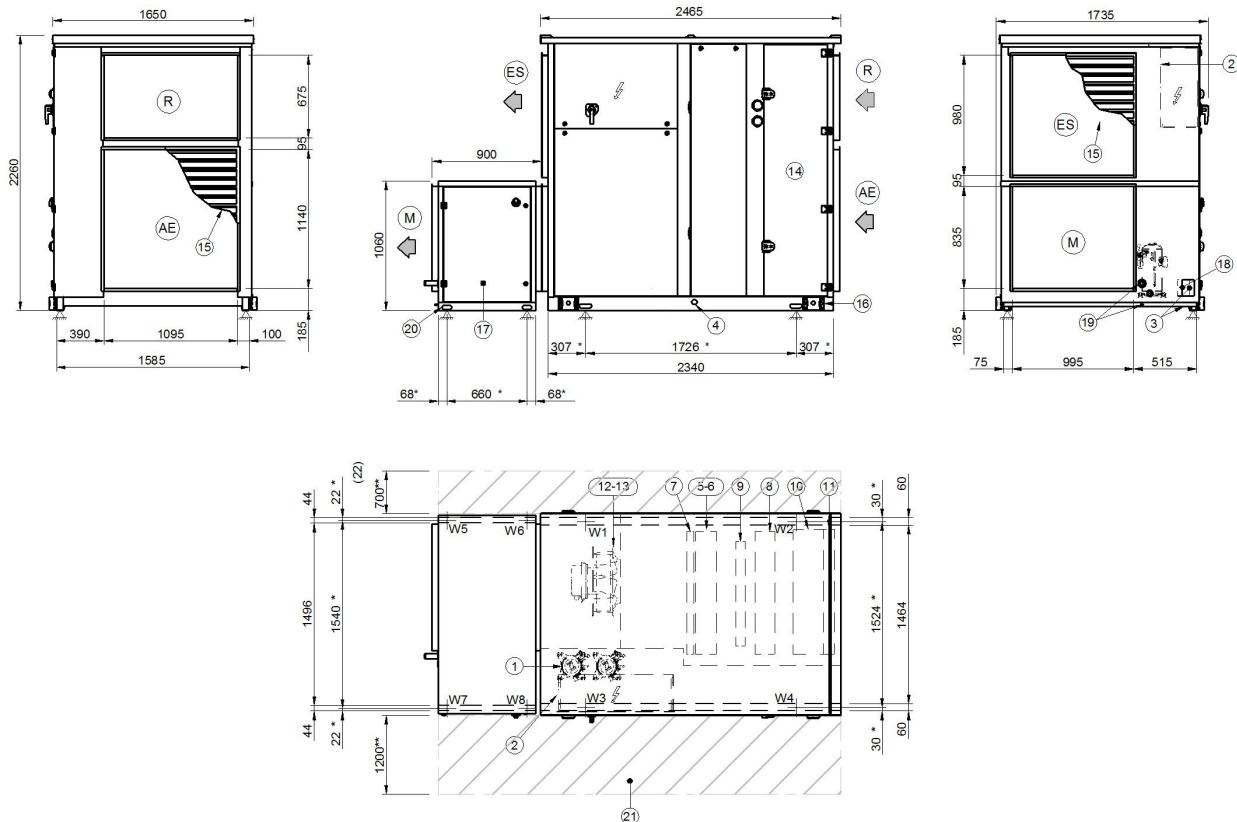

1. Inverter compressor
2. Electrical panel
3. Power input
4. Condensation drain pipe Ø 20 mm
5. Treatment coil (below)
6. Exhaust coil (above)
7. Post-heating coil
8. Hydronic recovery (Optional)
9. Electrical heaters
10. Electrostatic filters
11. Class G4 air filters
12. Supply electric fan (below)
13. Exhaust electric fan (above)
14. Filter maintenance access
15. Grid for outdoor installation (Optional)

16. Lifting brackets (removable)
17. Humidifier (optional) to be connected to the unit during the installation
18. Humidifier connections
19. Humidifier condensate drain
20. Humidifier lifting holes
21. Functional clearances
22. If unit leaned against the wall provide a space for the electric fan substitution from the roof
- (R) Air return
- (M) Air supply
- (AE) Outdoor air intake
- (ES) Exhaust air
- (*) Vibration mounts position
- (**) Suggested clearance

WEIGHT DISTRIBUTION			
Size		Size 4	
W1 Supporting Point		kg	312
W2 Supporting Point		kg	328
W3 Supporting Point		kg	347
W4 Supporting Point		kg	299
Shipping weight		kg	1285

HUMIDIFIER WEIGHT DISTRIBUTION			
Size		Size 4	
W5 Supporting Point		kg	23
W6 Supporting Point		kg	23
W7 Supporting Point		kg	40
W8 Supporting Point		kg	40
Operation weightt		kg	158
Shipping weight		kg	126


The presence of optional accessories may result in a substantial variation of the weights shown in the table.

Dimensional drawings

SIZE 5

DAA5Gsize5_MHSEX_0

Data: 11/07/2016

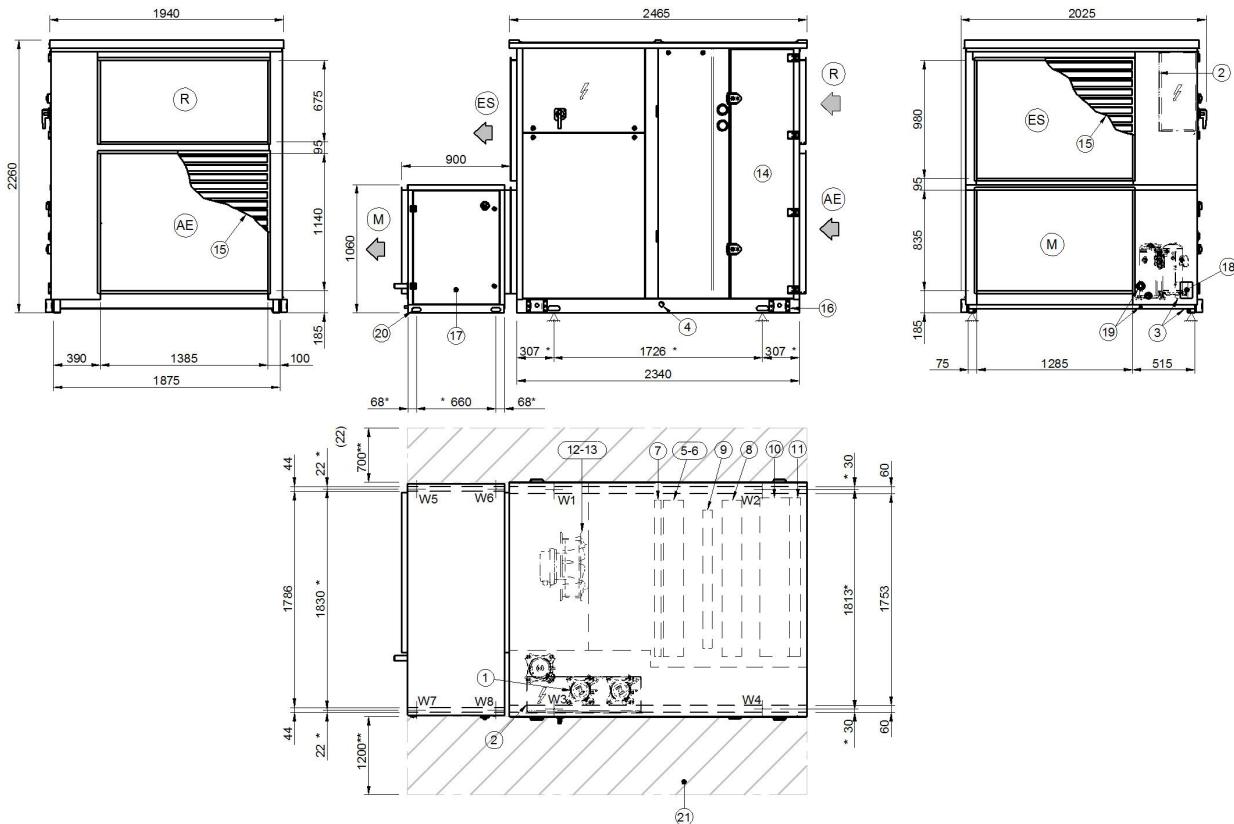

1. Inverter compressor
2. Electrical panel
3. Power input
4. Condensation drain pipe Ø 20 mm
5. Treatment coil (below)
6. Exhaust coil (above)
7. Post-heating coil
8. Hydronic recovery (Optional)
9. Electrical heaters
10. Electrostatic filters
11. Class G4 air filters
12. Supply electric fan (below)
13. Exhaust electric fan (above)
14. Filter maintenance access
15. Grid for outdoor installation (Optional)

16. Lifting brackets (removable)
 17. Humidifier (optional) to be connected to the unit during the installation
 18. Humidifier connections
 19. Humidifier condensate drain
 20. Humidifier lifting holes
 21. Functional clearances
 22. If unit leaned against the wall provide a space for the electric fan substitution from the roof
- (R) Air return
 (M) Air supply
 (AE) Outdoor air intake
 (ES) Exhaust air
 (*) Vibration mounts position
 (**) Suggested clearance

WEIGHT DISTRIBUTION			
Size		Size 5	
W1 Supporting Point		kg	348
W2 Supporting Point		kg	370
W3 Supporting Point		kg	399
W4 Supporting Point		kg	334
Shipping weight		kg	1450


HUMIDIFIER WEIGHT DISTRIBUTION			
Size		Size 5	
W5 Supporting Point		kg	27
W6 Supporting Point		kg	27
W7 Supporting Point		kg	43
W8 Supporting Point		kg	43
Operation weightt		kg	172
Shipping weight		kg	140

The presence of optional accessories may result in a substantial variation of the weights shown in the table.

SIZE 6

DAA5Gsize6_MHSEX_0

Data: 11/07/2016

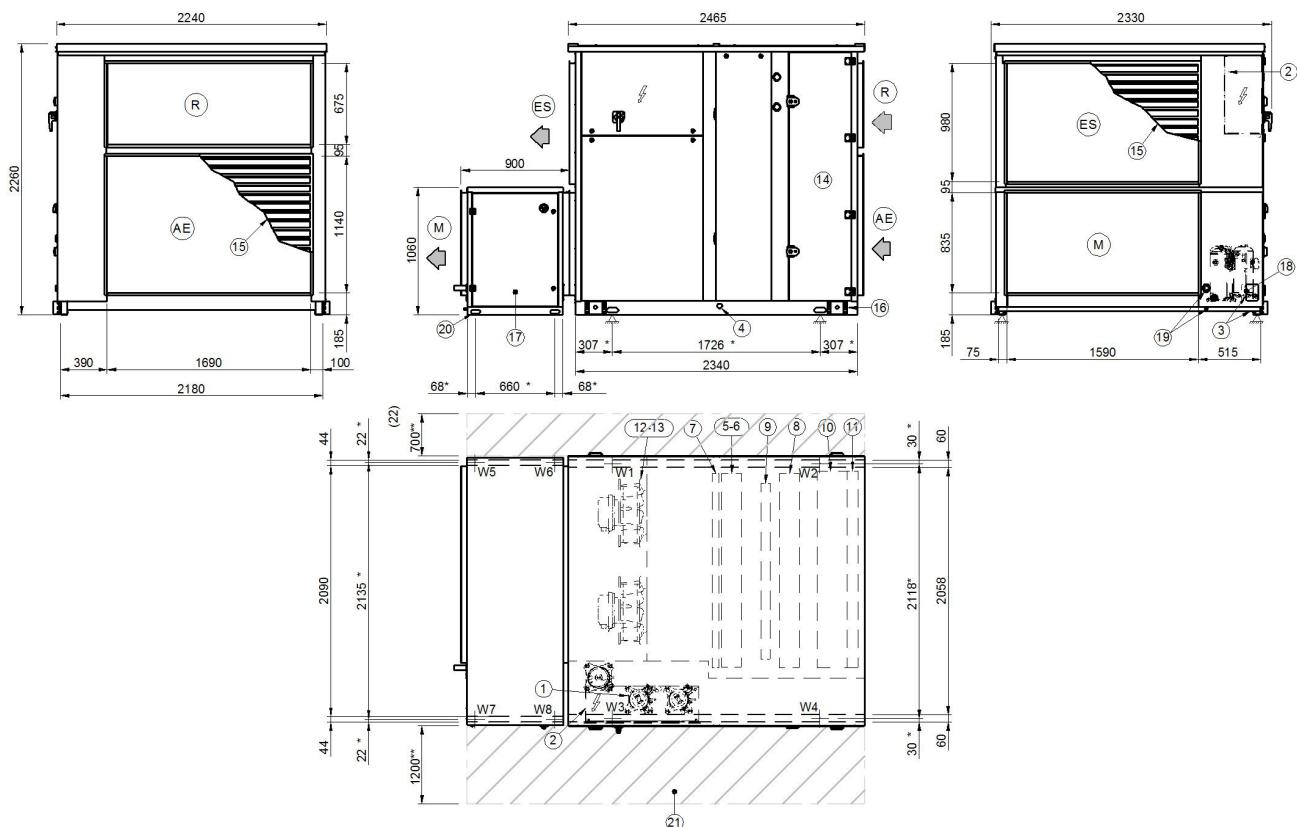

1. Inverter compressor
2. Electrical panel
3. Power input
4. Condensation drain pipe Ø 20 mm
5. Treatment coil (below)
6. Exhaust coil (above)
7. Post-heating coil
8. Hydronic recovery (Optional)
9. Electrical heaters
10. Electrostatic filters
11. Class G4 air filters
12. Supply electric fan (below)
13. Exhaust electric fan (above)
14. Filter maintenance access
15. Grid for outdoor installation (Optional)

16. Lifting brackets (removable)
 17. Humidifier (optional) to be connected to the unit during the installation
 18. Humidifier connections
 19. Humidifier condensate drain
 20. Humidifier lifting holes
 21. Functional clearances
 22. If unit leaned against the wall provide a space for the electric fan substitution from the roof
- (R) Air return
 (M) Air supply
 (AE) Outdoor air intake
 (ES) Exhaust air
 (*) Vibration mounts position
 (**) Suggested clearance

WEIGHT DISTRIBUTION			
Size		Size 6	
W1 Supporting Point		kg	401
W2 Supporting Point		kg	426
W3 Supporting Point		kg	459
W4 Supporting Point		kg	384
Shipping weight		kg	1670

HUMIDIFIER WEIGHT DISTRIBUTION			
Size		Size 6	
W5 Supporting Point		kg	30
W6 Supporting Point		kg	30
W7 Supporting Point		kg	46
W8 Supporting Point		kg	46
Operation weightt		kg	184
Shipping weight		kg	152

The presence of optional accessories may result in a substantial variation of the weights shown in the table.

SYSTEM SELECTION AND PERFORMANCE DATA

Page

- 31 System selection
- 39 Performance data

System selection

The energy performances (power output, power consumption, efficiency) of the ZEPHIR³ system varies according with the following data:

- Outdoor air flow
- Outdoor air conditions
- Indoor air conditions
- Supply air conditions

Outdoor air flow

Design outdoor air flow is determined in accordance with specific laws, rules and regulations in force, with two possible modes:

- Prescriptive approach: it is a common based on the amount of fresh air provided per occupant and per number of occupants. These two variables often depend on the surface area of the zone serviced and its intended use
- Performance approach: it is a common in technical standards, such as the European standard EN13779:2007 which provides different air flow rates depending on the indoor air quality (IDA) required. This choice made by the Client and the Designer results in specific values of the quantity of fresh air introduced per person or floor surface and the level of CO₂ concentration or specific pollutants.


The outdoor air volume shall also depend on the volume of the spaces, typically to get less than 6 air changes per hour. Exceeding this rate may result in undesired effects, such as overheating or subcooling spaces, rather than too high air velocity.

The outdoor flow air is the first input required to select ZEPHIR³ among its available sizes.

Each size features a minimum and maximum air flow value.

Between the two values:

- It is possible to select the required value
- The standard (or nominal) air flow is included. At this value the capacity supplied by the thermodynamic circuit is able to carry out the typical treatment required of Primary Air systems in continental and Mediterranean climates. Cooling and dehumidification treatment results from nominal external temperatures of 35°C d.b. / 24°C w.b. up to specific moisture flow equal to 10 g / kg. In heating, the treatment results from an outdoor conditions of -7°C until the supply temperature is around to 20°C.

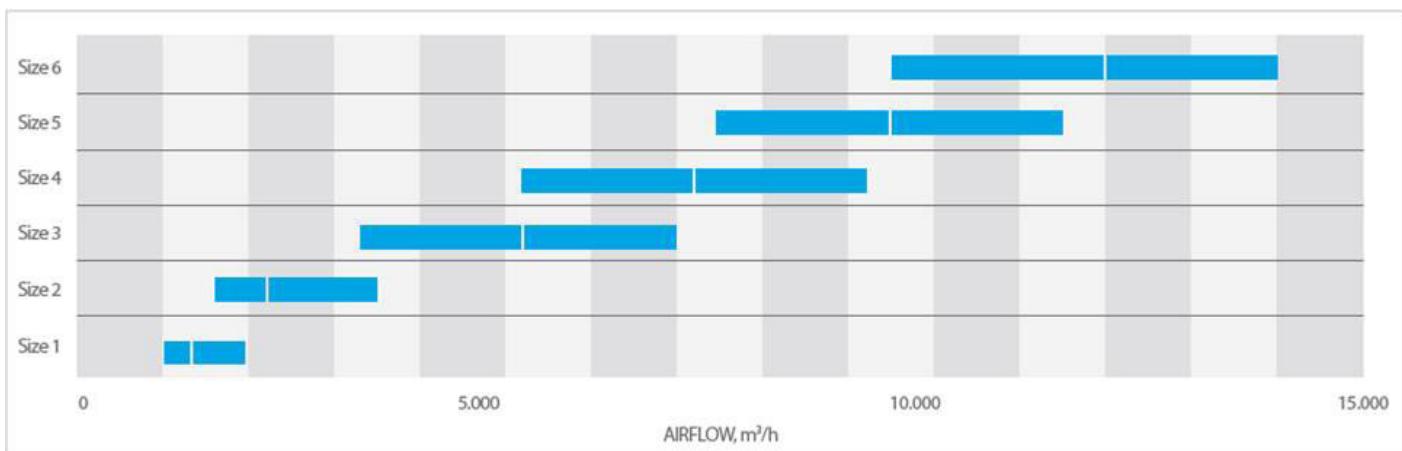


At the same outdoor air flow, two different sized ZEPHIR³ differ for their maximum heating and cooling capacity of the thermodynamic circuit which determines the possible treatment and therefore the supply conditions.

Example

The desired outdoor air flow is equal to 9,500 m³/h. This value can be satisfied by two different sizes:

- Size 5, at nominal air flow
- Size 6, at minimum air flow

At the same outdoor air flow and outdoor and indoor air condition, the greater cooling and heating capacity of the Size 6 compared with Size 5 can obtain stronger air handling.

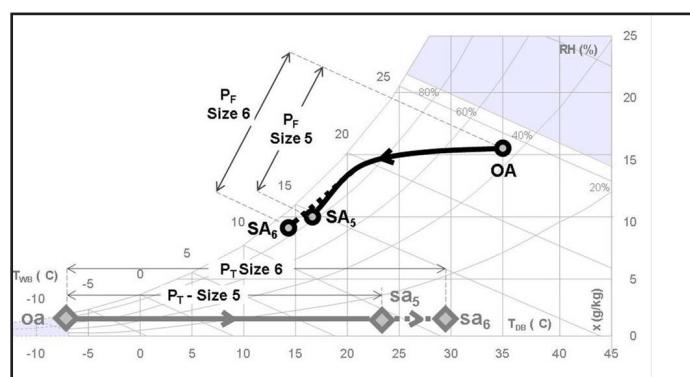

At the same air flow, say 9,500 m³/h, size 5 and size 6 can handle outdoor air from 35°C bs / 24°C bu to 16°C / 9.5 g/kg and 13°C / 8.4 g/kg respectively, or from -7°C to 23°C and 29°C respectively.

Outdoor air conditions

Compared with a traditional reverse cycle air-to-air heat pump, the air flows on the energy exchangers of the ZEPHIR³ are inverted. For this reason also the energy performance follows a different pattern.

In full load operation of the thermodynamic circuit:

- In cooling mode, as the outdoor air temperature (which passes through the evaporator of the thermodynamic circuit) decreases, the total cooling capacity is reduced and the thermodynamic efficiency of the system is increased.
- In heating mode, as the outdoor air temperature (which passes through the condenser of the thermodynamic circuit) decreases, both the heating capacity and the thermodynamic efficiency of the system are increased.

This performance may vary when capacity modulation occurs, according to the selected operating mode..

The choice of size of the ZEPHIR³ is usually based on the design outdoor air conditions in accordance with the laws, rules or regulations in force in this case.

These conditions must be within the operating range of the system, by selecting the option 'RECH - Hydronic recovery device for extended operating range' when ambient conditions may require it.


The maximum outdoor air conditions typically occurs for a few hours per year.

If the selection is carried out under these conditions, it would result in over-sizing the system, thus increasing costs and a reducing both the total efficiency and the regulation accuracy.

When severe conditions occur, ZEPHIR³ may temporarily reduce the air flow to maintain the thermodynamic circuit in operation.

All outdoor air conditions, between the minimum and maximum design temperature, affect the actual seasonal efficiency and therefore the energy consumption of the system. The number of operating hours in these conditions represents the most part of the total number of annual hours.

For this reason, the performance of ZEPHIR³ is detailed under different outdoor air temperatures, so as to evaluate the seasonal efficiency in accordance with the climate profile in different locations.

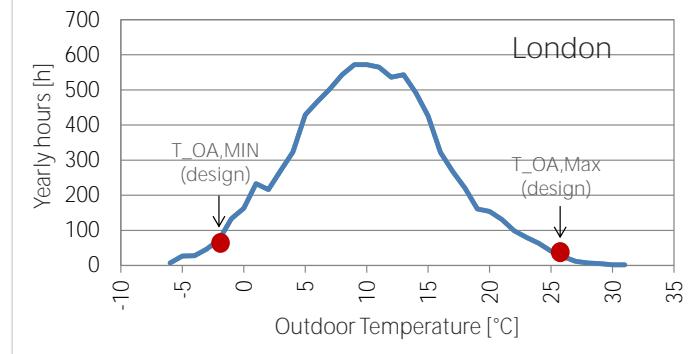

Climate profile for london, uk (source ashrae). on the total number of annual hours, the most severe external temperature compared to the project temperature has an occurrence probability of less than 1%

Indoor air conditions

Indoor air conditions affects the energy performance of the ZEPHIR³ to a lesser extent than the outdoor air.

Also in this case, the size selection is usually done in accordance with the design indoor air conditions as required by the rules and regulations in force for the specific case, so to meet the occupants needs.

Please note that design indoor air humidity has a very important role in the lifespan of the system.


It actually influences both the sizing and the energy consumption of the Primary Air system and therefore the entire building, independently of the system type used (traditional or ZEPHIR³).

In summertime, increasing by 5% increase in the design relative humidity of the indoor air (from 50% to 55%) does not charge the comfort quality perceived by the occupants.

However it reduces up to 15% the cooling capacity required by the primary air system. This results in a reduction of as much as 30% of the power absorbed by the thermodynamic circuit of the ZEPHIR³, thanks to partial load high efficiency.

Similarly in wintertime, when a modest reduction in the design relative humidity of the indoor air occur. Also in this case the latent load of the occupants contributes to an increase in indoor humidity, particularly in applications with high crowding such as shopping malls, offices and restaurants.

This choice verifies that the indoor air conditions and in particular its humidity fall within the operating range of the ZEPHIR³ which uses the extracted air as heat source.

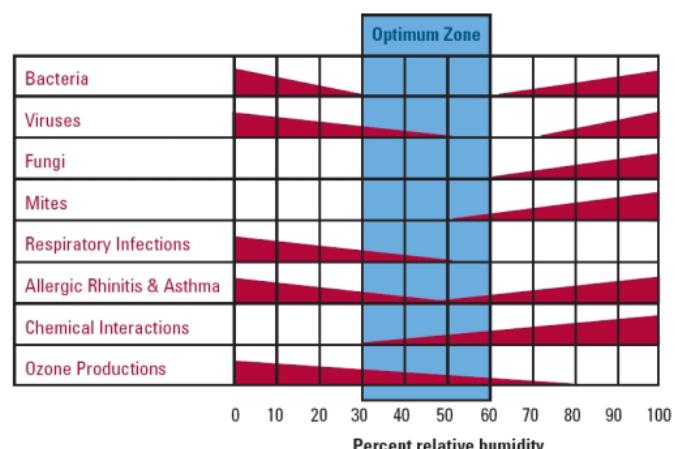

Optimal values of the relative humidity to indoor air (source ashrae). the right choice of project conditions can nearly always reduce energy consumption without affecting the quality of comfort perceived

System selection

Supply air conditions

Depending on the system application and the chosen mode of use, the supply air conditions can be set by the user or automatically managed by the control system of the ZEPHIR³ in accordance with its settings.

General considerations in cooling and dehumidification

The total cooling capacity P_F of the ZEPHIR³ system is provided by the thermodynamic circuit: it determines the cooling and dehumidification handling from the outdoor air OA to the temperature EA off-coil exit from the thermodynamic exchanger (evaporator). The supply air humidity ratio X_{SA} is crucial for the control of the internal hygrometric conditions in many applications.

The P_R reheat capacity increases the air temperature to the value of the supply temperature T_{SA} , without changing the humidity ratio. The reheat capacity is delivered by recovering, in part or in total, the condensation heat which would otherwise be rejected outdoor, with a triple benefit when compared with traditional systems:

- No fuel consumption and no local emission
- No auxiliary consumption to pump hot fluid from the boiler
- Decrease in condensation temperature and thus a further increase in the thermodynamic efficiency of the system.

Setting primary supply air at dry bulb temperature T_{SA} lower than the space air temperature T_{RA} , helps cooling the spaces and lessens the use of the secondary local unit. This contribution is therefore defined as additional capacity available to the space P_D .

Supply humidity ratio X_{SA} reset is available, either through standard volt-free contact (password-protected action) or Modbus / BACnet-IP protocol (option).

ZEPHIR³ system can also be used in particularly hot climates as long as care is taken to select the appropriate size (usually the bigger of the two available at constant air flow) and to select humidity ratio supply values X_{SA} that can meet the operating and comfort needs without over-sizing. At high ambient, exhaust airflow in cooling mode may temporarily increase by up to 30% over the current value. Outdoor airflow intake increases consequently by the same rate. This must be considered when designing ductworks in indoor installation. This does not affect air distribution to space, as the inbuilt compensation device keeps unchanged both supply and return airflow rates.

The optional 'RECH - Hydronic recovery device for extended operating range' pre-conditions outdoor air from OA' conditions to OA (air entering the thermodynamic exchanger).

This duty is included in the total cooling capacity of the system P_F .

General considerations in heating and any humidification

The thermal power P_T of the ZEPHIR³ system is delivered by the thermodynamic circuit: it determines the heating treatment of the outdoor air from the outdoor air temperature T_{OA} until it reaches the supply temperature T_{SA} .

In this case the re-heating is never active.

Setting primary supply air at dry bulb temperature T_{ra} higher than the space air temperature T_{ra} , helps heating the spaces and lessens the use of the secondary local unit.

This contribution is therefore defined as additional capacity available to the space P_D .


Low values of external specific humidity in cold climates often require air humidification before being released to the ambient.

Internal conditions of comfort are thus maintained for the occupants, which is the main functionality of the ZEPHIR³.


In fact, the high crowding in service sector applications often spontaneously raises the ambient humidity thus reducing the need for humidification.

If required, the ZEPHIR³ comes with the 'Steam humidification module' option: the modulating capacity control depends on return air conditions and supplies only the required amount of steam, keeping substantially uncharged the temperature of the Primary Air.

The optional 'RECH - Hydronic recovery device for extended operating range' pre-conditions outdoor air from OA' conditions to OA (air entering the thermodynamic exchanger). This duty is included in the heating capacity of the system P_T . Defrost cycles may temporarily occur.

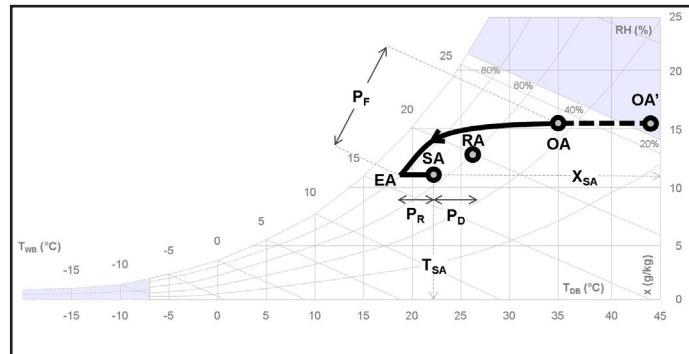

Cooling and dehumidification, and reheating with provision of additional available power to the space. for greater clarity the typical features are identified by capital letters.

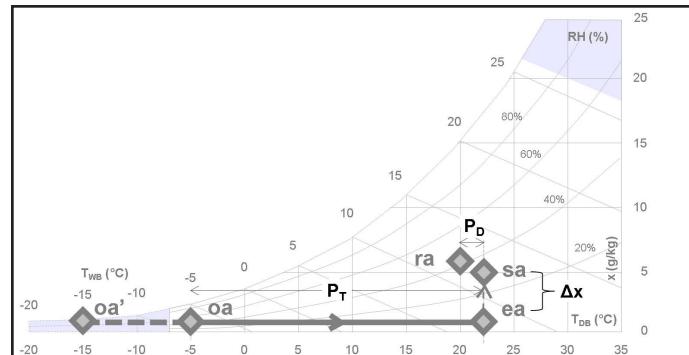

Heating and dehumidification, with provision of additional available power to the space. for greater clarity, the typical features are identified by small letters.

Operation with constant supply control (CS)

In this operating mode the outdoor air is treated according to the supply air conditions set in accordance with one of the two following criteria:

- with two fixed seasonal sets, for operation in cooling and heating mode respectively
- with two dynamic seasonal sets, in which the supply temperature is offset automatically in accordance with the external dry bulb temperature T_{OA} , with climatic regulation.

There is no feedback from the space.

In cooling mode the humidity control of the supply air is standard and a priority.

The automatic capacity control of the thermodynamic circuit modulates the cooling capacity of the system P_F to dehumidify the outdoor air to the value of the humidity ratio of the supply air X_{SA} . Moreover, the set-point of humidity ratio of the supply air X_{SA} can be dynamically changed by external input: free contact or modulating by Modbus protocol and BACnet-IP serial communication module.

The function can be particularly suitable using radiant systems. The control of the supply temperature T_{SA} is carried out through reheating by hot gas recovery, with modulating capacity control.

In heating mode the automatic capacity control of the thermodynamic circuit modulates the thermal power P_T to heat the outdoor air to the value of the supply air temperature T_{SA} .

At outside temperature close to the value of the supply temperature T_{SA} , the unit could use the electric heaters, provided as standard, to guarantee the desired conditions of the introduced air in the room. Humidity control is optional. When selected, it activates the on board humidifier to increase the specific humidity of the supply air X_{SA} , depending on return air conditions.

Size


Please, locate the pages relative to the size with the required outdoor air flow.

Performance data in cooling mode


1. Locate the performance table based on the humidity ratio of the supply air required X_{SA}
2. Locate the outdoor air temperature T_{OA} and CS lines, corresponding to the mode of use (referred to as SET) with constant supply regulation
3. Locate the required supply air temperature, T_{SA}
4. The table shows the total cooling capacity P_F , the reheating capacity P_R , the further power available to the ambient P_D , the electrical power P_A absorbed by the thermodynamic circuit. The table also shows the efficiencies of the system which are described below.

Performance data in heating mode

1. Locate the air temperature T_{OA} and CS lines, corresponding to the mode of use (referred to as SET) with fixed-point supply regulation
2. Locate the required supply air temperature, T_{SA}
3. The table shows the supply air humidity ratio X_{SA} , the heating capacity of the system P_T , the additional capacity available to the space P_D , the electrical power P_A absorbed by the thermodynamic circuit. The table also shows the efficiencies of the system which are described below.

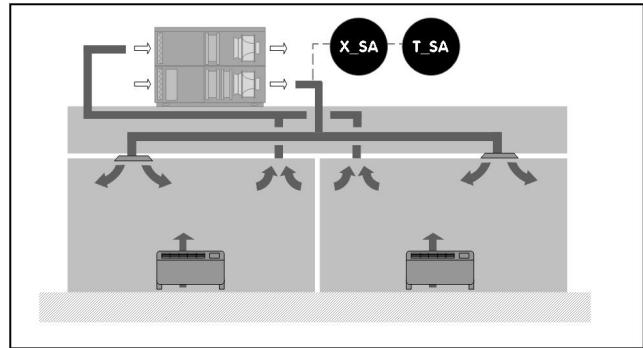

Application principle in cooling operation. the main regulation settings are highlighted

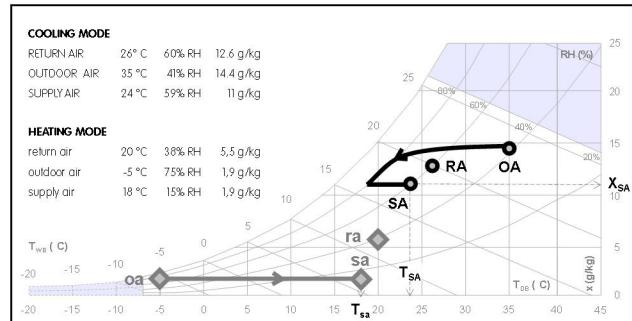

Typical treatments in cooling and heating. the post-heating treatment is highlighted.

SIZE 5 - AIR FLOW 9.500 m³/h (STANDARD) - COOLING

T_OA	SET	T_SA	SUPPLY HUMIDITY RATIO = 10 g/kg						
			P_F	P_R	P_D	P_A	EER_C	EER_S	
35 / 24	MC	26	30,5	31,6	2,8	2,6			
		20	11,5	19,1	29,9	3,3	3,1		
		22	17,8	12,7	29,0	3,7	3,4		
		24	24,2	6,4	28,1	4,0	3,7		
32 / 23	MC	26	32,1	23,1	3,4	3,1			
		20	19,1	21,7	4,2	3,8			
		24	25,8	6,4	20,3	5,2	4,6		
		22	—	30,2	16,4	4,0	3,4		
30 / 22	MC	26	11,1	19,1	15,3	5,0	4,3		
		20	17,5	12,7	14,7	5,6	4,8		
		24	23,9	6,4	14,1	6,3	5,3		
		22	—	28,6	12,8	4,3	3,5		
28 / 21	MC	26	9,5	19,1	11,7	5,5	4,5		
		20	—	22,3	6,4	10,3	7,4	5,9	
		22	15,9	12,7	11,0	6,4	5,2		
		24	22,3	6,4	10,3	7,4	5,9		
25 / 19	MC	18	—	27,0	5,7	5,9	4,1		
		20	8,0	19,1	5,3	7,8	5,3		
		22	14,3	12,7	4,8	10,0	6,5		

SIZE 5 - AIR FLOW 9.500 m³/h (STANDARD) - HEATING

T_OA	SET	T_SA	Performance in Heating					
			X_SA	P_T	P_D	P_A	COP_C	COP_S
-7 / -8	MC	28,7	125,7	27,7	29,8	4,2	3,9	
		22	102,4	6,4	17,5	5,9	5,2	
		18	95,5	—	14,6	6,5	5,7	
		30	88,5	—	12,6	7,0	6,1	
-5 / -6	MC	30	122,0	31,8	29,2	4,2	3,9	
		22	94,7	6,4	15,0	6,3	5,6	
		20	87,8	—	13,1	6,7	5,8	
		18	80,8	—	11,8	6,8	5,8	
0 / -1	MC	28	—	31,8	20,8	4,9	4,5	
		22	61,9	6,4	12,3	6,1	5,3	
		18	59,4	31,8	18,5	5,2	4,6	
		30	68,1	6,4	11,4	6,0	5,1	
2 / 1	MC	22	61,3	—	9,9	6,2	5,1	
		20	54,5	—	8,5	6,4	5,2	
		18	69,9	25,4	13,1	5,3	4,6	
		28	50,0	6,4	8,5	5,9	4,8	
7 / 6	MC	22	43,2	—	6,9	6,3	4,8	
		20	36,8	—	5,1	7,2	5,2	
		18	30,3	9,5	5,6	5,4	4,0	
		23	32,7	6,4	4,7	7,0	4,9	
12 / 11	MC	22	—	—	—	—	—	
		22	—	—	—	—	—	

System selection

Operation at the maximum capacity available (MC)

In this operating mode the supply air temperature T_{SA} can vary in accordance with the temperature of the air extracted from the ambient T_{RA} and their deviation from the set value.

There is feedback from the space.


In cooling mode the humidity control of the supply air is standard and a priority.

The automatic capacity control of the thermodynamic circuit modulates the cooling capacity of the system P_F to dehumidify the outdoor air to the value of the humidity ratio of the supply air X_{SA} . The control of the supply temperature T_{SA} is carried out through reheating by hot gas recovery, with modulating capacity control.


The re-heating capacity increases as the temperature of the air collected from the space (T_{RA}) is closer to the set value.

When the re-heating is zero, we have the maximum value of additional capacity available to the space P_D , which reduces the load assigned to the secondary system.

In heating mode, the automatic capacity control of the thermodynamic circuit modulates the heating capacity P_T to heat the outdoor air. The heating capacity P_T decreases as the return air temperature from space T_{RA} is closer to the set value.

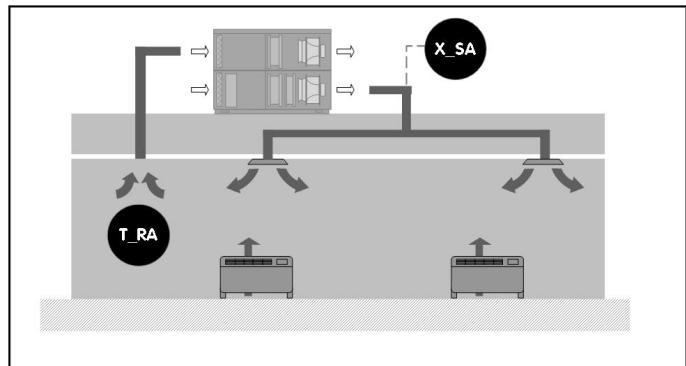

Application principle diagram in cooling operation. the main regulation settings are highlighted

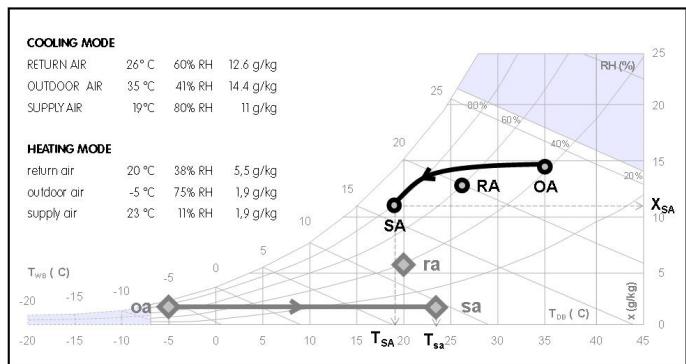

Typical treatments in cooling and heating mode, with ambient value not met.

Size

Please, locate the pages relative to the size with the required outdoor air flow.

Performance data in cooling mode

- Locate the performance table based on the humidity ratio of the supply air required X_{SA}
- Locate the outdoor air temperature T_{OA} and MC lines, corresponding to the operating mode (referred to as SET) in maximum available capacity
- The table shows the total cooling capacity P_F , the reheating capacity P_R , the further power available to the ambient P_D , the electrical power P_A absorbed by the thermodynamic circuit. The table also shows the efficiencies of the system which are described below.

Performance data in cooling mode

- Locate the air temperature T_{OA} and the MC line, corresponding to the operating mode (referred to as SET) at maximum available capacity
- The table shows the supply air humidity ratio X_{SA} , the heating capacity of the system P_T , the additional capacity available to the space P_D , the electrical power P_A absorbed by the thermodynamic circuit. The table also shows the efficiencies of the system which are described below.

Note:

The CS lines, corresponding to the operation mode (indicated as SET) with fixed point supply regulation, now show some operating points that may be encountered in the operation mode at maximum available capacity (MC) when the temperature in the space is partially or totally satisfied, on the basis of the parameters on the extraction section:

- In cooling with reheating activated
- In heating with modulating capacity regulation

SIZE 5 - AIR FLOW 9.500 m³/h (STANDARD) - COOLING

T_OA	SET	T_SA	P_F	P_R	P_D	P_A	FEE C		FEE S			
							1	SUPPLY HUMIDITY RATIO = 10 g/kg				
35 / 24	MC	16,4	—	30,5	31,6	2,8	2,6					
	CS	20	88,6	11,5	19,1	29,9	3,3	5,1				
		22		17,8	12,7	29,0	3,7	3,4				
		24		4,2	6,4	28,1	4,0	3,7				
	MC	15,9	—	32,1	23,1	3,4	3,1					
	CS	20	79,1	19,1	21,7	4,2	3,8					
32 / 23	MC	16,5	—	25,8	6,4	20,3	5,2	4,6				
	CS	20		—	30,2	16,4	4,0	3,4				
		22		11,1	19,1	15,3	5,0	4,3				
		24		17,5	12,7	14,7	5,6	4,8				
	MC	16,5	—	23,9	6,4	14,1	6,3	5,3				
	CS	20	65,4	28,6	12,8	4,3	3,5					
30 / 22	MC	17,0	—	9,5	19,1	11,7	5,5	4,5				
	CS	20	54,4	15,9	12,7	11,0	6,4	5,2				
		22		22,3	6,4	10,3	7,4	5,9				
		24		—	27,0	5,7	5,9	4,1				
	MC	18	—	8,0	19,1	5,3	7,8	5,3				
	CS	20	33,6	—	—	—	—	—				

SIZE 5 - AIR FLOW 9.500 m³/h (STANDARD) - HEATING

T_OA	SET	T_SA	X_SA	Performance in Heating						
				P_T	P_D	P_A	COP C	COP S		
-7 / -8	MC	28,7	—	125,7	27,7	29,8	4,2	3,9		
	CS	22	1,5	102,4	6,4	17,5	5,9	5,2		
		20		95,5	—	14,6	6,5	5,7		
		18		88,5	—	12,6	7,0	6,1		
	MC	30	—	122,0	31,8	29,2	4,2	3,9		
	CS	22	1,9	94,7	6,4	15,0	6,3	5,6		
-5 / -6	MC	30	—	102,4	6,4	17,5	5,9	5,2		
	CS	20	1,9	87,8	—	13,1	6,7	5,8		
		18		80,8	—	11,8	6,8	5,8		
		22		73,8	6,4	12,3	6,1	5,3		
	MC	30	2,8	31,8	20,8	4,9	4,5	4,5		
	CS	20	3,1	55,6	6,4	10,9	6,3	5,3		
0 / -1	MC	30	—	95,4	31,8	18,5	5,2	4,6		
	CS	20	3,1	68,8	—	10,9	6,3	5,3		
		18		61,9	—	9,5	6,5	5,4		
		22		54,5	6,4	12,3	6,1	5,3		
	MC	30	2,8	68,1	6,4	11,4	6,0	5,1		
	CS	20	3,7	61,3	—	9,9	6,2	5,1		
2 / 1	MC	28	—	54,5	—	8,5	6,4	5,2		
	CS	20	3,7	69,9	25,4	13,1	5,3	4,6		
		18		50,0	6,4	8,5	5,9	4,8		
		22		43,2	—	6,9	6,3	4,8		
	MC	28	—	36,8	—	5,1	7,2	5,2		
	CS	20	5,4	30,3	9,5	5,6	5,4	4,0		
7 / 6	MC	23	7,8	32,7	6,4	4,7	7,0	4,9		
	CS	22	—	—	—	—	—	—		
12 / 11	MC	23	7,8	—	—	—	—	—		
	CS	22	—	—	—	—	—	—		

Operation with high air flow (HA)

Available only for the maximum air flow rate for each size.
In this operation mode of use the outdoor air is treated until it reaches the supply temperature provided by a default regulation diagram:

There is no feedback from the space.

In cooling operation mode, the automatic capacity control of the thermodynamic circuit modulates the total cooling capacity of the system (P_F) to cool the outdoor air until it reaches the value of the supply air temperature (X_{SA}). In this treatment the outdoor air is also dehumidified. Re-heat is not active.

In heating mode the automatic capacity control of the thermodynamic circuit modulates the heating capacity (P_T) to heat the outdoor air until it reaches the value of the supply air temperature (T_{SA}). To control humidity, the steam humidification module, is available(optional).

Size

Locate the pages relative to the size with the maximum outdoor air flow.

Performance data in cooling mode

1. Locate the performance table entitled "Supply humidity ratio = not controlled"
2. Locate the outdoor air conditions T_{OA} . All rows are identified with HA, corresponding to the mode of use (indicated like SET) with high air flow
3. The table shows the supply conditions T_{SA} and X_{SA} , the total cooling capacity P_F , Additional capacity available for space P_D , the power absorbed by the thermodynamic circuit P_A . The table also shows the system efficiencies, which are described below

Performance data in heating mode

1. Locate the outdoor air conditions T_{OA} . All rows are identified with HA, corresponding to the mode of use (indicated like SET) with high air flow
2. The table shows the supply conditions T_{SA} and X_{SA} , the total cooling capacity P_F , Additional capacity available for space P_D , the power absorbed by the thermodynamic circuit P_A . The table also shows the system efficiencies, which are described below


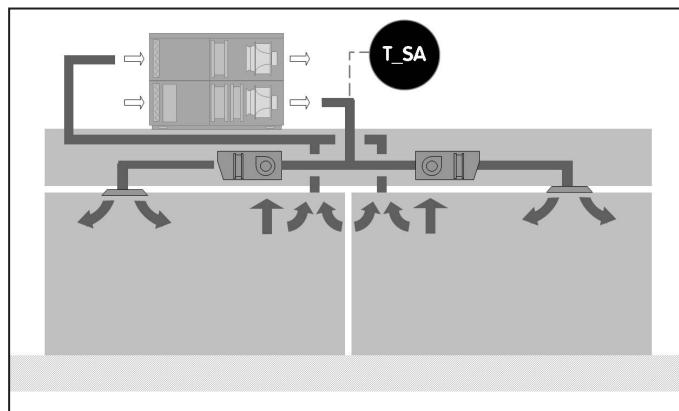


Diagram showing the operating principle in cooling operation. the main regulation settings are highlighted

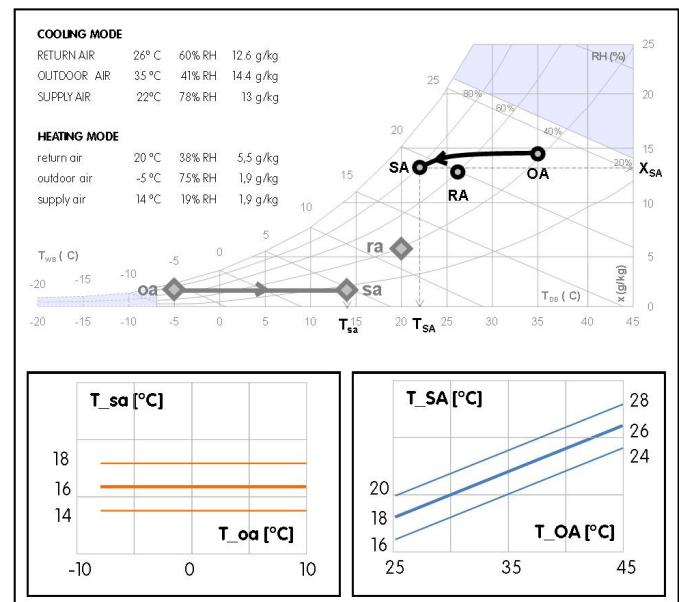

Typical treatments in cooling and heating mode. the supply temperatures are highlighted in heating and cooling mode based on the outdoor air temperature (climatic control)

SIZE 5 - AIR FLOW 11.500 m³/h (MAXIMUM) - COOLING

SUPPLY HUMIDITY RATIO = not controlled								
Performance in Cooling and in Dehumidification								
T_{OA}	SET	T_{SA}	X_{SA}	P_F	P_D	P_A	EER_C	EER_S
45/26	HA	26	13,1	70,1	0,0	14,2	4,9	3,9
40/25	HA	24	12,6	69,7	7,7	14,3	4,9	3,8
35/24	HA	22	12,4	65,6	15,4	13,4	4,9	3,8
32/23	HA	21	12,0	59,5	19,3	11,8	5,0	3,8
30/22	HA	20	11,5	54,7	23,1	10,7	5,1	3,8
28/21	HA	19	10,9	52,0	27,0	10,0	5,2	3,8
25/19	HA	18	10,2	37,3	30,8	6,0	6,2	3,8

SIZE 5 - AIR FLOW 11.500 m³/h (MAXIMUM) - HEATING

Performance in Heating								
T_{OA}	SET	T_{SA}	X_{SA}	P_T	P_D	P_A	COP_C	COP_S
-7/-8	MC	19,6		113,5	—	21,4	5,3	4,5
	CS	18	1,5	106,8	—	17,9	6,0	4,9
	HA	16		98,5	—	14,2	6,9	5,5
	MC	21,6		112,5	6,2	22,3	5,0	4,3
-5/-6	CS	20	1,9	106,0	—	18,5	5,7	4,7
		18		97,7	—	14,7	6,6	5,3
	HA	16		89,3	—	11,7	7,6	5,8
	MC	27,3		113,1	28,1	25,1	4,5	3,9
0/-1	CS	22		103,5	—	7,7	14,3	6,4
		20	3,1	95,5	—	11,2	7,4	5,5
	HA	18		75,0	—	9,6	7,8	5,6
	MC	29,3		66,7	—	8,1	8,2	5,6
	CS	27		112,1	35,8	25,8	4,3	3,8
	HA	16		55,5	—	11,2	7,4	5,5

System selection

System energy efficiency

The performance tables show the operating efficiency values of ZEPHIR³ in cooling mode (EER) and in heating mode (COP), further divided in:

- Thermodynamic efficiency of the system (EER_C in cooling mode and COP_C in heating mode)
- Overall efficiency of the system (EER_S in cooling and COP_S in heating)

The thermodynamic efficiency of the system is the relationship between the total power delivered by the system and the power absorbed by the thermodynamic circuit.

In cooling mode the total capacity supplied includes the re-heating capacity, which in a traditional system should be supplied separately.

The overall system efficiency also includes fan power input.

The available static pressure is assumed to be 150 Pa on the supply section and 100 Pa on the extraction section.

The overall system efficiency also includes the optional 'RECH - Hydronic recovery device for extended operating range', when required.

Seasonal energy performances

The actual efficiency of a system must be assessed during the entire annual operating cycle and not only at design conditions.

For this reason, the performance tables also show the seasonal values of supplied energy (E_T), absorbed energy (E_A), thermodynamic energy efficiency of the system (SE_C) and the overall energy efficiency of the system (SE_S), in three European locations representing three climates:

- Cold climate: reference city Stockholm. Similar performance in Bruxelles, Munich, Wien, Warsaw.
- Temperate climate: reference city London. Similar performance for Paris, Milan, Bilbao and Frankfurt.
- Mediterranean climate: reference city Rome. Similar performance for Barcelona, Lisbon and Palermo.
- Hot and dry climate: reference city Valencia. Similar performance for Athens and Bangalore
- Hot and humid climate: reference city Tunis. Similar performance for Algiers, Casablanca, Cairo.

The analysis uses the Bin Method procedure, where the seasonal values are obtained by regularly calculating performance at different temperatures and multiplying the results by the number of hours of occurrence of each temperature.

Continuous operation, for a total of 8,760 hours/year, is considered.

The seasonal energy performance is shown in different operating modes

- Operation with constant supply control: the values are provided based on the supply air temperature T_SA, in both cooling and heating mode
- Operation at maximum available capacity: as the air supply temperature (T_SA) is variable, both in cooling and heating mode, in this operating mode the seasonal energy performance is shown in the row featuring the '-' symbol in T_SA
- Use with high air flow: as the supply air temperature T_SA in cooling mode is variable, in this mode of operation the seasonal energy performance is shown in the row featuring the '-' symbol in the T_SA field of the table.

**SNS4U
SH74U**



8-BIT SHIFT

LOW POWER

CONT

8-BIT
SHIFT
CIRCUIT
JCK INPUTS
HIGH SPEED TERMINATION


LOADING (Note 4)

HIGH	LOW
0.5 U.L.	0.25 U.L.
1.0 U.L.	0.25 U.L.

PERFORMANCE DATA

- L. Input Load (Note 1) = 40 pA. Input High (Note 2) = 2.0V and 5.0V for Commercial; Output LOW drive factor 1.0 to 2.0 U.L. for Military (Note 3) and 5.0 U.L. for Commercial SH74U Temperature Range.

LOGIC DIAGRAM

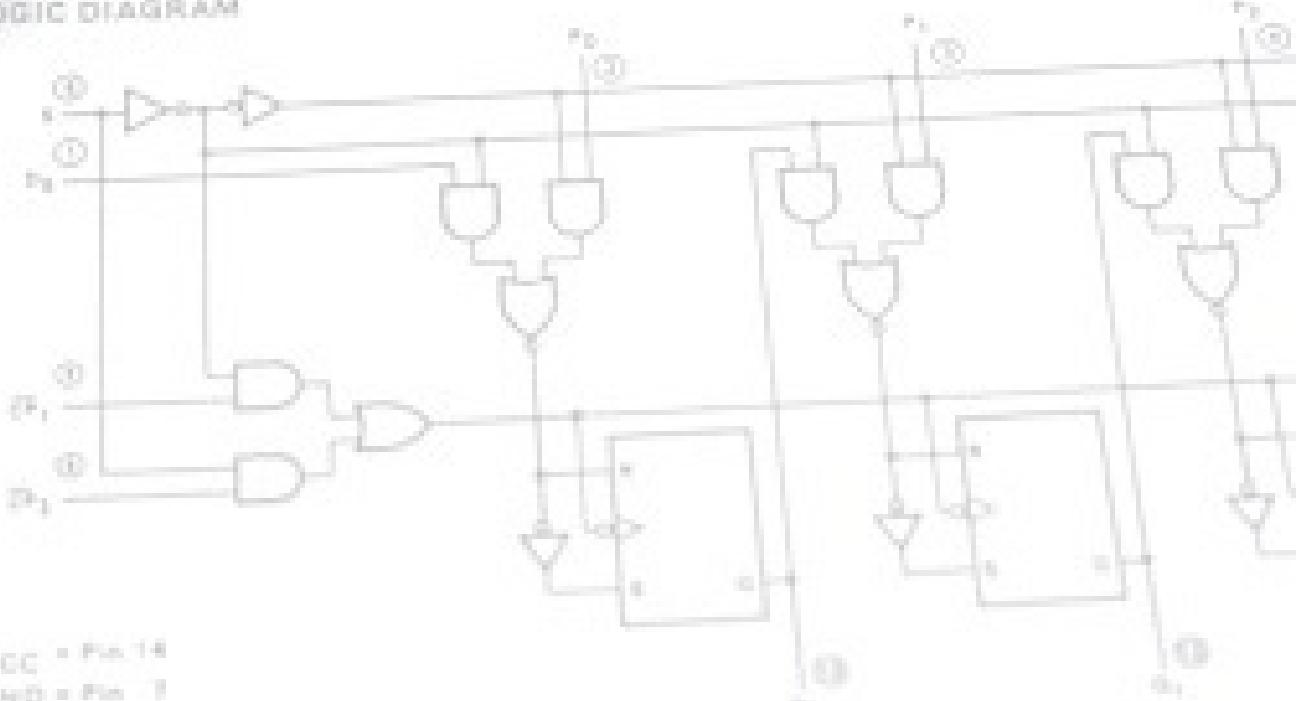

VCC = Pin 14
GND = Pin 1

Performance data

SIZE 1 - AIR FLOW 1.000 m³/h (MINIMUM) - COOLING

SUPPLY HUMIDITY RATIO = 9 g/kg									Seasonal energy performances				
		Performance in cooling and in dehumidification						Seasonal energy performances			SE_C		
T_OA	SET	T_SA	P_F	P_R	P_D	P_A	EER_C	EER_S	T_SA	E_T	E_A	SE_C	SE_S
35 / 24	MC	14,7	10,7	-	3,78	4,04	2,6	2,5	STOCKHOLM	853	197	4,3	3,7
	CS	20		1,77	2,01	3,78	3,3	3,2				6,7	5,7
	CS	22		2,44	1,34	3,69	3,6	3,4				7,7	6,5
	CS	24		3,11	0,67	3,60	3,8	3,7				6,4	5,7
32 / 23	MC	14	9,88	-	4,15	3,51	2,8	2,7	LONDON	1.364	322	4,2	3,8
	CS	20		2,14	2,01	3,24	3,7	3,5				6,5	5,7
	CS	22		2,81	1,34	3,16	4,0	3,8				7,5	6,5
	CS	24		3,48	0,67	3,08	4,3	4,1				6,2	5,7
30 / 22	MC	14,1	8,66	-	3,98	2,52	3,4	3,2	ROME	11.220	2.787	4,0	3,6
	CS	20		1,98	2,01	2,31	4,6	4,3				6,1	5,4
	CS	22		2,65	1,34	2,23	5,1	4,7				6,9	6,1
	CS	24		3,31	0,67	2,16	5,5	5,1				6,2	5,7
28 / 21	MC	13,1	7,88	-	4,32	2,24	3,5	3,3	VALENCIA	13.825	3.594	3,8	3,5
	CS	20		2,31	2,01	1,96	5,2	4,8				5,7	5,1
	CS	22		2,98	1,34	1,88	5,8	5,3				6,4	5,8
	CS	24		3,65	0,67	1,80	6,4	5,9				5,9	5,4
25 / 19	MC	14,2	5,45	-	3,95	1,23	4,4	3,9					
	CS	20		1,94	2,01	1,07	6,9	6,0					
	CS	22		2,61	1,34	1,01	8,0	6,8					

SUPPLY HUMIDITY RATIO = 10 g/kg									Seasonal energy performances				
		Performance in cooling and in dehumidification						Seasonal energy performances			SE_C		
T_OA	SET	T_SA	P_F	P_R	P_D	P_A	EER_C	EER_S	T_SA	E_T	E_A	SE_C	SE_S
45 / 28 *	MC	15,8	14,7	-	3,42	5,96	2,5	2,4	STOCKHOLM	665	127	5,2	4,2
	CS	20		1,41	2,01	5,71	2,8	2,7				7,9	6,1
	CS	22		2,08	1,34	5,59	3,0	2,9				9,3	7,2
	CS	24		2,75	0,67	5,47	3,2	3,1				7,6	6,5
40 / 25	MC	17,6	10,1	-	2,81	3,30	3,1	2,9	LONDON	1.068	210	5,1	4,3
	CS	20		0,80	2,01	3,18	3,4	3,3				7,6	6,3
	CS	22		1,47	1,34	3,08	3,8	3,6				9,0	7,3
	CS	24		2,14	0,67	2,99	4,1	3,9				7,3	6,5
35 / 24	MC	15,7	9,57	-	3,45	3,03	3,2	3,0	ROME	8.896	1.851	4,8	4,1
	CS	20		1,44	2,01	2,86	3,8	3,6				8,2	6,9
	CS	22		2,11	1,34	2,78	4,2	4,0				7,3	6,4
	CS	24		2,78	0,67	2,70	4,6	4,3					
32 / 23	MC	15,7	8,43	-	3,45	2,36	3,6	3,3	VALENCIA	11.105	2.436	4,6	4,0
	CS	20		1,44	2,01	2,21	4,5	4,1				6,5	5,6
	CS	22		2,11	1,34	2,14	4,9	4,6				7,5	6,4
	CS	24		2,78	0,67	2,07	5,4	5,0					
30 / 22	MC	15,6	7,37	-	3,48	1,91	3,9	3,5	TUNIS	15.896	3.779	4,2	3,7
	CS	20		1,47	2,01	1,76	5,0	4,6				5,8	5,0
	CS	22		2,14	1,34	1,70	5,6	5,1				6,6	5,6
	CS	24		2,81	0,67	1,63	6,2	5,7					
28 / 21	MC	15,2	6,41	-	3,62	1,52	4,2	3,8		19.903	3.441	5,8	5,0
	CS	20		1,61	2,01	1,36	5,9	5,2				6,6	5,6
	CS	22		2,28	1,34	1,29	6,7	6,0					
	CS	24		2,95	0,67	1,23	7,6	6,7					
25 / 19	MC	15,7	4,23	-	3,45	0,79	5,4	4,4		21.727	3.290	6,0	5,3
	CS	20		1,44	2,01	0,70	8,1	6,6					
	CS	22		2,11	1,34	0,65	9,7	7,7					

SUPPLY HUMIDITY RATIO = 11 g/kg

Performance in cooling and in dehumidification								Seasonal energy performances					
T_OA	SET	T_SA	P_F	P_R	P_D	P_A	EER_C	EER_S	T_SA	E_T	E_A	SE_C	SE_S
45 / 28 *	MC	17	13,6	-	3,08	5,12	2,7	2,6	STOCKHOLM	STOCKHOLM			
		20		1,07	2,01	4,93	3,0	2,9		-	49	10	5,1
		CS		1,74	1,34	4,82	3,2	3,0		20	58	9	6,5
		24		2,41	0,67	4,70	3,4	3,3		22	64	8	7,8
45 / 26	MC	20,3	9,72	-	1,91	2,75	3,5	3,3		24	71	8	9,2
		CS		0,57	1,34	2,65	3,9	3,6		LONDON			
		24		1,24	0,67	2,53	4,3	4,1		-	143	29	5,0
		MC		19	-	2,41	2,47	3,6		20	167	27	6,3
40 / 25	CS	20	8,95	0,40	2,01	2,42	3,9	3,6		22	186	25	7,4
		22		1,07	1,34	2,33	4,3	4,0		24	205	23	8,7
		24		1,74	0,67	2,24	4,8	4,4	ROME				
		MC		17	-	2,95	2,26	3,7	-	2,659	536	5,0	
35 / 24	CS	20	8,32	0,94	2,01	2,15	4,3	4,0	20	3,115	498	6,3	
		22		1,61	1,34	2,08	4,8	4,4	22	3,463	469	7,4	
		24		2,28	0,67	2,01	5,3	4,9	24	3,811	440	8,7	
		MC		17	-	2,88	1,73	4,1	VALENCIA				
32 / 23	CS	20	7,11	0,87	2,01	1,64	4,9	4,4	-	4,584	962	4,8	
		22		1,54	1,34	1,58	5,5	4,9	20	5,329	897	5,9	
		24		2,21	0,67	1,51	6,2	5,6	22	5,895	851	6,9	
		MC		17	-	2,91	1,34	4,5	TUNIS				
30 / 22	CS	20	6,05	0,90	2,01	1,26	5,5	4,9	-	8,111	1,868	4,3	
		22		1,57	1,34	1,21	6,3	5,5	20	9,271	1,758	5,3	
		24		2,24	0,67	1,15	7,2	6,3	22	10,149	1,683	6,0	
		MC		17	-	2,88	0,96	5,1	VALENCIA				
28 / 21	CS	20	4,89	0,87	2,01	0,88	6,5	5,5	-	6,461	802	8,1	
		22		1,54	1,34	0,83	7,8	6,4	20	11,028	1,601	6,9	
		24		2,21	0,67	0,77	9,2	7,5	TUNIS				
		MC		17	-	2,88	0,96	5,1	22	11,028	1,601	6,9	

SIZE 1 - AIR FLOW 1.000 m³/h (MINIMUM) - HEATING

Performance in Heating								Seasonal energy performances					
T_OA	SET	T_SA	x_SA	P_T	P_D	P_A	COP_C	COP_S	T_SA	E_T	E_A	SE_C	SE_S
-20 / -21 *	MC	25,2	0,20	16,8	1,74	5,89	2,9	2,8	STOCKHOLM	STOCKHOLM			
		22		15,6	0,67	4,60	3,4	3,2		-	64,534	15,695	4,1
		CS		20	-	3,93	3,8	3,6		22	41,011	7,035	5,8
		18		14,1	-	3,26	4,3	4,1		20	29,692	4,820	6,2
-15 / -16 *	MC	30	0,50	16,4	3,35	6,28	2,6	2,5	LONDON	LONDON			
		22		13,4	0,67	3,37	4,0	3,7		-	49,952	10,659	4,7
		CS		20	-	2,80	4,5	4,2		22	24,805	3,681	6,7
		18		12,7	-	2,33	5,2	4,7		20	10,495	1,559	6,7
-12 / -13 *	MC	30	0,80	15,1	3,35	5,39	2,8	2,7	ROME	ROME			
		22		12,2	0,67	2,80	4,4	4,1		-	25,759	5,237	4,9
		CS		20	-	2,33	4,9	4,5		22	10,423	1,477	7,1
		18		11,4	-	1,85	5,8	5,2		20	2,986	432	6,9
-7 / -8	MC	29,5	1,50	13,6	3,18	3,97	3,4	3,3	VALENCIA	VALENCIA			
		22		10,8	0,67	2,33	4,6	4,3		-	19,553	3,869	5,1
		CS		20	-	1,94	5,2	4,7		22	6,600	918	7,2
		18		9,30	-	1,63	5,7	5,2		20	1,437	206	7,0
-5 / -6	MC	30	1,90	12,9	3,35	3,70	3,5	3,3	TUNIS	TUNIS			
		22		9,96	0,67	1,99	5,0	4,6		-	15,061	2,850	5,3
		CS		20	-	1,68	5,5	5,0		22	3,409	452	7,5
		18		8,49	-	1,41	6,0	5,4		20	39	5	7,1
0 / -1	MC	30	3,10	10,9	3,35	2,75	4,0	3,7	VALENCIA	VALENCIA			
		22		7,96	0,67	1,38	5,8	5,1		-	1,278	162	7,9
		CS		20	-	1,09	6,6	5,7		22	3,409	452	7,5
		18		6,51	-	0,87	7,5	6,2		20	39	5	7,1
2 / 1	MC	30	3,70	10,00	3,35	2,39	4,2	3,9	TUNIS	TUNIS			
		22		7,17	0,67	1,13	6,3	5,5		-	34	4	8,0
		CS		20	-	0,92	7,1	6,0		22	3,409	452	7,5
		18		5,73	-	0,71	8,0	6,5		20	39	5	7,1
7 / 6	MC	30	5,40	8,07	3,35	1,70	4,7	4,3	VALENCIA	VALENCIA			
		22		5,26	0,67	0,70	7,6	6,1		-	1,278	162	7,9
12 / 11	MC	30	7,80	6,19	3,35	1,10	5,6	4,9	TUNIS				

Notes
* System with "Hydronic recovery device for extended operating range" option
T_OA = Dry bulb/wet bulb outdoor air temperature [°C]
SET = Operation mode: MC = Maximum Capacity, CS = Constant Supply, HA = High Air Flow
T_SA = Dry bulb supply air temperature [°C]
X_SA = Supply air humidity ratio [g/kg]
P_F = Overall cooling capacity of the system (kW)
P_T = Heating capacity of the system [kW]
P_R = Post-heating capacity [kW]
P_D = Additional capacity available to the space [kW]
P_A = Electricity absorbed by the thermodynamic circuit [kW]
EER_C = Thermodynamic efficiency of the system in cooling mode
EER_S = Overall efficiency of the system in cooling mode (thermodynamic circuit and fans)
COP_C = Thermodynamic efficiency of the system in heating mode

COP_S = Overall efficiency of the system in heating mode (thermodynamic circuit and fans)
E_T = Seasonal thermal/cooling energy supplied [kWh]
E_A = Overall seasonal electricity absorbed [kWh]
SE_C = Thermodynamic seasonal efficiency of the system
SE_S = Overall seasonal efficiency of the system (thermodynamic circuit and fans)
In heating mode, the performances are considered with maximum air temperature supply T_SA equal to 30°C
The performance refers to a standard ZEPHIR[®] unit (not fitted with a 'Steam-powered humidification module' option)
Return air in cooling mode = 26°C DB
Return air in heating mode = 20°C / 12°C
Available static pressure: supply 150 Pa, return 100 Pa
Performance values do not include the effect of fan motor heat
Source: ASHRAE weather data (International weather for energy calculation)

SIZE 1 - AIR FLOW 1.300 m³/h (STANDARD) - COOLING

SUPPLY HUMIDITY RATIO = 10 g/kg									Seasonal energy performances						
Performance in cooling and in dehumidification															
T_OA	SET	T_SA	P_F	P_R	P_D	P_A	EER_C	EER_S	T_SA	E_T	E_A	SE_C	SE_S		
35 / 24	MC	16	12,20	-	4,22	4,40	2,8	2,6		STOCKHOLM					
		20		1,61	2,61	4,17	3,3	3,1		-	833	156	5,3	4,1	
	CS	22		2,48	1,74	4,04	3,6	3,4		20	1.105	138	8,0	5,9	
		24		3,35	0,87	3,92	4,0	3,7		22	1.237	130	9,5	7,0	
32 / 23	MC	16,3	10,70	-	4,22	3,45	3,1	2,9		LONDON					
		20		1,61	2,61	3,25	3,8	3,5		-	1.340	259	5,2	4,2	
	CS	22		2,48	1,74	3,13	4,2	3,9		20	1.764	230	7,7	6,1	
		24		3,35	0,87	3,02	4,7	4,3		22	116	16	7,4	6,2	
30 / 22	MC	16,2	9,33	-	4,27	2,56	3,6	3,3		ROME					
		20		1,65	2,61	2,38	4,6	4,2		22	332	47	7,0	6,1	
	CS	22		2,52	1,74	2,28	5,2	4,7		-	11.172	2.320	4,8	4,1	
		24		3,40	0,87	2,19	5,8	5,2		24	14.412	2.079	6,9	5,7	
28 / 21	MC	15,8	8,07	-	4,44	1,95	4,1	3,7		VALENCIA					
		20		1,83	2,61	1,76	5,6	5,0		22	15.989	1.956	8,2	6,7	
	CS	22		2,70	1,74	1,66	6,5	5,7		24	6.164	880	7,0	6,1	
		24		3,57	0,87	1,57	7,4	6,4							
25 / 19	MC	16	5,30	-	4,40	0,96	5,5	4,4		-	13.968	3.116	4,5	3,9	
		20		1,78	2,61	0,85	8,3	6,5		20	17.691	2.818	6,3	5,3	
	CS	22		2,66	1,74	0,80	10,0	7,7		22	19.517	2.663	7,3	6,2	
									24	10.285	1.589	6,5	5,7		

SUPPLY HUMIDITY RATIO = 11 g/kg									Seasonal energy performances						
Performance in cooling and in dehumidification															
T_OA	SET	T_SA	P_F	P_R	P_D	P_A	EER_C	EER_S	T_SA	E_T	E_A	SE_C	SE_S		
45 / 28*	MC	18	17,3	-	3,57	6,41	2,7	2,6		STOCKHOLM					
		20,0		0,96	2,61	6,23	2,9	2,8		-	63	12	5,3	4,2	
	CS	22		1,83	1,74	6,06	3,2	3,0		20	74	11	6,7	5,2	
		24		2,70	0,87	5,89	3,4	3,2		22	83	10	8,0	6,2	
40 / 25	MC	20	11,4	-	2,83	3,66	3,1	2,9		LONDON					
		20,0		0,22	2,61	3,62	3,2	3,0		-	184	36	5,1	4,3	
	CS	22		1,09	1,74	3,46	3,6	3,4		20	214	33	6,4	5,4	
		24		1,96	0,87	3,31	4,0	3,8		22	239	31	7,6	6,3	
35 / 24	MC	18	10,6	-	3,57	3,26	3,3	3,0		ROME					
		20,0		0,96	2,61	3,14	3,7	3,4		-	3.431	667	5,1	4,3	
	CS	22		1,83	1,74	3,02	4,1	3,8		20	3.989	620	6,4	5,4	
		24		2,70	0,87	2,91	4,6	4,2		22	4.441	583	7,6	6,3	
32 / 23	MC	18	9,11	-	3,61	2,35	3,9	3,5		VALENCIA					
		20,0		1,00	2,61	2,25	4,5	4,1		-	5.897	1.208	4,9	4,2	
	CS	22		1,87	1,74	2,16	5,1	4,6		20	6.788	1.131	6,0	5,1	
		24		2,74	0,87	2,06	5,8	5,2		22	7.524	1.071	7,0	5,9	
30 / 22	MC	18	7,71	-	3,61	1,65	4,7	4,1		TUNIS					
		20,0		1,00	2,61	1,56	5,6	4,8		-	10.398	2.446	4,3	3,6	
	CS	22		1,87	1,74	1,49	6,4	5,5		20	11.738	2.321	5,1	4,3	
		24		2,74	0,87	1,41	7,4	6,3		22	12.881	2.214	5,8	4,9	
28 / 21	MC	18	6,33	-	3,70	1,19	5,3	4,4							
		20,0		1,09	2,61	1,10	6,7	5,5		-	8.259	1.008	8,2	6,8	
	CS	22		1,96	1,74	1,03	8,0	6,5		20	11.738	2.321	5,1	4,3	
		24		2,83	0,87	0,96	9,5	7,6		22	12.881	2.214	5,8	4,9	
									24	14.023	2.103	6,7	5,6		

SUPPLY HUMIDITY RATIO = 12 g/kg									Seasonal energy performances					
Performance in cooling and in dehumidification														
T_OA	SET	T_SA	P_F	P_R	P_D	P_A	EER_C	EER_S	T_SA	E_T	E_A	SE_C	SE_S	
45 / 28*	MC	19	15,7	-	2,96	5,30	3,0	2,8		STOCKHOLM				
		20		0,35	2,61	5,23	3,1	2,9		-	48	7	6,4	4,5
	CS	22		1,22	1,74	5,05	3,4	3,2		20	51	7	7,2	5,0
		24		2,09	0,87	4,87	3,7	3,4		22	60	7	9,2	6,2
40 / 26	MC	22	11,0	-	1,74	3,22	3,4	3,2		LONDON				
		22,0		0,00	1,74	3,22	3,4	3,2		-	140	22	6,2	4,8
	CS	24		0,87	0,87	2,96	4,0	3,7		20	151	22	6,9	5,3
					2,31	2,60	3,8	3,5		22	175	20	8,7	6,5
40 / 25	MC	21	9,87	-	2,31	2,60	3,8	3,5		ROME				
		22		0,57	1,74	2,51	4,2	3,8		-	2.602	419	6,2	4,8
	CS	24		1,44	0,87	2,35	4,8	4,4		20	2.802	405	6,9	5,3
					2,96	2,21	4,1	3,7		22	3.255	374	8,7	6,5
35 / 24	MC	19	8,98	-	2,61	2,17	4,3	3,9		VALENCIA				
		20		0,35	2,61	2,07	4,9	4,4		-	4.541	766	5,9	4,7
	CS	22		1,22	1,74	2,07	4,9	4,4		20	4.861	744	6,5	5,1
		24		2,09	0,87	1,97	5,6	5,0		22	5.596	691	8,1	6,3
32 / 23	MC	19	7,54	-	3,00	1,48	5,1	4,4		TUNIS				
		20		0,39	2,61	1,45	5,5	4,7						

SIZE 1 - AIR FLOW 1.300 m³/h (STANDARD) - HEATING

Performance in Heating								Seasonal energy performances					
T_OA	SET	T_SA	x_SA	P_T	P_D	P_A	COP_C	COP_S	T_SA	E_T	E_A	SE_C	SE_S
-20 / -21 *	MC	19,7	0,2	19,1	-	5,62	3,4	2,8	STOCKHOLM	81.480	19.967	4,1	2,8
	CS	18		18,3	-	4,82	3,8	3,0					
-15 / -16 *	MC	24,4		18,6	1,92	6,01	3,1	2,5		53.296	9.702	5,5	3,2
		22		17,5	0,87	4,90	3,6	2,8					
	CS	20	0,5	16,5	-	4,09	4,0	3,1				6,1	3,2
		18		15,5	-	3,36	4,6	3,3					
-12 / -13 *	MC	27,2	0,8	18,3	3,13	6,24	2,9	2,4	LONDON	64.802	14.377	4,5	4,1
		22		15,8	0,87	4,03	3,9	3,0					
	CS	20		14,9	-	3,31	4,5	3,2				6,4	5,4
		18		13,9	-	2,67	5,2	3,5					
-7 / -8	MC	23,6	1,5	14,8	1,57	3,70	4,0	3,8	ROME	33.512	7.094	4,7	4,2
		22		14,0	0,87	3,27	4,3	4,0				6,7	5,6
	CS	20		13,0	-	2,73	4,8	4,4				7,3	5,8
		18		12,1	-	2,31	5,2	4,7					
-5 / -6	MC	25,7	1,9	14,7	2,48	3,81	3,9	3,6	VALENCIA	25.445	5.247	4,8	4,3
		22		13,0	0,87	2,79	4,7	4,3				6,9	5,6
	CS	20		12,0	-	2,36	5,1	4,6				7,7	6,0
		18		11,1	-	1,94	5,7	5,1					
0 / -1	MC	30	3,1	14,1	4,35	3,84	3,7	3,5	TUNIS	3.459	450	7,7	6,2
		22		10,3	0,87	1,85	5,6	4,9				5,1	2,9
	CS	20		9,41	-	1,53	6,2	5,3				7,3	6,3
		18		8,46	-	1,21	7,0	5,8					
2 / 1	MC	30	3,7	13,1	4,35	3,29	4,0	3,7	TUNIS	19.590	3.862	5,1	2,9
		22		9,33	0,87	1,58	5,9	5,1				7,3	3,0
	CS	20		8,40	-	1,25	6,7	5,6				8,4	2,9
		18		7,45	-	0,93	8,0	6,4					
7 / 6	MC	30	5,4	10,5	4,35	2,28	4,6	4,2	TUNIS	4.440	610	7,3	3,0
		22		6,85	0,87	0,94	7,3	5,8				8,4	2,9
	CS	20		5,93	-	0,71	8,4	6,3				8,0	3,3
		12 / 11		MC	30	7,8	8,05	4,35					

Notes

* System with "Hydronic recovery device for extended operating range" option

T_OA = Dry bulb/wet bulb outdoor air temperature [°C]

SET = Operation mode: MC = Maximum Capacity, CS = Constant Supply, HA = High Air Flow

T_SA = Dry bulb supply air temperature [°C]

X_SA = Supply air humidity ratio [g/kg]

P_F = Overall cooling capacity of the system (kW)

P_T = Heating capacity of the system (kW)

P_R = Post-heating capacity (kW)

P_D = Additional capacity available to the space (kW)

P_A = Electricity absorbed by the thermodynamic circuit (kW)

EER_C = Thermodynamic efficiency of the system in cooling mode

EER_S = Overall efficiency of the system in cooling mode (thermodynamic circuit and fans)

COP_C = Thermodynamic efficiency of the system in heating mode

COP_S = Overall efficiency of the system in heating mode (thermodynamic circuit and fans)

E_T = Seasonal thermal/cooling energy supplied [kWh]

E_A = Overall seasonal electricity absorbed [kWh]

SE_C = Thermodynamic seasonal efficiency of the system

SE_S = Overall seasonal efficiency of the system (thermodynamic circuit and fans)

In heating mode, the performances are considered with maximum air temperature supply T_SA equal to 30°C

The performance refers to a standard ZEPHIR³ unit (not fitted with a 'Steam-powered humidification module' option)

Return air in cooling mode = 26°C DB

Return air in heating mode = 20°C / 12°C

Available static pressure: supply 150 Pa, return 100 Pa

Performance values do not include the effect of fan motor heat

Source: ASHRAE weather data (International weather for energy calculation)

SIZE 1 - AIR FLOW 1.900 m³/h (MAXIMUM) - COOLING

SUPPLY HUMIDITY RATIO = 11 g/kg								
Performance in cooling and in dehumidification								
T_OA	SET	T_SA	P_F	P_R	P_D	P_A	EER_C	EER_S
35 / 24	MC	18,1	15,3	-	5,03	4,61	3,3	3,0
	CS	20		1,21	3,82	4,45	3,7	3,4
	CS	22		2,48	2,54	4,28	4,2	3,8
	CS	24		3,75	1,27	4,11	4,6	4,2
32 / 23	MC	18,1	13,1	-	5,03	3,51	3,7	3,3
	CS	20		1,21	3,82	3,37	4,2	3,8
	CS	22		2,48	2,54	3,22	4,8	4,3
	CS	24		3,75	1,27	3,07	5,5	4,8
30 / 22	MC	17,7	11,2	-	5,28	2,61	4,3	3,7
	CS	20		1,46	3,82	2,47	5,1	4,4
	CS	22		2,74	2,54	2,35	5,9	5,0
	CS	24		4,01	1,27	2,23	6,8	5,7
28 / 21	MC	18	9,19	-	5,34	1,80	5,1	4,1
	CS	20		1,53	3,82	1,67	6,4	5,1
	CS	22		2,80	2,54	1,56	7,7	6,1
	CS	24		4,07	1,27	1,45	9,1	7,1
25 / 19	MC	18	5,24	-	5,34	0,69	7,6	4,7
	CS	20		1,53	3,82	0,63	10,7	6,5

Seasonal energy performances				
T_SA	E_T	E_A	SE_C	SE_S
STOCKHOLM				
-	836	116	7,2	4,1
20	1.068	106	10,1	5,5
22	120	16	7,7	5,6
24	133	15	9,1	6,5
LONDON				
-	1.362	199	6,9	4,6
20	1.724	183	9,4	6,1
22	345	48	7,2	5,8
24	381	45	8,5	6,8
ROME				
-	11.751	1.910	6,2	4,4
20	14.510	1.764	8,2	5,8
22	6.429	891	7,2	5,8
24	7.091	833	8,5	6,8
VALENCIA				
-	15.120	2.715	5,6	4,2
20	18.287	2.526	7,2	5,4
22	10.883	1.639	6,6	5,5
24	11.958	1.540	7,8	6,3

SUPPLY HUMIDITY RATIO = 12 g/kg								
Performance in cooling and in dehumidification								
T_OA	SET	T_SA	P_F	P_R	P_D	P_A	EER_C	EER_S
40 / 25	MC	21	14,3	-	3,18	3,94	3,6	3,3
	CS	22		0,64	2,54	3,81	3,9	3,5
	CS	24		1,91	1,27	3,56	4,6	4,1
35 / 24	MC	20	12,8	-	3,94	3,25	3,9	3,5
	CS	20,0		0,13	3,82	3,24	4,0	3,5
	CS	22		1,40	2,54	3,07	4,6	4,1
	CS	24		2,67	1,27	2,90	5,3	4,7
32 / 23	MC	20	10,7	-	4,07	2,25	4,8	4,0
	CS	20,0		0,25	3,82	2,22	4,9	4,2
	CS	22		1,53	2,54	2,10	5,8	4,9
	CS	24		2,80	1,27	1,97	6,9	5,7
30 / 22	MC	19	8,76	-	4,26	1,54	5,7	4,5
	CS	20,0		0,45	3,82	1,50	6,1	4,8
	CS	22		1,72	2,54	1,41	7,4	5,7
28 / 21	MC	19	6,76	-	4,39	0,98	6,9	4,8
	CS	20,0		0,57	3,82	0,95	7,7	5,4
	CS	22		1,84	2,54	0,87	9,9	6,7

Seasonal energy performances				
T_SA	E_T	E_A	SE_C	SE_S
STOCKHOLM				
-	68	10	6,9	4,3
20	73	10	7,7	4,8
22	86	9	9,9	6,0
24	-	-	-	-
LONDON				
-	199	30	6,6	4,7
20	215	30	7,3	5,2
22	250	27	9,2	6,4
24	49	6	8,3	6,4
ROME				
-	3.717	567	6,6	4,7
20	4.001	551	7,3	5,2
22	4.663	508	9,2	6,4
24	1.127	128	8,8	6,7
VALENCIA				
-	6.500	1.064	6,1	4,6
20	6.929	1.037	6,7	5,0
22	8.004	963	8,3	6,1
24	3.874	471	8,2	6,4

SUPPLY HUMIDITY RATIO = 13 g/kg								
Performance in cooling and in dehumidification								
T_OA	SET	T_SA	P_F	P_R	P_D	P_A	EER_C	EER_S
45 / 28 *	MC	21	20,6	-	3,44	6,05	3,4	3,1
	CS	22		0,89	2,54	5,86	3,7	3,3
	CS	24		2,16	1,27	5,58	4,1	3,7
45 / 26	MC	24	13,3	-	1,15	3,27	4,1	3,6
	MC	24		-	1,15	2,11	5,2	4,3
40 / 25	MC	21	10,9	-	2,93	2,02	5,1	4,2
	MC	22		0,38	2,54	1,97	5,4	4,5
	MC	24		1,65	1,27	1,80	6,6	5,4
35 / 24	MC	21	8,40	-	3,24	1,32	6,4	4,8
	CS	22		0,70	2,54	1,26	7,2	5,4
	CS	24		1,97	1,27	1,15	9,0	6,6
32 / 23	MC	21	6,18	-	3,12	0,80	7,7	5,1
	CS	22		0,57	2,54	0,76	8,9	5,7
	CS	24		1,84	1,27	0,68	11,8	7,3

Seasonal energy performances				
T_SA	E_T	E_A	SE_C	SE_S
LONDON				
-	27	4	7,2	5,0
22	29	4	8,3	5,6
24	34	3	10,8	7,1
ROME				
-	600	79	7,6	5,1
22	656	75	8,7	5,7
24	776	67	11,5	7,3
VALENCIA				
-	2.132	297	7,2	5,0
22	2.319	283	8,2	5,6
24	2.723	255	10,7	7,0
TUNIS				
-	6.475	1.050	6,2	4,3
22	6.804	982	6,9	4,7
24	7.822	894	8,7	5,8

SIZE 1 - AIR FLOW 1.900 m³/h (MAXIMUM) - COOLING

SUPPLY HUMIDITY RATIO = non controllata													
Performance in cooling and in dehumidification								Seasonal energy performances					
T_OA	SET	T_SA	x_SA	P_F	P_D	P_A	EER_C	EER_S	T_SA	E_T	E_A	SE_C	SE_S
45 / 28 *	HA	26	15,8	9,46	-	0,97	9,8	6,1	STOCKHOLM				
45 / 26	HA	26	13,5	11,5	-	2,29	5,0	4,2	-	682	102	6,7	3,6
40 / 25	HA	24	13,0	11,0	1,27	2,16	5,1	4,3	LONDON				
35 / 24	HA	22	13,5	9,20	2,54	1,56	5,9	4,7	-	1.067	158	6,7	4,1
32 / 23	HA	21	12,5	5,01	3,18	0,65	7,7	4,7	ROME				
30 / 22	HA	20	11,8	4,88	3,82	0,66	7,5	4,6	-	8.250	1.208	6,8	4,2
28 / 21	HA	19	11,1	4,73	4,45	0,66	7,2	4,4	VALENCIA				
25 / 19	HA	18	9,74	4,47	5,09	0,67	6,7	4,1	-	9.704	1.406	6,9	4,3
									TUNIS				
									-	13.424	1.959	6,9	3,8

SIZE 1 - AIR FLOW 1.900 m³/h (MAXIMUM) - HEATING

Performance in Heating									Seasonal energy performances				
T_OA	SET	T_SA	x_SA	P_T	P_D	P_A	COP_C	COP_S	T_SA	E_T	E_A	SE_C	SE_S
-15 / -16 *	MC	16,5		21,7	-	5,32	4,1	3,7	STOCKHOLM				
	HA	16	0,50	21,4	-	5,07	4,2	3,8	-	103.312	23.341	4,4	3,8
-12 / -13 *	MC	19,0		21,2	-	5,57	3,8	3,4	LONDON				
	CS	18	0,80	20,5	-	5,03	4,1	3,7	22	63.670	11.036	5,8	4,5
	HA	16		19,1	-	3,97	4,8	4,2	20	49.578	7.857	6,3	4,8
-7 / -8	MC	16,2		16,4	-	3,23	5,1	4,5	18	57.294	8.832	6,5	4,9
	HA	16	1,50	16,3	-	3,16	5,2	4,6	16	55.525	7.751	7,2	5,1
-5 / -6	MC	18,4		16,4	-	3,36	4,9	4,3	ROME				
	CS	18	1,90	16,1	-	3,23	5,0	4,4	-	89.353	20.322	4,4	3,9
	HA	16		14,7	-	2,61	5,6	4,9	22	59.519	9.191	6,5	5,1
0 / -1	MC	23,6		16,2	2,29	3,66	4,4	4,0	20	39.848	5.767	6,9	5,4
		22		15,1	1,27	3,10	4,9	4,3	18	36.307	4.654	7,8	5,7
	CS	20	3,10	13,7	-	2,46	5,6	4,8	16	30.847	3.399	9,1	6,1
		18		12,4	-	1,93	6,4	5,3	VALENCIA				
	HA	16		11,0	-	1,45	7,6	5,9	-	36.524	8.069	4,5	4,0
2 / 1	MC	25,9		16,3	3,75	3,80	4,3	3,9	22	22.709	3.114	7,3	5,3
		22		13,6	1,27	2,55	5,3	4,6	20	17.231	2.376	7,3	5,5
	CS	20	3,70	12,3	-	2,01	6,1	5,1	18	14.991	1.788	8,4	5,9
		18		10,9	-	1,52	7,2	5,6	16	12.565	1.282	9,8	6,2
	HA	16		9,54	-	1,14	8,4	6,1	ROMANIA				
7 / 6	MC	30		15,3	6,36	3,76	4,1	3,7	-	28.640	6.163	4,6	3,8
		22		10,0	1,27	1,48	6,8	5,3	22	16.858	2.116	8,0	5,0
	CS	20	5,40	8,68	-	1,08	8,0	5,8	20	5.629	703	8,0	5,2
		18		7,34	-	0,78	9,4	6,1	18	4.763	508	9,4	5,4
	HA	16		6,00	-	0,54	11,1	6,3	16	3.897	352	11,1	5,4
12 / 11	MC	30	7,80	11,8	6,36	2,35	5,0	4,3					
	CS	22		6,53	1,27	0,73	9,0	5,7					

Notes

* System with "Hydronic recovery device for extended operating range" option
T_OA = Dry bulb/wet bulb outdoor air temperature [°C]
SET = Operation mode: MC = Maximum Capacity, CS = Constant Supply, HA = High Air Flow
T_SA = Dry bulb supply air temperature [°C]
X_SA = Supply air humidity ratio [g/kg]
P_F = Overall cooling capacity of the system (kW)
P_T = Heating capacity of the system [kW]
P_R = Post-heating capacity [kW]
P_D = Additional capacity available to the space [kW]
P_A = Electricity absorbed by the thermodynamic circuit [kW]
EER_C = Thermodynamic efficiency of the system in cooling mode
EER_S = Overall efficiency of the system in cooling mode (thermodynamic circuit and fans)
COP_C = Thermodynamic efficiency of the system in heating mode

COP_S = Overall efficiency of the system in heating mode (thermodynamic circuit and fans)

E_T = Seasonal thermal/cooling energy supplied [kWh]

E_A = Overall seasonal electricity absorbed [kWh]

SE_C = Thermodynamic seasonal efficiency of the system

SE_S = Overall seasonal efficiency of the system (thermodynamic circuit and fans)

In heating mode, the performances are considered with maximum air

temperature supply T_SA equal to 30°C

The performance refers to a standard ZEPHIR³ unit (not fitted with a 'Steam-powered humidification module' option)

Return air in cooling mode = 26°C DB

Return air in heating mode = 20°C / 12°C

Available static pressure: supply 150 Pa, return 100 Pa

Performance values do not include the effect of fan motor heat

Source: ASHRAE weather data (International weather for energy calculation)

SIZE 2 - AIR FLOW 1.600 m³/h (MINIMUM) - COOLING

SUPPLY HUMIDITY RATIO = 9 g/kg								
Performance in cooling and in dehumidification								
T_OA	SET	T_SA	P_F	P_R	P_D	P_A	EER_C	EER_S
35 / 24	MC	15,2	16,8	-	5,79	6,93	2,4	2,3
	CS	20		2,6	3,21	6,52	3,0	2,9
	CS	22		3,6	2,14	6,35	3,2	3,1
	CS	24		4,7	1,07	6,18	3,5	3,3
32 / 23	MC	14,6	15,3	-	6,11	5,37	2,8	2,7
	CS	20		2,9	3,21	4,99	3,6	3,5
	CS	22		4,0	2,14	4,85	4,0	3,8
	CS	24		5,0	1,07	4,71	4,3	4,1
30 / 22	MC	14,1	13,8	-	6,38	4,43	3,1	3,0
	CS	20		3,2	3,21	4,05	4,2	3,9
	CS	22		4,2	2,14	3,92	4,6	4,3
	CS	24		5,3	1,07	3,79	5,0	4,7
28 / 21	MC	13,7	12,3	-	6,59	3,61	3,4	3,2
	CS	20		3,4	3,21	3,19	4,9	4,6
	CS	22		4,4	2,14	3,05	5,5	5,1
	CS	24		5,5	1,07	2,92	6,1	5,6
25 / 19	MC	14,9	8,39	-	5,95	1,86	4,5	4,0
	CS	20		2,7	3,21	1,62	6,9	6,0
	CS	22		3,8	2,14	1,53	8,0	6,9

SUPPLY HUMIDITY RATIO = 10 g/kg								
Performance in cooling and in dehumidification								
T_OA	SET	T_SA	P_F	P_R	P_D	P_A	EER_C	EER_S
45 / 28 *	MC	16,9	23,0	-	4,88	9,98	2,3	2,2
	CS	20		1,7	3,21	9,62	2,6	2,5
	CS	22		2,7	2,14	9,38	2,7	2,7
	CS	24		3,8	1,07	9,15	2,9	2,8
40 / 25	MC	18,2	15,9	-	4,18	5,41	2,9	2,8
	CS	20		1,0	3,21	5,25	3,2	3,1
	CS	22		2,0	2,14	5,07	3,5	3,4
	CS	24		3,1	1,07	4,90	3,9	3,7
35 / 24	MC	16,8	14,8	-	4,93	4,73	3,1	3,0
	CS	20		1,7	3,21	4,50	3,7	3,5
	CS	22		2,8	2,14	4,36	4,0	3,8
	CS	24		3,9	1,07	4,21	4,4	4,2
32 / 23	MC	16,7	13,0	-	4,98	3,69	3,5	3,3
	CS	20		1,8	3,21	3,48	4,2	4,0
	CS	22		2,8	2,14	3,36	4,7	4,4
	CS	24		3,9	1,07	3,23	5,2	4,9
30 / 22	MC	16,3	11,4	-	5,20	2,96	3,9	3,6
	CS	20		2,0	3,21	2,76	4,8	4,5
	CS	22		3,1	2,14	2,65	5,5	5,0
	CS	24		4,1	1,07	2,53	6,1	5,6
28 / 21	MC	16,3	9,70	-	5,20	2,21	4,4	3,9
	CS	20		2,0	3,21	2,01	5,8	5,2
	CS	22		3,1	2,14	1,90	6,7	5,9
	CS	24		4,1	1,07	1,79	7,7	6,8
25 / 19	MC	16	6,48	-	5,36	1,21	5,4	4,4
	CS	20		2,1	3,21	1,07	8,1	6,5
	CS	22		3,2	2,14	1,00	9,7	7,8

Notes

* System with "Hydronic recovery device for extended operating range" option
T_OA = Dry bulb/wet bulb outdoor air temperature [°C]
SET = Operation mode: MC = Maximum Capacity, CS = Constant Supply, HA = High Air Flow
T_SA = Dry bulb supply air temperature [°C]
X_SA = Supply air humidity ratio [g/kg]
P_F = Overall cooling capacity of the system (kW)
P_T = Heating capacity of the system [kW]
P_R = Post-heating capacity [kW]
P_D = Additional capacity available to the space [kW]
P_A = Electricity absorbed by the thermodynamic circuit [kW]
EER_C = Thermodynamic efficiency of the system in cooling mode
EER_S = Overall efficiency of the system in cooling mode (thermodynamic circuit and fans)
COP_C = Thermodynamic efficiency of the system in heating mode

COP_S = Overall efficiency of the system in heating mode (thermodynamic circuit and fans)
E_T = Seasonal thermal/cooling energy supplied [kWh]
E_A = Overall seasonal electricity absorbed [kWh]
SE_C = Thermodynamic seasonal efficiency of the system
SE_S = Overall seasonal efficiency of the system (thermodynamic circuit and fans)
In heating mode, the performances are considered with maximum air temperature supply T_SA equal to 30°C
The performance refers to a standard ZEPHIR³ unit (not fitted with a 'Steam-powered humidification module' option)
Return air in cooling mode = 26°C DB
Return air in heating mode = 20°C / 12°C
Available static pressure: supply 150 Pa, return 100 Pa
Performance values do not include the effect of fan motor heat
Source: ASHRAE weather data (International weather for energy calculation)

SUPPLY HUMIDITY RATIO = 11 g/kg

Performance in cooling and in dehumidification								Seasonal energy performances					
T_OA	SET	T_SA	P_F	P_R	P_D	P_A	EER_C	EER_S	T_SA	E_T	E_A	SE_C	SE_S
45 / 28 *	MC	17,9	21,2	-	4,34	8,08	2,6	2,5	STOCKHOLM				
		20		1,1	3,21	7,85	2,8	2,7	-	77	15	5,1	4,2
	CS	22		2,2	2,14	7,63	3,1	2,9	20	90	14	6,4	5,2
		24		3,3	1,07	7,41	3,3	3,2	22	101	13	7,6	6,1
45 / 26	MC	20,5	15,5	-	2,95	4,91	3,2	3,0	LONDON				
		22		0,8	2,14	4,74	3,4	3,3	-	224	45	5,0	4,3
	CS	24		1,9	1,07	4,51	3,9	3,7	20	259	42	6,1	5,3
40 / 25	MC	19,1	14,2	-	3,70	4,14	3,4	3,2	22	289	40	7,3	6,2
		20		0,5	3,21	4,07	3,6	3,4	24	319	37	8,6	7,3
	CS	22		1,6	2,14	3,91	4,0	3,8	ROME				
		24		2,6	1,07	3,75	4,5	4,2	-	4.182	845	5,0	4,3
35 / 24	MC	18,8	12,5	-	3,86	3,31	3,8	3,5	20	4.828	789	6,1	5,3
		20		0,6	3,21	3,23	4,1	3,8	22	5.385	742	7,3	6,2
	CS	22		1,7	2,14	3,09	4,6	4,3	24	5.943	694	8,6	7,3
		24		2,8	1,07	2,95	5,2	4,8	VALENCIA				
32 / 23	MC	18,7	10,7	-	3,91	2,44	4,4	4,0	-	7.152	1.486	4,8	4,2
		20		0,7	3,21	2,37	4,8	4,4	20	8.145	1.401	5,8	5,1
	CS	22		1,8	2,14	2,25	5,5	5,0	22	9.050	1.320	6,9	5,9
		24		2,8	1,07	2,14	6,3	5,7	24	9.956	1.240	8,0	6,9
30 / 22	MC	18	9,3	-	4,29	2,02	4,6	4,1	TUNIS				
		20		1,1	3,21	1,93	5,4	4,8	-	12.484	2.806	4,4	3,9
	CS	22		2,1	2,14	1,83	6,3	5,5	20	13.820	2.684	5,1	4,5
		24		3,2	1,07	1,73	7,2	6,3	22	15.226	2.544	6,0	5,1
28 / 21	MC	17,6	7,74	-	4,50	1,53	5,1	4,4	24	16.632	2.407	6,9	5,9
		20		1,3	3,21	1,42	6,4	5,4					
	CS	22		2,4	2,14	1,33	7,6	6,4					
		24		3,4	1,07	1,24	9,0	7,5					

SIZE 2 - AIR FLOW 1.600 m³/h (MINIMUM) - HEATING

Performance in Heating								Seasonal energy performances					
T_OA	SET	T_SA	x_SA	P_T	P_D	P_A	COP_C	COP_S	T_SA	E_T	E_A	SE_C	SE_S
-20 / -21 *	MC	24,1	0,20	26,1	2,20	8,24	3,2	3,0	STOCKHOLM				
		22		24,9	1,07	7,03	3,5	3,4	-	102.830	23.595	4,4	4,0
	CS	20		23,7	-	5,93	4,0	3,8	22	65.828	11.372	5,8	5,0
		18		23,3	-	5,58	4,2	3,9	20	59.690	9.494	6,3	5,3
-15 / -16 *	MC	28,7	0,50	25,4	4,66	8,93	2,8	2,7	LONDON				
		22		22,4	1,07	5,93	3,8	3,6	-	79.896	16.139	5,0	4,5
	CS	20		21,9	-	5,51	4,0	3,8	22	39.728	6.165	6,4	5,5
		18		21,4	-	5,10	4,2	3,9	20	35.147	5.100	6,9	5,8
-12 / -13 *	MC	30	0,80	24,1	5,36	8,41	2,9	2,8	18	43.442	6.646	6,5	5,5
		22		20,9	1,07	5,35	3,9	3,7	ROME				
	CS	20		20,3	-	4,82	4,2	3,9	-	41.201	7.946	5,2	4,7
		18		19,6	-	4,25	4,6	4,3	22	16.702	2.532	6,6	5,6
-7 / -8	MC	27,6	1,50	20,6	4,07	5,42	3,8	3,6	20	14.658	2.094	7,0	5,8
		22		17,3	1,07	3,53	4,9	4,6	18	4.259	601	7,1	6,0
	CS	20		16,1	-	3,00	5,4	5,0	VALENCIA				
		18		14,9	-	2,47	6,0	5,5	-	31.264	5.883	5,3	4,8
-5 / -6	MC	30	1,90	20,7	5,36	5,60	3,7	3,5	22	10.578	1.592	6,6	5,6
		22		15,9	1,07	3,11	5,1	4,7	20	9.253	1.316	7,0	5,8
	CS	20		14,8	-	2,56	5,8	5,3	18	2.047	288	7,1	6,0
		18		13,6	-	2,20	6,2	5,6	TUNIS				
0 / -1	MC	30	3,10	17,3	5,36	4,14	4,2	3,9	-	24.068	4.349	5,5	4,8
		22		12,7	1,07	2,14	5,9	5,3	22	5.464	811	6,7	5,4
	CS	20		11,6	-	1,76	6,6	5,8	20	4.740	668	7,1	5,4
		18		10,4	-	1,45	7,2	6,1	18	55	8	7,1	5,7
2 / 1	MC	30	3,70	16,1	5,36	3,64	4,4	4,1					
		22		11,5	1,07	1,78	6,5	5,7					
	CS	20		10,3	-	1,49	6,9	5,9					
		18		9,18	-	1,29	7,1	6,0					
7 / 6	MC	30	5,40	12,9	5,36	2,54	5,1	4,6					
		22		8,43	1,07	1,25	6,7	5,6					
	CS	20		7,31	-	1,03	7,1	5,7					
		18		6,29	-	0,85	7,5	6,3					
12 / 11	MC	30	7,80	9,89	5,36	1,70	5,8	5,1					

SIZE 2 - AIR FLOW 2.200 m³/h (STANDARD) - COOLING

SUPPLY HUMIDITY RATIO = 10 g/kg								
Performance in cooling and in dehumidification								
T_OA	SET	T_SA	P_F	P_R	P_D	P_A	EER_C	EER_S
35 / 24	MC	17,3	20,0	-	6,41	7,93	2,5	2,4
	CS	20		2,0	4,42	7,58	2,9	2,8
		22		3,5	2,95	7,33	3,2	3,0
		24		4,9	1,47	7,07	3,5	3,4
32 / 23	MC	16,6	17,9	-	6,92	5,95	3,0	2,8
	CS	20		2,5	4,42	5,61	3,6	3,4
		22		4,0	2,95	5,42	4,0	3,8
		24		5,5	1,47	5,22	4,5	4,2
30 / 22	MC	16,3	15,7	-	7,15	4,62	3,4	3,1
	CS	20		2,7	4,42	4,30	4,3	3,9
		22		4,2	2,95	4,12	4,8	4,4
		24		5,7	1,47	3,95	5,4	4,9
28 / 21	MC	16	13,5	-	7,37	3,38	4,0	3,6
	CS	20		2,9	4,42	3,05	5,4	4,8
		22		4,4	2,95	2,89	6,2	5,5
		24		5,9	1,47	2,72	7,1	6,3
25 / 19	MC	16	8,94	-	7,37	1,64	5,5	4,4
	CS	20		2,9	4,42	1,46	8,1	6,5
		22		4,4	2,95	1,36	9,8	7,7

Seasonal energy performances				
T_SA	E_T	E_A	SE_C	SE_S
STOCKHOLM				
-	1.404	267	5,3	4,1
20	1.852	238	7,8	6,0
22	2.076	222	9,4	7,0
24	194	27	7,1	6,1
LONDON				
-	2.257	444	5,1	4,2
20	2.955	397	7,4	6,1
22	3.304	371	8,9	7,2
24	553	82	6,7	6,0
ROME				
-	18.793	4.002	4,7	4,0
20	24.109	3.599	6,7	5,6
22	26.779	3.385	7,9	6,6
24	10.284	1.539	6,7	5,9
VALENCIA				
-	23.477	5.416	4,3	3,8
20	29.568	4.913	6,0	5,2
22	32.659	4.645	7,0	6,0
24	17.164	2.794	6,1	5,5

SUPPLY HUMIDITY RATIO = 11 g/kg								
Performance in cooling and in dehumidification								
T_OA	SET	T_SA	P_F	P_R	P_D	P_A	EER_C	EER_S
40 / 25	MC	19,8	19,0	-	4,57	6,55	2,9	2,7
	CS	20		0,1	4,42	6,51	2,9	2,8
		22		1,6	2,95	6,22	3,3	3,1
		24		3,1	1,47	5,92	3,7	3,5
35 / 24	MC	18,3	17,5	-	5,67	5,52	3,2	3,0
	CS	20		1,3	4,42	5,34	3,5	3,3
		22		2,7	2,95	5,13	3,9	3,7
		24		4,2	1,47	4,92	4,4	4,1
32 / 23	MC	17,9	15,3	-	5,97	4,11	3,7	3,4
	CS	20		1,5	4,42	3,94	4,3	3,9
		22		3,0	2,95	3,77	4,9	4,4
		24		4,5	1,47	3,60	5,5	5,0
30 / 22	MC	17,8	13,0	-	6,04	2,88	4,5	4,0
	CS	20		1,6	4,42	2,73	5,4	4,7
		22		3,1	2,95	2,60	6,2	5,4
		24		4,6	1,47	2,46	7,1	6,2
28 / 21	MC	17,7	10,6	-	6,11	1,96	5,4	4,5
	CS	20		1,7	4,42	1,82	6,8	5,6
		22		3,2	2,95	1,70	8,1	6,6
		24		4,6	1,47	1,58	9,6	7,8
25 / 19	MC	17,5	6,38	-	6,26	0,98	6,5	4,7
	CS	20		1,8	4,42	0,89	9,2	6,5

Seasonal energy performances				
T_SA	E_T	E_A	SE_C	SE_S
STOCKHOLM				
-	1.012	159	6,4	4,4
20	1.290	145	8,9	5,9
22	138	17	8,1	6,3
24	152	16	9,6	7,4
LONDON				
-	1.642	265	6,2	4,7
20	2.074	243	8,5	6,3
22	397	52	7,6	6,3
24	438	49	9,0	7,4
ROME				
-	13.997	2.380	5,9	4,6
20	17.250	2.195	7,9	6,0
22	7.393	977	7,6	6,3
24	8.160	912	8,9	7,4
VALENCIA				
-	17.890	3.274	5,5	4,4
20	21.598	3.043	7,1	5,7
22	12.541	1.815	6,9	5,9
24	13.786	1.705	8,1	6,8

SUPPLY HUMIDITY RATIO = 12 g/kg								
Performance in cooling and in dehumidification								
T_OA	SET	T_SA	P_F	P_R	P_D	P_A	EER_C	EER_S
45 / 28*	MC	20	25,7	-	4,42	9,35	2,7	2,6
	CS	20		0,0	4,42	9,35	2,7	2,6
		22		1,5	2,95	8,97	3,0	2,9
		24		2,9	1,47	8,59	3,3	3,2
45 / 26	MC	22,6	18,2	-	2,50	5,49	3,3	3,1
	CS	24		1,0	1,47	5,04	3,8	3,6
40 / 25	MC	21,8	15,9	-	3,09	4,09	3,9	3,6
	CS	22		0,1	2,95	4,06	4,0	3,6
		24		1,6	1,47	3,70	4,7	4,3
		20		0,0	4,42	3,57	4,1	3,7
35 / 24	MC	20	14,7	1,5	2,95	3,37	4,8	4,3
	CS	22		2,9	1,47	3,18	5,5	5,0
		24		-	4,86	2,44	5,1	4,4
		20		0,4	4,42	2,41	5,4	4,7
32 / 23	MC	19,4	12,5	1,9	2,95	2,27	6,4	5,5
	CS	22		3,4	1,47	2,14	7,4	6,3
		24		3,4	4,94	1,80	5,7	4,7
		20		0,5	4,42	1,76	6,1	5,0
30 / 22	MC	19,3	10,2	2,0	2,95	1,65	7,4	6,0
	CS	20		2,0	1,47	1,54	8,9	7,1
		22		3,5	4,94	1,21	6,3	4,8
		24		3,5	4,42	1,17	7,0	5,3
28 / 21	MC	19,3	7,65	2,0	2,95	1,07	9,0	6,7
	CS	20		2,0	1,47	0,98	11,4	8,3
		22		3,5	4,94	1,21	6,3	4,8
		24		3,5	4,42	1,17	7,0	5,3

SIZE 2 - AIR FLOW 2.200 m³/h (STANDARD) - HEATING

Performance in Heating									Seasonal energy performances				
T_OA	SET	T_SA	x_SA	P_T	P_D	P_A	COP_C	COP_S	T_SA	E_T	E_A	SE_C	SE_S
-20 / -21 *	MC	10,3	0,20	30,7	-	7,54	4,1	3,8	STOCKHOLM				
-15 / -16 *	MC	17,1	0,50	29,7	-	8,16	3,6	3,4	-	134.295	30.428	4,4	4,0
-12 / -13 *	CS	23,1	0,80	29,2	2,28	8,55	3,4	3,2	22	92.243	15.694	5,9	4,9
		22		27,3	1,47	7,07	3,9	3,6	20	80.969	13.262	6,1	5,1
		20		25,2	-	5,47	4,6	4,2	18	72.403	10.985	6,6	5,1
		18		23,6	-	4,39	5,4	4,8	LONDON				
-7 / -8	MC	21,1	1,50	23,0	0,81	4,92	4,7	4,3	-	108.952	23.151	4,7	4,3
	CS	20		22,1	-	4,52	4,9	4,5	22	71.434	10.582	6,8	5,5
		18		20,5	-	3,80	5,4	4,9	20	48.204	7.021	6,9	5,7
-5 / -6	CS	23,2	1,90	22,9	2,36	5,09	4,5	4,2	18	42.001	5.814	7,2	5,7
		22		21,9	1,47	4,65	4,7	4,4	ROME				
		20		20,3	-	3,91	5,2	4,7	-	56.592	11.575	4,9	4,4
		18		18,7	-	3,26	5,7	5,2	22	35.520	5.014	7,1	5,6
0 / -1	MC	28,8	3,10	22,9	6,48	5,59	4,1	3,8	20	20.095	2.837	7,1	5,7
		22		17,5	1,47	3,14	5,6	5,0	18	17.348	2.350	7,4	5,7
	CS	20		15,9	-	2,50	6,4	5,5	VALENCIA				
		18		14,3	-	2,10	6,8	5,8	-	43.007	8.579	5,0	4,5
2 / 1	MC	30	3,70	22,1	7,37	5,40	4,1	3,8	22	26.361	3.650	7,2	5,7
	CS	22		15,8	1,47	2,56	6,2	5,4	20	12.680	1.768	7,2	5,8
		20		14,2	-	2,15	6,6	5,6	18	10.903	1.467	7,4	5,7
		18		12,6	-	1,73	7,3	6,0	TUNIS				
7 / 6	MC	30	5,40	17,8	7,37	3,77	4,7	4,3	-	33.135	6.322	5,2	4,5
	CS	22		11,6	1,47	1,57	7,4	6,0	22	19.548	2.625	7,4	5,3
		20		10,0	-	1,35	7,4	5,8	20	6.485	877	7,4	5,5
		18		8,5	-	1,13	7,5	5,7	18	5.516	734	7,5	5,3
12 / 11	MC	30	7,80	13,6	7,37	2,44	5,6	4,8					
	CS	22		7,6	1,47	1,01	7,5	5,5					

Notes

* System with "Hydronic recovery device for extended operating range" option
T_OA = Dry bulb/wet bulb outdoor air temperature [°C]
SET = Operation mode: MC = Maximum Capacity, CS = Constant Supply, HA = High Air Flow
T_SA = Dry bulb supply air temperature [°C]
X_SA = Supply air humidity ratio [g/kg]
P_F = Overall cooling capacity of the system (kW)
P_T = Heating capacity of the system [kW]
P_R = Post-heating capacity [kW]
P_D = Additional capacity available to the space [kW]
P_A = Electricity absorbed by the thermodynamic circuit [kW]
EER_C = Thermodynamic efficiency of the system in cooling mode
EER_S = Overall efficiency of the system in cooling mode (thermodynamic circuit and fans)
COP_C = Thermodynamic efficiency of the system in heating mode
COP_S = Overall efficiency of the system in heating mode (thermodynamic circuit and fans)

E_T = Seasonal thermal/cooling energy supplied [kWh]

E_A = Overall seasonal electricity absorbed [kWh]

SE_C = Thermodynamic seasonal efficiency of the system

SE_S = Overall seasonal efficiency of the system (thermodynamic circuit and fans)

In heating mode, the performances are considered with maximum air temperature supply T_SA equal to 30°C

The performance refers to a standard ZEPHIR³ unit (not fitted with a 'Steam-powered humidification module' option)

Return air in cooling mode = 26°C DB

Return air in heating mode = 20°C / 12°C

Available static pressure: supply 150 Pa, return 100 Pa

Performance values do not include the effect of fan motor heat

Source: ASHRAE weather data (International weather for energy calculation)

Performance values do not include the effect of fan motor heat

Source: ASHRAE weather data (International weather for energy calculation)

SIZE 2 - AIR FLOW 3.500 m³/h (MAXIMUM) - COOLING

SUPPLY HUMIDITY RATIO = 11 g/kg								
Performance in cooling and in dehumidification								
T_OA	SET	T_SA	P_F	P_R	P_D	P_A	EER_C	EER_S
32 / 23	MC	18,5	23,6	-	8,79	7,71	3,1	2,7
	CS	20		1,8	7,03	7,45	3,4	3,0
	CS	22		4,1	4,69	7,11	3,9	3,5
	CS	24		6,4	2,34	6,76	4,4	3,9
30 / 22	MC	18,3	20,0	-	9,02	4,98	4,0	3,4
	CS	20		2,0	7,03	4,77	4,6	3,9
	CS	22		4,3	4,69	4,51	5,4	4,5
	CS	24		6,7	2,34	4,26	6,3	5,2
28 / 21	MC	17,9	16,5	-	9,49	3,20	5,2	4,0
	CS	20		2,5	7,03	2,99	6,3	4,9
	CS	22		4,8	4,69	2,79	7,6	5,8
	CS	24		7,1	2,34	2,58	9,2	6,8
25 / 19	MC	18,2	8,90	-	9,14	1,26	7,1	4,2
	CS	20		2,1	7,03	1,17	9,4	5,4

Seasonal energy performances				
T_SA	E_T	E_A	SE_C	SE_S
STOCKHOLM				
-	1.429	211	6,8	3,8
20	1.753	196	8,9	4,9
22	213	28	7,6	5,5
24	236	26	9,2	6,5
LONDON				
-	2.340	363	6,4	4,1
20	2.847	338	8,4	5,2
22	612	88	7,0	5,5
24	678	81	8,3	6,4
ROME				
-	20.433	3.477	5,9	4,0
20	24.392	3.252	7,5	5,0
22	11.387	1.630	7,0	5,5
24	12.605	1.516	8,3	6,4
VALENCIA				
-	26.158	4.934	5,3	3,9
20	30.695	4.643	6,6	4,7
22	18.853	2.988	6,3	5,1
24	20.805	2.796	7,4	5,9

SUPPLY HUMIDITY RATIO = 12 g/kg								
Performance in cooling and in dehumidification								
T_OA	SET	T_SA	P_F	P_R	P_D	P_A	EER_C	EER_S
40 / 25	MC	22,3	24,6	-	4,34	7,94	3,1	2,8
	CS	24		2,0	2,34	7,19	3,7	3,3
35 / 24	MC	20,5	22,8	-	6,45	6,58	3,5	3,1
	CS	22		1,8	4,69	6,28	3,9	3,4
	CS	24		4,1	2,34	5,86	4,6	4,0
32 / 23	MC	19,9	19,3	-	7,15	4,33	4,5	3,7
	CS	20		0,1	7,03	4,31	4,5	3,7
	CS	22		2,5	4,69	4,05	5,4	4,4
	CS	24		4,8	2,34	3,79	6,4	5,2
30 / 22	MC	19,6	15,8	-	7,50	2,79	5,7	4,3
	CS	20		0,5	7,03	2,76	5,9	4,5
	CS	22		2,8	4,69	2,57	7,2	5,4
	CS	24		5,2	2,34	2,39	8,8	6,4
28 / 21	MC	19,6	11,8	-	7,50	1,68	7,0	4,6
	CS	20		0,5	7,03	1,66	7,4	4,8
	CS	22		2,8	4,69	1,51	9,7	6,1

Seasonal energy performances				
T_SA	E_T	E_A	SE_C	SE_S
STOCKHOLM				
-	118	17	7,0	4,3
20	123	17	7,4	4,5
22	146	15	9,7	5,7
LONDON				
-	350	53	6,6	4,5
20	363	52	6,9	4,7
22	428	48	8,9	5,9
24	87	11	7,9	6,0
ROME				
-	6.537	988	6,6	4,5
20	6.779	977	6,9	4,7
22	7.997	895	8,9	5,9
24	2.010	235	8,5	6,3
VALENCIA				
-	11.513	1.900	6,1	4,4
20	11.611	1.802	6,4	4,6
22	13.858	1.736	8,0	5,6
24	6.902	876	7,9	6,0

SUPPLY HUMIDITY RATIO = 13 g/kg								
Performance in cooling and in dehumidification								
T_OA	SET	T_SA	P_F	P_R	P_D	P_A	EER_C	EER_S
45 / 26	MC	25	23,6	-	1,17	6,62	3,6	3,1
	CS	25,2		-	0,94	3,39	5,6	4,5
35 / 24	MC	21,9	18,5	-	4,80	3,48	5,3	4,2
	CS	22		0,1	4,69	3,47	5,4	4,3
	CS	24		2,5	2,34	3,10	6,8	5,3
32 / 23	MC	21,3	15,0	-	5,51	2,37	6,3	4,6
	CS	22		0,8	4,69	2,30	6,9	5,0
	CS	24		3,2	2,34	2,08	8,7	6,1
30 / 22	MC	21,6	10,8	-	5,16	1,44	7,5	4,7
	CS	22		0,5	4,69	1,40	8,0	4,9
	CS	24		2,8	2,34	1,23	11,1	6,5
28 / 21	MC	21,2	7,88	-	5,63	0,98	8,0	4,2
	CS	22		0,9	4,69	0,92	9,5	4,9

Seasonal energy performances				
T_SA	E_T	E_A	SE_C	SE_S
STOCKHOLM				
-	79	10	8,0	3,8
22	88	9	9,5	4,4
LONDON				
-	237	30	7,8	4,3
22	261	29	9,1	4,9
24	59	6	10,2	6,4
ROME				
-	4.400	559	7,9	4,3
22	4.845	531	9,1	4,9
24	1.321	122	10,8	6,4
VALENCIA				
-	7.902	1.048	7,5	4,4
24	4.658	459	10,2	6,3

SIZE 2 - AIR FLOW 3.500 m³/h (MAXIMUM) - COOLING

SUPPLY HUMIDITY RATIO = non controllata														
Performance in cooling and in dehumidification								Seasonal energy performances						
T_OA	SET	T_SA	x_SA	P_F	P_D	P_A	EER_C	EER_S	T_SA	E_T	E_A	SE_C	SE_S	
45 / 28 *	HA	26	16,00	24,0	-	3,46	6,9	5,3	STOCKHOLM					
45 / 26	HA	26	13,30	21,8	-	5,04	4,3	3,7	-	1.470	212	6,9	3,9	
40 / 25	HA	24	12,80	20,8	2,34	4,57	4,6	3,8	LONDON	-	339	6,9	4,3	
35 / 24	HA	22	13,10	18,2	4,69	3,38	5,4	4,3	ROME	-	19.110	2.783	6,9	4,4
32 / 23	HA	21	12,70	16,3	5,86	2,86	5,7	4,4	VALENCIA	-	23.430	3.477	6,7	4,4
30 / 22	HA	20	12,30	14,5	7,03	2,31	6,3	4,5	TUNIS	-				
28 / 21	HA	19	11,80	13,0	8,20	1,89	6,9	4,7	-	32.831	5.094	6,4	4,1	
25 / 19	HA	18	10,90	9,4	9,38	1,36	6,9	4,2						

SIZE 2 - AIR FLOW 3.500 m³/h (MAXIMUM) - HEATING

Performance in Heating								Seasonal energy performances					
T_OA	SET	T_SA	x_SA	P_T	P_D	P_A	COP_C	COP_S	T_SA	E_T	E_A	SE_C	SE_S
-15 / -16 *	MC	13,7	0,50	36,4	-	7,20	5,1	4,4	STOCKHOLM				
	HA	13,7		36,4	-	7,20	5,1	4,4	-	169.709	33.402	5,1	4,2
-12 / -13 *	MC	16,1	0,80	35,4	-	7,50	4,7	4,1	22	79.313	12.908	6,1	4,5
	HA	16		35,3	-	7,41	4,8	4,2	20	103.519	16.661	6,2	4,6
-7 / -8	MC	13		26,0	-	4,33	6,0	5,0	18	80.475	11.996	6,7	4,8
	HA	13		26,0	-	4,33	6,0	5,0	16	100.485	14.792	6,8	4,9
-5 / -6	MC	15,1		26,0	-	4,48	5,8	4,9	LONDON				
	HA	15,1		26,0	-	4,48	5,8	4,9	-	151.245	30.984	4,9	4,1
	MC	20,4		25,8	0,47	4,88	5,3	4,5	22	96.300	14.675	6,6	4,8
0 / -1	CS	20		25,3	-	4,69	5,4	4,5	20	94.703	13.880	6,8	4,9
		18		22,8	-	3,76	6,1	4,9	18	63.595	8.833	7,2	4,4
	HA	16		20,3	-	2,98	6,8	5,3	16	56.867	7.352	7,7	4,4
	MC	22,4		25,6	2,81	5,01	5,1	4,3	ROME				
2 / 1	CS	22		25,1	2,34	4,82	5,2	4,4	-	81.948	16.894	4,9	4,1
		20		22,6	-	3,85	5,9	4,8	22	53.740	7.877	6,8	4,9
	HA	16		20,1	-	3,04	6,6	5,1	20	47.664	6.627	7,2	4,9
	MC	27,7		25,5	9,02	5,50	4,6	4,0	18	27.265	3.646	7,5	4,1
7 / 6	CS	22		18,4	2,34	2,75	6,7	5,1	16	23.212	2.881	8,1	3,9
		20		16,0	-	2,16	7,4	5,3	VALENCIA				
	HA	16		13,5	-	1,67	8,1	5,3	-	63.716	13.125	4,9	4,1
	MC	30		21,7	11,72	4,36	5,0	4,1	22	40.830	5.793	7,0	5,0
12 / 11	CS	22		12,0	2,34	1,47	8,2	5,1	20	35.220	4.761	7,4	4,9
		20		9,6	-	1,18	8,1	4,7	18	17.306	2.274	7,6	3,7
	MC	30		21,7	11,72	4,36	5,0	4,1	16	14.504	1.774	8,2	3,5
	CS	22		12,0	2,34	1,47	8,2	5,1	TUNIS				
		20		9,6	-	1,18	8,1	4,7	-	50.955	10.478	4,9	4,0
	MC	30		21,7	11,72	4,36	5,0	4,1	22	30.995	4.125	7,5	4,8
	CS	22		12,0	2,34	1,47	8,2	5,1	20	25.646	3.281	7,8	4,5
		20		9,6	-	1,18	8,1	4,7	18	8.761	1.087	8,1	4,9
	MC	30		21,7	11,72	4,36	5,0	4,1	16	7.210	852	8,5	4,7

Notes

* System with "Hydronic recovery device for extended operating range" option
T_OA = Dry bulb/wet bulb outdoor air temperature [°C]
SET = Operation mode: MC = Maximum Capacity, CS = Constant Supply, HA = High Air Flow
T_SA = Dry bulb supply air temperature [°C]
X_SA = Supply air humidity ratio [g/kg]
P_F = Overall cooling capacity of the system (kW)
P_T = Heating capacity of the system [kW]
P_R = Post-heating capacity [kW]
P_D = Additional capacity available to the space [kW]
P_A = Electricity absorbed by the thermodynamic circuit [kW]
EER_C = Thermodynamic efficiency of the system in cooling mode
EER_S = Overall efficiency of the system in cooling mode (thermodynamic circuit and fans)
COP_C = Thermodynamic efficiency of the system in heating mode

COP_S = Overall efficiency of the system in heating mode (thermodynamic circuit and fans)

E_T = Seasonal thermal/cooling energy supplied [kWh]

E_A = Overall seasonal electricity absorbed [kWh]

SE_C = Thermodynamic seasonal efficiency of the system

SE_S = Overall seasonal efficiency of the system (thermodynamic circuit and fans)

In heating mode, the performances are considered with maximum air temperature supply T_SA equal to 30°C

The performance refers to a standard ZEPHIR³ unit (not fitted with a 'Steam-powered humidification module' option)

Return air in cooling mode = 26°C DB

Return air in heating mode = 20°C / 12°C

Available static pressure: supply 150 Pa, return 100 Pa

Performance values do not include the effect of fan motor heat

Source: ASHRAE weather data (International weather for energy calculation)

SIZE 3 - AIR FLOW 3.300 m³/h (MINIMUM) - COOLING

SUPPLY HUMIDITY RATIO = 9 g/kg														
Performance in cooling and in dehumidification								Seasonal energy performances						
T_OA	SET	T_SA	P_F	P_R	P_D	P_A	EER_C	EER_S	T_SA	E_T	E_A	SE_C	SE_S	
35 / 24	CS	MC	14,3	35,6	-	12,9	14,5	2,5	2,4	STOCKHOLM				
		20	6,3		6,63	13,5	3,1	3,0	-	2.894	578	5,0	4,3	
		22	8,5		4,42	13,2	3,3	3,2	20	3.968	497	8,0	6,7	
		24	10,7		2,21	12,9	3,6	3,4	22	4.304	473	9,1	7,5	
32 / 23	CS	MC	13,8	32,4	-	13,4	12,3	2,6	2,5	LONDON				
		20	6,9		6,63	11,4	3,4	3,3	-	4.614	953	4,8	4,3	
		22	9,1		4,42	11,1	3,7	3,6	20	6.287	824	7,6	6,6	
		24	11,3		2,21	10,8	4,0	3,8	22	6.811	785	8,7	7,4	
30 / 22	CS	MC	13,6	29,1	-	13,7	9,58	3,0	2,9	ROME				
		20	7,1		6,63	8,73	4,1	3,9	-	37.568	8.395	4,5	4,0	
		22	9,3		4,42	8,46	4,5	4,3	20	50.334	7.324	6,9	6,0	
		24	11,5		2,21	8,19	5,0	4,6	22	54.338	6.998	7,8	6,8	
28 / 21	CS	MC	13,7	25,3	-	13,5	6,63	3,8	3,5	VALENCIA				
		20	7,0		6,63	5,85	5,5	5,0	-	46.146	11.254	4,1	3,7	
		22	9,2		4,42	5,60	6,2	5,6	20	60.903	9.930	6,1	5,5	
		24	11,4		2,21	5,35	6,9	6,2	22	65.539	9.522	6,9	6,1	
25 / 19	CS	MC	13,6	18,6	-	13,7	3,60	5,2	4,5	-	32.471	5.619	5,8	5,3
		20	7,1		6,63	3,09	8,3	7,0						
		22	9,3		4,42	2,94	9,5	8,0						

SUPPLY HUMIDITY RATIO = 10 g/kg									Seasonal energy performances					
Performance in cooling and in dehumidification								T_SA	E_T	E_A	SE_C	SE_S		
T_OA	SET	T_SA	P_F	P_R	P_D	P_A	EER_C	EER_S	T_SA	E_T	E_A	SE_C	SE_S	
40 / 25	CS	MC	17,1	33,8	-	9,83	12,5	2,7	2,6	STOCKHOLM				
		20	3,2		6,63	12,0	3,1	2,9	-	1.803	337	5,3	4,1	
		22	5,4		4,42	11,6	3,4	3,2	20	2.171	310	7,0	5,3	
		24	7,6		2,21	11,3	3,7	3,5	22	2.507	285	8,8	6,6	
35 / 24	CS	MC	15,7	31,6	-	11,3	11,0	2,9	2,7	LONDON				
		20	4,8		6,63	10,4	3,5	3,3	-	2.956	564	5,2	4,2	
		22	7,0		4,42	10,1	3,8	3,6	20	3.570	517	6,9	5,5	
		24	9,2		2,21	9,84	4,1	3,9	22	4.093	479	8,6	6,7	
32 / 23	CS	MC	15,3	28,3	-	11,8	8,23	3,4	3,2	ROME				
		20	5,2		6,63	7,68	4,4	4,1	-	25.927	5.131	5,1	4,2	
		22	7,4		4,42	7,45	4,8	4,5	20	31.616	4.680	6,8	5,6	
		24	9,6		2,21	7,22	5,3	4,9	22	35.620	4.372	8,1	6,6	
30 / 22	CS	MC	14,9	25,1	-	12,2	6,32	4,0	3,6	-	16588	20,11	8	7
		20	5,6		6,63	5,81	5,3	4,8						
		22	7,8		4,42	5,60	5,9	5,3						
		24	10,1		2,21	5,40	6,5	5,9						
28 / 21	CS	MC	15,1	21,3	-	12,0	4,34	4,9	4,3	VALENCIA				
		20	5,4		6,63	3,88	6,9	6,0	-	33.488	7.048	4,8	4,1	
		22	7,6		4,42	3,69	7,8	6,8	20	40.868	6.440	6,3	5,4	
		24	9,8		2,21	3,50	8,9	7,7	22	45.505	6.070	7,5	6,3	
25 / 19	CS	MC	18	11,2	-	8,84	2,07	5,4	4,3	TUNIS				
		20	2,2		6,63	1,91	7,0	5,4	-	48.530	11.458	4,2	3,7	
		22	4,4		4,42	1,75	8,9	6,8	20	58.583	10.569	5,5	4,8	

Notes

- * System with "Hydronic recovery device for extended operating range" option
- T_OA = Dry bulb/wet bulb outdoor air temperature [°C]
- SET = Operation mode: MC = Maximum Capacity, CS = Constant Supply, HA = High Air Flow
- T_SA = Dry bulb supply air temperature [°C]
- X_SA = Supply air humidity ratio [g/kg]
- P_F = Overall cooling capacity of the system (kW)
- P_T = Heating capacity of the system [kW]
- P_R = Post-heating capacity [kW]
- P_D = Additional capacity available to the space [kW]
- P_A = Electricity absorbed by the thermodynamic circuit [kW]
- EER_C = Thermodynamic efficiency of the system in cooling mode
- EER_S = Overall efficiency of the system in cooling mode (thermodynamic circuit and fans)

COP_C = Thermodynamic efficiency of the system in heating mode

COP_S = Overall efficiency of the system (thermodynamic circuit and fans)

E_T = Seasonal thermal/cooling energy supplied [kWh]

E_A = Overall seasonal electricity absorbed [kWh]

SE_C = Thermodynamic seasonal efficiency of the system

SE_S = Overall seasonal efficiency of the system (thermodynamic circuit and fans)

In heating mode, the performances are considered with maximum air temperature supply T_SA equal to 30°C

The performance refers to a standard ZEPHIR³ unit (not fitted with a 'Steam-powered humidification module' option)

Return air in cooling mode = 26°C DB Return air in heating mode = 20°C / 12°C

Available static pressure: supply 150 Pa, return 100 Pa

Performance values do not include the effect of fan motor heat

Source: ASHRAE weather data (International weather for energy calculation)

SUPPLY HUMIDITY RATIO = 11 g/kg

Performance in cooling and in dehumidification								Seasonal energy performances					
T_OA	SET	T_SA	P_F	P_R	P_D	P_A	EER_C	EER_S	T_SA	E_T	E_A	SE_C	SE_S
45 / 28 *	MC	15,8	46,9	-	11,2	19,8	2,4	2,3	STOCKHOLM				
		20		4,6	6,63	19,0	2,7	2,6	-	148	27	5,5	4,4
	CS	22		6,9	4,42	18,6	2,9	2,8	20	163	26	6,4	5,1
		24		9,1	2,21	18,2	3,1	3,0	22	186	24	7,8	6,1
45 / 26	MC	18,8	33,7	-	7,96	11,9	2,8	2,7	24	208	22	9,5	7,4
		20		1,3	6,63	11,7	3,0	2,9	LONDON				
	CS	22		3,5	4,42	11,3	3,3	3,1	-	443	83	5,4	4,5
		24		5,7	2,21	10,9	3,6	3,4	20	496	78	6,3	5,3
40 / 25	MC	17,9	30,5	-	8,95	9,34	3,3	3,1	22	558	73	7,6	6,3
		20		2,3	6,63	9,03	3,6	3,4	24	620	68	9,2	7,5
	CS	22		4,5	4,42	8,74	4,0	3,8	ROME				
		24		6,7	2,21	8,45	4,4	4,1	-	8.314	1.546	5,4	4,5
35 / 24	MC	16,5	28,2	-	10,5	7,71	3,7	3,4	20	9.367	1.458	6,4	5,4
		20		3,9	6,63	7,32	4,4	4,1	22	10.517	1.363	7,7	6,4
	CS	22		6,1	4,42	7,10	4,8	4,5	24	11.666	1.264	9,2	7,5
		24		8,3	2,21	6,87	5,3	4,9	VALENCIA				
32 / 23	MC	16,6	24,3	-	10,3	5,55	4,4	4,0	-	14.764	2.839	5,2	4,5
		20		3,8	6,63	5,24	5,4	4,8	20	16.887	2.671	6,3	5,4
	CS	22		6,0	4,42	5,05	6,0	5,4	22	18.755	2.520	7,4	6,3
		24		8,2	2,21	4,87	6,7	6,0	24	20.622	2.365	8,7	7,3
30 / 22	MC	16,2	21,1	-	10,8	4,05	5,2	4,6	TUNIS				
		20		4,2	6,63	3,76	6,7	5,9	-	26.887	5.845	4,6	4,0
	CS	22		6,4	4,42	3,61	7,6	6,6	20	30.879	5.513	5,6	4,9
		24		8,6	2,21	3,46	8,6	7,4	22	33.778	5.270	6,4	5,5
28 / 21	MC	18,6	14,8	-	8,18	2,71	5,5	4,5	24	36.677	5.024	7,3	6,3
		20		1,5	6,63	2,57	6,4	5,2					
	CS	22		3,8	4,42	2,38	7,8	6,3					
		24		6,0	2,21	2,18	9,5	7,6					

SIZE 3 - AIR FLOW 3.300 m³/h (MINIMUM) - HEATING

Performance in Heating								Seasonal energy performances					
T_OA	SET	T_SA	x SA	P_T	P_D	P_A	COP_C	COP_S	T_SA	E_T	E_A	SE_C	SE_S
-20 / -21 *	MC	25,2	0,20	55,8	5,75	16,8	3,3	3,2	STOCKHOLM				
		22		51,7	2,21	13,1	3,9	3,8	-	213.271	43.923	4,9	4,4
	CS	20		49,2	-	11,1	4,4	4,2	22	149.955	22.962	6,5	5,5
		18		46,7	-	9,41	5,0	4,6	20	134.290	19.196	7,0	5,7
-15 / -16 *	MC	30	0,50	54,3	11,0	18,2	3,0	2,9	18	109.472	14.791	7,4	6,0
		22		44,5	2,21	9,74	4,6	4,3	LONDON				
	CS	20		42,1	-	7,96	5,3	4,9	-	165.066	29.741	5,6	5,0
		18		39,6	-	6,63	6,0	5,4	22	107.279	15.199	7,1	5,7
-12 / -13 *	MC	30	0,80	49,9	11,0	15,5	3,2	3,1	20	93.195	12.649	7,4	5,8
		22		40,3	2,21	7,73	5,2	4,8	18	63.145	8.258	7,6	6,0
	CS	20		37,9	-	6,59	5,8	5,2	ROME				
		18		35,5	-	5,50	6,5	5,8	-	85.113	14.600	5,8	5,1
-7 / -8	MC	30	1,50	45,4	11,0	11,3	4,0	3,8	22	53.359	7.462	7,2	5,7
		22		35,6	2,21	6,52	5,5	5,0	20	45.692	6.182	7,4	5,6
	CS	20		33,1	-	5,56	6,0	5,4	18	26.094	3.407	7,7	5,9
		18		30,7	-	4,61	6,7	5,9	VALENCIA				
-5 / -6	MC	30	1,90	42,6	11,0	10,1	4,2	4,0	-	64.578	10.780	6,0	5,2
		22		32,9	2,21	5,66	5,8	5,3	22	39.613	5.531	7,2	5,6
	CS	20		30,5	-	4,7	6,5	5,8	20	33.624	4.564	7,4	5,5
		18		28,0	-	4,02	7,0	6,1	18	16.403	2.143	7,7	5,9
0 / -1	MC	30	3,10	35,8	11,0	7,69	4,7	4,3	TUNIS				
		22		26,3	2,21	3,98	6,6	5,8	-	49.703	7.927	6,3	5,3
	CS	20		23,9	-	3,38	7,1	6,1	22	29.393	4.102	7,2	5,3
		18		21,5	-	2,78	7,7	6,4	20	24.570	3.363	7,3	5,1
2 / 1	MC	30	3,70	33,2	11,0	6,80	4,9	4,5	18	8.305	1.090	7,6	5,5
		22		23,7	2,21	3,44	6,9	5,9					
	CS	20		21,3	-	2,80	7,6	6,3					
		18		18,9	-	2,43	7,8	6,3					
7 / 6	MC	30	5,40	26,7	11,0	4,70	5,7	5,1					
		22		17,4	2,21	2,33	7,5	6,0					
	CS	20		15,1	-	2,00	7,6	5,9					
		18		12,8	-	1,68	7,6	5,7					
12 / 11	MC	30	7,80	20,4	11,0	3,07	6,6	5,6					
		22		11,4	2,21	1,63	7,0	5,2					
	CS	20		9,3	-	1,30	7,2	5,0					

SIZE 3 - AIR FLOW 4.600 m³/h (STANDARD) - COOLING

SUPPLY HUMIDITY RATIO = 10 g/kg								
Performance in cooling and in dehumidification								
T_OA	SET	T_SA	P_F	P_R	P_D	P_A	EER_C	EER_S
35 / 24	MC	16,2	42,6	-	15,0	16,3	2,6	2,5
		20		5,9	9,24	15,4	3,1	3,0
	CS	22		8,9	6,16	15,0	3,4	3,2
		24		12,0	3,08	14,5	3,8	3,5
32 / 23	MC	15,1	39,6	-	16,7	14,2	2,8	2,6
		20		7,5	9,24	13,2	3,6	3,3
	CS	22		10,6	6,16	12,8	3,9	3,7
		24		13,7	3,08	12,4	4,3	4,0
30 / 22	MC	14,98	34,8	-	16,9	10,2	3,4	3,1
		20		7,7	9,24	9,38	4,5	4,1
	CS	22		10,8	6,16	9,06	5,0	4,6
		24		13,9	3,08	8,73	5,6	5,0
28 / 21	MC	15,2	29,4	-	16,6	6,29	4,7	4,1
		20		7,4	9,24	5,63	6,5	5,6
	CS	22		10,5	6,16	5,36	7,4	6,3
		24		13,6	3,08	5,08	8,5	7,1
25 / 19	MC	15,8	19,0	-	15,7	3,03	6,3	4,8
	CS	20		6,5	9,24	2,67	9,5	7,1

Seasonal energy performances				
T_SA	E_T	E_A	SE_C	SE_S
STOCKHOLM				
-	2.992	493	6,1	4,4
20	3.985	435	9,2	6,4
22	399	54	7,4	6,1
24	430	51	8,5	6,8
LONDON				
-	4.821	829	5,8	4,6
20	6.381	734	8,7	6,7
22	1.144	169	6,8	5,9
24	1.230	161	7,7	6,6
ROME				
-	40.378	7.581	5,3	4,3
20	52.611	6.756	7,8	6,2
22	21.307	3.161	6,7	5,8
24	22.909	3.010	7,6	6,5
VALENCIA				
-	50.715	10.640	4,8	4,0
20	65.143	9.570	6,8	5,6
22	35.834	5.975	6,0	5,3
24	38.437	5.717	6,7	5,9

SUPPLY HUMIDITY RATIO = 11 g/kg								
Performance in cooling and in dehumidification								
T_OA	SET	T_SA	P_F	P_R	P_D	P_A	EER_C	EER_S
40 / 25	MC	18,3	41,9	-	11,8	14,9	2,8	2,6
		20		2,6	9,24	14,5	3,1	2,9
	CS	22		5,7	6,16	14,0	3,4	3,2
		24		8,8	3,08	13,5	3,8	3,5
35 / 24	MC	16,9	38,7	-	14,0	12,5	3,1	2,9
		20		4,8	9,24	11,9	3,7	3,4
	CS	22		7,9	6,16	11,5	4,0	3,7
		24		10,9	3,08	11,1	4,5	4,1
32 / 23	MC	16,5	34,0	-	14,6	9,01	3,8	3,4
		20		5,4	9,24	8,50	4,6	4,2
	CS	22		8,5	6,16	8,20	5,2	4,6
		24		11,6	3,08	7,91	5,8	5,1
30 / 22	MC	16,4	29,1	-	14,7	5,97	4,9	4,2
		20		5,5	9,24	5,56	6,2	5,3
	CS	22		8,6	6,16	5,33	7,1	6,0
		24		11,7	3,08	5,10	8,0	6,8
28 / 21	MC	16,6	23,6	-	14,4	3,94	6,0	4,8
		20		5,2	9,24	3,59	8,0	6,4
	CS	22		8,3	6,16	3,39	9,4	7,4
		24		11,4	3,08	3,18	11,0	8,5
25 / 19	MC	20,5	8,1	-	8,47	1,18	6,9	3,8
	CS	22		2,3	6,16	1,06	9,9	5,2

Seasonal energy performances				
T_SA	E_T	E_A	SE_C	SE_S
STOCKHOLM				
-	1.392	207	6,7	3,6
20	288	36	8,0	6,0
22	1.803	184	9,8	4,9
24	350	32	11,0	8,0
LONDON				
-	2.389	368	6,5	4,0
20	835	111	7,5	6,1
22	3.106	327	9,5	5,7
24	1.008	100	10,1	8,0
ROME				
-	23.341	3.784	6,2	4,3
20	15.575	2.072	7,5	6,1
22	30.679	3.334	9,2	6,1
24	18.779	1.853	10,1	8,0
VALENCIA				
-	32.265	5.693	5,7	4,2
20	26.572	3.892	6,8	5,7
22	42.269	5.036	8,4	6,0
24	31.778	3.519	9	7
TUNIS				
-	49.555	10.348	4,8	3,6
20	44.937	8.123	5,5	4,6
22	63.690	9.287	6,9	5,1
24	52.952	7.457	7,1	5,9

SUPPLY HUMIDITY RATIO = 12 g/kg								
Performance in cooling and in dehumidification								
T_OA	SET	T_SA	P_F	P_R	P_D	P_A	EER_C	EER_S
45 / 26	MC	19,9	41,8	-	9,40	14,2	2,9	2,8
		20		0,2	9,24	14,2	3,0	2,8
	CS	22		3,2	6,16	13,6	3,3	3,1
		24		6,3	3,08	13,0	3,7	3,5
40 / 25	MC	19,6	36,6	-	9,86	9,86	3,7	3,4
		20		0,6	9,24	9,78	3,8	3,5
	CS	22		3,7	6,16	9,35	4,3	3,9
		24		6,8	3,08	8,93	4,9	4,4
35 / 24	MC	18,5	32,9	-	11,5	7,33	4,5	4,0
		20		2,3	9,24	7,11	5,0	4,4
	CS	22		5,4	6,16	6,82	5,6	4,9
		24		8,5	3,08	6,53	6,3	5,5
32 / 23	MC	18	28,2	-	12,3	5,37	5,3	4,5
		20		3,1	9,24	5,15	6,1	5,1
	CS	22		6,2	6,16	4,93	7,0	5,9
		24		9,2	3,08	4,71	7,9	6,6
30 / 22	MC	18,4	22,5	-	11,7	3,37	6,7	5,2
		20		2,5	9,24	3,23	7,7	6,0
	CS	22		5,5	6,16	3,06	9,2	7,0
		24		8,6	3,08	2,88	10,8	8,2
28 / 21	MC	21,1	13,3	-	7,55	1,96	6,8	4,6
	CS	22		1,4	6,16	1,85	7,9	5,3
		24		4,5	3,08	1,58	11,2	7,1

SIZE 3 - AIR FLOW 4.600 m³/h (STANDARD) - HEATING

Performance in Heating									Seasonal energy performances				
T_OA	SET	T_SA	x_SA	P_T	P_D	P_A	COP_C	COP_S	T_SA	E_T	E_A	SE_C	SE_S
-20 / -21 *	MC	18,2	0,20	65,5	-	15,1	4,3	4,0	STOCKHOLM				
	CS	18		65,2	-	14,9	4,4	4,0	-	284.316	59.157	4,8	4,2
-15 / -16 *	CS	22,8	0,50	63,4	4,31	16,4	3,9	3,6	22	208.685	32.984	6,3	4,9
		22		62,0	3,08	15,3	4,1	3,8	20	186.567	27.168	6,9	5,1
		20		58,6	-	12,8	4,6	4,2	18	152.667	21.148	7,2	5,2
		18		55,2	-	10,7	5,2	4,6	LONDON				
-12 / -13 *	CS	25,7	0,80	62,1	8,78	17,1	3,6	3,4	-	228.393	44.062	5,2	4,6
		22		56,0	3,08	12,5	4,5	4,1	22	149.144	20.516	7,3	5,7
		20		52,7	-	10,5	5,0	4,5	20	128.970	16.645	7,7	5,7
		18		49,3	-	8,53	5,8	5,1	18	87.987	11.127	7,9	5,9
-7 / -8	CS	22,1	1,50	48,7	3,23	9,88	4,9	4,5	ROME				
		22		49,6	3,08	9,83	5,0	4,6	-	118.255	21.860	5,4	4,7
		20		46,2	-	8,48	5,4	4,9	22	74.137	9.794	7,6	5,7
		18		42,8	-	7,12	6,0	5,3	20	63.025	7.900	8,0	5,7
-5 / -6	CS	24,3	1,90	49,7	6,62	10,2	4,9	4,5	VALENCIA				
		22		45,9	3,08	8,61	5,3	4,8	-	89.811	16.162	5,6	4,8
		20		42,4	-	7,19	5,9	5,2	22	55.016	7.150	7,7	5,7
		18		39,1	-	6,15	6,4	5,5	20	46.258	5.741	8,1	5,6
0 / -1	MC	29,8	3,10	49,5	15,0	11,3	4,4	4,0	TUNIS				
		22		36,6	3,08	5,96	6,1	5,3	-	69.149	11.870	5,8	4,7
		20		33,3	-	4,81	6,9	5,8	22	40.792	5.169	7,9	5,2
		18		30,0	-	3,97	7,6	6,1	20	33.640	4.113	8,2	4,9
2 / 1	MC	30	3,70	46,2	15,4	10,2	4,5	4,1	18	11.550	1.396	8,3	5,3
		22		33,0	3,08	4,79	6,9	5,8					
		20		29,7	-	4,01	7,4	6,0					
		18		26,4	-	3,38	7,8	6,1					
7 / 6	MC	30	5,40	37,1	15,4	7,13	5,2	4,6	In heating mode, the performances are considered with maximum air temperature supply T_SA equal to 30°C				
		22		24,2	3,08	3,14	7,7	5,9	The performance refers to a standard ZEPHIR ³ unit (not fitted with a 'Steam-powered humidification module' option)				
		20		21,0	-	2,54	8,3	6,0	Return air in cooling mode = 26°C DB				
		18		17,8	-	2,15	8,3	5,8	Return air in heating mode = 20°C / 12°C				
12 / 11	MC	30	7,80	28,4	15,40	4,56	6,2	5,2	Available static pressure: supply 150 Pa, return 100 Pa				
		22		15,8	3,08	1,97	8,0	5,4	Performance values do not include the effect of fan motor heat				
		20		12,6	-	1,55	8,1	5,1	Source: ASHRAE weather data (International weather for energy calculation)				

Notes

* System with "Hydronic recovery device for extended operating range" option
T_OA = Dry bulb/wet bulb outdoor air temperature [°C]
SET = Operation mode: MC = Maximum Capacity, CS = Constant Supply, HA = High Air Flow
T_SA = Dry bulb supply air temperature [°C]
X_SA = Supply air humidity ratio [g/kg]
P_F = Overall cooling capacity of the system [kW]
P_T = Heating capacity of the system [kW]
P_R = Post-heating capacity [kW]
P_D = Additional capacity available to the space [kW]
P_A = Electricity absorbed by the thermodynamic circuit [kW]
EER_C = Thermodynamic efficiency of the system in cooling mode
EER_S = Overall efficiency of the system in cooling mode (thermodynamic circuit and fans)
COP_C = Thermodynamic efficiency of the system in heating mode

COP_S = Overall efficiency of the system in heating mode (thermodynamic circuit and fans)

E_T = Seasonal thermal/cooling energy supplied [kWh]

E_A = Overall seasonal electricity absorbed [kWh]

SE_C = Thermodynamic seasonal efficiency of the system

SE_S = Overall seasonal efficiency of the system (thermodynamic circuit and fans)

In heating mode, the performances are considered with maximum air temperature supply T_SA equal to 30°C

The performance refers to a standard ZEPHIR³ unit (not fitted with a 'Steam-powered humidification module' option)

Return air in cooling mode = 26°C DB

Return air in heating mode = 20°C / 12°C

Available static pressure: supply 150 Pa, return 100 Pa

Performance values do not include the effect of fan motor heat

Source: ASHRAE weather data (International weather for energy calculation)

SIZE 3 - AIR FLOW 7.000 m³/h (MAXIMUM) - COOLING

SUPPLY HUMIDITY RATIO = 11 g/kg								
Performance in cooling and in dehumidification								
T_OA	SET	T_SA	P_F	P_R	P_D	P_A	EER_C	EER_S
32 / 23	MC	17,6	49,4	-	19,9	14,0	3,4	3,0
		20		5,6	14,6	13,0	4,0	3,5
	CS	22		10,3	9,38	13,0	4,5	3,9
		24		15,0	4,69	12,0	5,1	4,4
30 / 22	MC	17,3	42,3	-	20,9	9,75	4,3	3,6
		20		6,3	14,6	9,18	5,3	4,3
	CS	22		11,0	9,38	8,76	6,1	4,9
		24		15,7	4,69	8,34	7,0	5,5
28 / 21	MC	17	35,1	-	21,9	6,29	5,6	4,2
		20		7,0	14,6	5,77	7,3	5,3
	CS	22		11,7	9,38	5,42	8,6	6,2
		24		16,4	4,69	5,07	10,2	7,2
25 / 19	MC	19,4	15,0	-	15,7	1,96	7,7	3,7
	CS	20		1,4	14,6	1,90	8,6	4,1

Seasonal energy performances				
T_SA	E_T	E_A	SE_C	SE_S
STOCKHOLM				
-	2.481	341	7,3	3,3
20	2.751	328	8,4	3,8
22	468	54	8,6	5,8
24	515	51	10,2	6,7
LONDON				
-	4.154	604	6,9	3,8
20	4.641	577	8,0	4,3
22	1.343	170	7,9	5,9
24	1.475	159	9,3	6,7
ROME				
-	38.359	6.160	6,2	3,8
20	43.761	5.806	7,5	4,5
22	25.002	3.162	7,9	5,9
24	27.439	2.973	9,2	6,7
VALENCIA				
-	50.613	9.001	5,6	3,8
20	57.980	8.470	6,8	4,5
22	41.327	5.772	7,2	5,5
24	45.232	5.450	8,3	6,3

SUPPLY HUMIDITY RATIO = 12 g/kg								
Performance in cooling and in dehumidification								
T_OA	SET	T_SA	P_F	P_R	P_D	P_A	EER_C	EER_S
35 / 24	MC	18,9	49,1	-	16,6	13,6	3,6	3,1
		20		2,6	14,0	13,3	3,9	3,4
	CS	22		7,3	9,38	12,7	4,4	3,8
		24		12,0	4,69	12,2	5,0	4,3
32 / 23	MC	18,7	41,3	-	17,1	8,83	4,7	3,8
		20		3,0	14,0	8,56	5,2	4,2
	CS	22		7,7	9,38	8,15	6,0	4,8
		24		12,4	4,69	7,74	6,9	5,4
30 / 22	MC	18,7	33,6	-	17,1	5,39	6,2	4,5
		20		3,0	14,06	5,20	7,0	5,0
	CS	22		7,7	9,38	4,90	8,4	5,9
		24		12,4	4,69	4,61	10,0	6,8
28 / 21	MC	18,5	26,3	-	17,5	3,61	7,3	4,6
		20		3,5	14,0	3,41	8,7	5,4
	CS	22		8,2	9,38	3,16	10,9	6,5

Seasonal energy performances				
T_SA	E_T	E_A	SE_C	SE_S
STOCKHOLM				
-	263	36	7,3	4,2
20	298	34	8,7	4,9
22	345	32	10,9	5,9
LONDON				
-	773	112	6,9	4,5
20	870	106	8,2	5,3
22	1.001	99	10,1	6,3
24	192	22	8,9	6,4
ROME				
-	14.416	2.067	7,0	4,5
20	16.199	1.963	8,3	5,3
22	18.637	1.828	10,2	6,4
24	4418	457	10	7
VALENCIA				
-	25.139	3.897	6,5	4,4
20	27.955	3.726	7,5	5,1
22	31.916	3.489	9,1	6,0
24	15.224	1.723	8,8	6,3

SUPPLY HUMIDITY RATIO = 13 g/kg								
Performance in cooling and in dehumidification								
T_OA	SET	T_SA	P_F	P_R	P_D	P_A	EER_C	EER_S
45 / 26	MC	22,2	53,0	-	8,91	15,4	3,4	3,0
	CS	24		4,2	4,69	14,1	4,1	3,5
40 / 25	MC	23	42,9	-	7,03	8,36	5,1	4,1
	CS	24		2,3	4,69	7,57	6,0	4,7
35 / 24	MC	20,3	40,6	-	13,3	7,97	5,1	4,0
	CS	22		4,0	9,38	7,57	5,9	4,6
		24		8,7	4,69	7,10	6,9	5,3
32 / 23	MC	20,5	31,9	-	12,8	4,69	6,8	4,7
		22		3,5	9,38	4,44	8,0	5,4
	CS	24		8,2	4,69	4,11	9,8	6,4
30 / 22	MC	20	25,2	-	14,0	3,08	8,2	4,8
		20		0,0	14,0	3,08	8,2	4,8
	CS	22		4,7	9,38	2,86	10,5	6,0
		24		9,4	4,69	2,64	13,1	7,3
28 / 21	MC	24,1	9,08	-	4,45	1,06	8,6	2,9

Seasonal energy performances				
T_SA	E_T	E_A	SE_C	SE_S
LONDON				
-	325	39	8,3	3,3
20	76	9	8,2	4,8
22	125	13	9,6	5,8
24	144	12	12,0	7,0
ROME				
-	6.293	753	8,4	3,4
20	2.243	274	8,2	4,8
22	2.872	281	10,2	5,9
24	3.318	260	12,8	7,2
VALENCIA				
-	13.339	1.682	7,9	3,8
20	6.376	779	8,2	4,8
22	9.974	1.050	9,5	5,8
24	11.464	971	11,8	7,0

SIZE 3 - AIR FLOW 7.000 m³/h (MAXIMUM) - COOLING

SUPPLY HUMIDITY RATIO = non controllata													
Performance in cooling and in dehumidification													
T_OA	SET	T_SA	x_SA	P_F	P_D	P_A	EER_C	EER_S	Seasonal energy performances				
45 / 28 *	HA	26	16,6	44,8	-	4,83	9,3	6,0	T_SA	E_T	E_A	SE_C	SE_S
45 / 26	HA	26	13,7	41,4	-	6,70	6,2	4,7	STOCKHOLM				
40 / 25	HA	24	13,2	39,2	4,69	6,10	6,4	4,8	-	2.957	388	7,6	3,7
35 / 24	HA	22	13,9	31,9	9,38	4,46	7,2	4,8	LONDON				
32 / 23	HA	21	13,2	30,2	11,7	4,20	7,2	4,8	-	4.673	612	7,6	4,2
30 / 22	HA	20	13,0	25,1	14,0	3,06	8,2	4,8	ROME				
28 / 21	HA	19	12,3	23,1	16,4	2,91	7,9	4,6	-	37.039	4.803	7,7	4,3
25 / 19	HA	18	10,8	19,2	18,7	2,53	7,6	4,1	VALENCIA				
									-	44.565	5.754	7,7	4,4
									TUNIS				
									-	61.867	8.097	7,6	4,0

SIZE 3 - AIR FLOW 7.000 m³/h (MAXIMUM) - HEATING

Performance in Heating								Seasonal energy performances					
T_OA	SET	T_SA	x_SA	P_T	P_D	P_A	COP_C	COP_S	T_SA	E_T	E_A	SE_C	SE_S
-15 / -16 *	MC	14,8	0,50	75,7	-	14,6	5,2	4,4	STOCKHOLM				
	HA	14,8		75,7	-	14,6	5,2	4,4	-	356.197	66.030	5,4	4,1
-12 / -13 *	MC	17,2	0,80	73,9	-	15,2	4,9	4,1	22	158.788	23.053	6,9	4,6
	HA	16		68,5	-	13,5	5,1	4,2	20	207.139	29.811	6,9	4,6
-7 / -8	MC	14,2	1,50	55,2	-	8,73	6,3	5,1	18	179.044	23.865	7,5	4,6
	HA	14,2		55,2	-	8,73	6,3	5,1	16	202.769	27.791	7,3	4,8
-5 / -6	MC	16,3	1,90	55,0	-	8,98	6,1	5,0	LONDON				
	HA	16		54,3	-	8,76	6,2	5,0	-	314.697	60.311	5,2	4,3
	MC	21,5		54,5	3,52	9,78	5,6	4,6	22	192.851	26.405	7,3	5,0
0 / -1	CS	20	3,10	50,6	-	8,37	6,0	4,8	20	189.583	25.029	7,6	5,0
	18			45,5	-	6,66	6,8	5,2	18	159.052	19.961	8,0	4,8
	HA	16		40,5	-	5,40	7,5	5,4	16	113.593	13.718	8,3	5,1
	MC	23,7		54,6	8,67	10,1	5,4	4,5	ROME				
2 / 1	22			50,2	4,69	8,46	5,9	4,7	-	169.267	32.463	5,2	4,3
	CS	20	3,70	45,2	-	6,77	6,7	5,1	22	107.615	14.235	7,6	5,0
	18			40,2	-	5,52	7,3	5,3	20	95.461	12.016	7,9	4,9
	HA	16		35,1	-	4,23	8,3	5,5	18	78.383	9.527	8,2	4,7
	MC	29		54,0	21,0	11,1	4,9	4,1	16	46.269	5.394	8,6	5,0
7 / 6	22			36,9	4,69	4,97	7,4	5,2	VALENCIA				
	CS	20	5,40	32,0	-	3,93	8,1	5,3	-	130.856	24.956	5,2	4,3
	18			27,0	-	3,17	8,5	5,1	22	81.755	10.507	7,8	5,0
	HA	16		22,1	-	2,48	8,9	4,8	20	70.564	8.666	8,1	4,9
	MC	30		43,3	23,4	7,82	5,5	4,4	18	57.072	6.828	8,4	4,5
12 / 11	22			24,0	4,69	2,71	8,9	5,0	16	28.894	3.327	8,7	5,0
	CS	20	7,80	19,3	-	2,18	8,9	4,5	TUNIS				
	18			14,4	-	1,65	8,7	3,8	-	103.691	19.591	5,3	4,1
									22	62.053	7.538	8,2	4,6
									20	51.419	6.020	8,5	4,3
									18	40.403	4.684	8,6	3,8
									16	14.355	1.613	8,9	4,3

Notes

* System with "Hydronic recovery device for extended operating range" option
T_OA = Dry bulb/wet bulb outdoor air temperature [°C]
SET = Operation mode: MC = Maximum Capacity, CS = Constant Supply, HA = High Air Flow
T_SA = Dry bulb supply air temperature [°C]
X_SA = Supply air humidity ratio [g/kg]
P_F = Overall cooling capacity of the system (kW)
P_T = Heating capacity of the system [kW]
P_R = Post-heating capacity [kW]
P_D = Additional capacity available to the space [kW]
P_A = Electricity absorbed by the thermodynamic circuit [kW]
EER_C = Thermodynamic efficiency of the system in cooling mode
EER_S = Overall efficiency of the system in cooling mode (thermodynamic circuit and fans)
COP_C = Thermodynamic efficiency of the system in heating mode

COP_S = Overall efficiency of the system in heating mode (thermodynamic circuit and fans)

E_T = Seasonal thermal/cooling energy supplied [kWh]

E_A = Overall seasonal electricity absorbed [kWh]

SE_C = Thermodynamic seasonal efficiency of the system

SE_S = Overall seasonal efficiency of the system (thermodynamic circuit and fans)

In heating mode, the performances are considered with maximum air temperature supply T_SA equal to 30°C

The performance refers to a standard ZEPHIR³ unit (not fitted with a 'Steam-powered humidification module' option)

Return air in cooling mode = 26°C DB

Return air in heating mode = 20°C / 12°C

Available static pressure: supply 150 Pa, return 100 Pa

Performance values do not include the effect of fan motor heat

Source: ASHRAE weather data (International weather for energy calculation)

SIZE 4 - AIR FLOW 5.200 m³/h (MINIMUM) - COOLING

SUPPLY HUMIDITY RATIO = 9 g/kg									Seasonal energy performances				
Performance in cooling and in dehumidification									Seasonal energy performances				
T_OA	SET	T_SA	P_F	P_R	P_D	P_A	EER_C	EER_S	T_SA	E_T	E_A	SE_C	SE_S
35 / 24	MC	14,7	55,3	-	19,6	20,2	2,7	2,6	STOCKHOLM	4.248	988	4,3	3,7
		20		9,2	10,4	19,0	3,4	3,3					
	CS	22		12,7	6,96	18,5	3,7	3,5					
		24		16,2	3,48	18,0	4,0	3,8					
32 / 23	MC	13,7	51,4	-	21,4	17,8	2,9	2,8	LONDON	6.809	1.609	4,2	3,8
		20		11,0	10,4	16,5	3,8	3,6					
	CS	22		14,5	6,96	16,1	4,1	3,9					
		24		17,9	3,48	15,6	4,4	4,2					
30 / 22	MC	14,3	44,6	-	20,3	12,9	3,5	3,2	ROME	56.291	13.783	4,1	3,7
		20		9,9	10,4	11,8	4,6	4,3					
	CS	22		13,4	6,96	11,4	5,1	4,7					
		24		16,9	3,48	11,0	5,6	5,2					
28 / 21	MC	13,7	40,0	-	21,4	10,6	3,8	3,5	VALENCIA	69.708	17.817	3,9	3,6
		20		11,0	10,4	9,34	5,5	5,0					
	CS	22		14,5	6,96	8,94	6,1	5,6					
		24		17,9	3,48	8,55	6,8	6,2					
25 / 19	MC	15	27,1	-	19,1	6,21	4,4	3,8	STOCKHOLM	2651	563	4,7	3,6
		20		8,7	10,4	5,42	6,6	5,7					
	CS	22		12,2	6,96	5,10	7,7	6,6					

SUPPLY HUMIDITY RATIO = 10 g/kg									Seasonal energy performances				
Performance in cooling and in dehumidification									Seasonal energy performances				
T_OA	SET	T_SA	P_F	P_R	P_D	P_A	EER_C	EER_S	T_SA	E_T	E_A	SE_C	SE_S
45 / 28 *	MC	15,2	77,2	-	18,8	38,8	2,0	1,9	STOCKHOLM	2.651	563	4,7	3,6
		20		8,4	10,4	37,0	2,3	2,2					
	CS	22		11,8	6,96	36,3	2,5	2,4					
		24		15,3	3,48	35,6	2,6	2,5					
40 / 25	MC	16,8	54,1	-	16,0	18,6	2,9	2,8	LONDON	4.347	933	4,7	3,8
		20		5,6	10,4	17,8	3,4	3,2					
	CS	22		9,1	6,96	17,3	3,7	3,5					
		24		12,5	3,48	16,8	4,0	3,8					
35 / 24	MC	15,2	50,5	-	18,8	16,4	3,1	2,9	ROME	38.077	8.301	4,6	3,9
		20		8,4	10,4	15,4	3,8	3,6					
	CS	22		11,8	6,96	15,0	4,2	3,9					
		24		15,3	3,48	14,6	4,5	4,3					
32 / 23	MC	15,2	44,8	-	18,8	12,8	3,5	3,3	VALENCIA	49.551	11.119	4,5	3,8
		20		8,4	10,4	11,9	4,5	4,2					
	CS	22		11,8	6,96	11,6	4,9	4,5					
		24		15,3	3,48	11,2	5,4	5,0					
30 / 22	MC	15,7	38,2	-	17,9	8,84	4,3	3,9	TUNIS	74.008	18.232	4,1	3,5
		20		7,5	10,4	8,17	5,6	5,1					
	CS	22		11,0	6,96	7,86	6,3	5,6					
		24		14,5	3,48	7,55	7,0	6,3					
28 / 21	MC	16,7	30,8	-	16,1	6,92	4,5	4,0	TUNIS	57.853	10.330	5,6	4,8
		20		5,7	10,4	6,31	5,8	5,1					
	CS	22		9,2	6,96	5,95	6,7	5,9					
		24		12,7	3,48	5,59	7,8	6,8					
25 / 19	MC	18,7	16,5	-	12,7	3,48	4,7	3,8	TUNIS	65.158	9.666	6,7	5,7
		20		2,3	10,4	3,29	5,7	4,5					
	CS	22		5,7	6,96	2,99	7,4	5,8					

Notes

* System with "Hydronic recovery device for extended operating range" option

T_OA = Dry bulb/wet bulb outdoor air temperature [°C]

SET = Operation mode: MC = Maximum Capacity, CS = Constant Supply, HA = High Air Flow

T_SA = Dry bulb supply air temperature [°C]

X_SA = Supply air humidity ratio [g/kg]

P_F = Overall cooling capacity of the system (kW)

P_T = Heating capacity of the system [kW]

P_R = Post-heating capacity [kW]

P_D = Additional capacity available to the space [kW]

P_A = Electricity absorbed by the thermodynamic circuit [kW]

EER_C = Thermodynamic efficiency of the system in cooling mode

EER_S = Overall efficiency of the system in cooling mode (thermodynamic circuit and fans)

COP_C = Thermodynamic efficiency of the system in heating mode

COP_S = Overall efficiency of the system in heating mode (thermodynamic circuit and fans)

E_T = Seasonal thermal/cooling energy supplied [kWh]

E_A = Overall seasonal electricity absorbed [kWh]

SE_C = Thermodynamic seasonal efficiency of the system

SE_S = Overall seasonal efficiency of the system (thermodynamic circuit and fans)

In heating mode, the performances are considered with maximum air temperature supply T_SA equal to 30°C

The performance refers to a standard ZEPHIR³ unit (not fitted with a 'Steam-powered humidification module' option)

Return air in cooling mode = 26°C DB

Return air in heating mode = 20°C / 12°C

Available static pressure: supply 150 Pa, return 100 Pa

Performance values do not include the effect of fan motor heat

Source: ASHRAE weather data (International weather for energy calculation)

SUPPLY HUMIDITY RATIO = 11 g/kg

Performance in cooling and in dehumidification								Seasonal energy performances					
T_OA	SET	T_SA	P_F	P_R	P_D	P_A	EER_C	EER_S	T_SA	E_T	E_A	SE_C	SE_S
45 / 28 *	CS	MC	71,4	-	16,1	27,9	2,6	2,5	STOCKHOLM				
		20		5,7	10,4	26,9	2,9	2,8	-	208	44	4,7	3,7
		22		9,2	6,96	26,2	3,1	2,9	20	208	44	4,7	3,7
		24		12,7	3,48	25,6	3,3	3,1	22	243	40	6,0	4,7
45 / 26	CS	MC	52,7	-	12,0	16,6	3,2	3,0	24	278	36	7,8	5,9
		20		1,6	10,4	16,3	3,3	3,2	LONDON				
		22		5,0	6,96	15,8	3,7	3,5	-	621	133	4,7	4,0
		24		8,5	3,48	15,2	4,0	3,8	20	630	132	4,8	4,0
40 / 25	CS	MC	48,5	-	14,1	14,3	3,4	3,2	22	728	121	6,0	5,0
		20		3,7	10,4	13,8	3,8	3,6	24	825	109	7,6	6,2
		22		7,1	6,96	13,4	4,2	3,9	ROME				
		24		10,6	3,48	12,9	4,6	4,3	-	11.566	2.480	4,7	4,0
35 / 24	CS	MC	44,1	-	16,1	12,0	3,7	3,4	20	11.719	2.464	4,8	4,0
		20		5,7	10,4	11,4	4,4	4,1	22	13.530	2.255	6,0	5,0
		22		9,2	6,96	11,0	4,8	4,5	24	15.341	2.034	7,5	6,2
		24		12,7	3,48	10,7	5,3	4,9	VALENCIA				
32 / 23	CS	MC	37,5	-	15,3	8,35	4,5	4,1	-	20.588	4.477	4,6	4,0
		20		4,9	10,4	7,92	5,4	4,8	20	21.267	4.409	4,8	4,1
		22		8,4	6,96	7,62	6,0	5,4	22	24.210	4.079	5,9	5,0
		24		11,8	3,48	7,32	6,7	6,0	24	27.152	3.734	7,3	6,1
30 / 22	CS	MC	28,1	-	11,8	6,15	4,6	4,0	TUNIS				
		20		1,4	10,4	6,00	4,9	4,3	-	38.968	9.030	4,3	3,7
		22		4,9	6,96	5,63	5,9	5,1	20	41.804	8.749	4,8	4,1
		24		8,4	3,48	5,26	6,9	6,0	22	46.372	8.255	5,6	4,7
28 / 21	CS	MC	20,8	-	10,4	4,43	4,7	3,9	24	50.941	7.760	6,6	5,5
		20		0,0	10,4	4,43	4,7	3,9					
		22		3,5	6,96	4,02	6,0	5,0					
		24		7,0	3,48	3,58	7,8	6,3					

SIZE 4 - AIR FLOW 5.200 m³/h (MINIMUM) - HEATING

Performance in Heating								Seasonal energy performances					
T_OA	SET	T_SA	x_SA	P_T	P_D	P_A	COP_C	COP_S	T_SA	E_T	E_A	SE_C	SE_S
-20 / -21 *	CS	MC	0,20	95,2	15,7	37,6	2,5	2,5	STOCKHOLM				
		22		81,4	3,5	21,2	3,8	3,6	-	335835	71945	4,7	4,2
		20		77,4	-	17,5	4,4	4,2	22	236020	37024	6,4	5,2
		18		73,5	-	13,8	5,3	4,9	20	192824	28436	6,8	5,6
-15 / -16 *	CS	MC	0,50	85,5	17,4	30,2	2,8	2,7	18	172360	24179	7,1	5,7
		22		70,1	3,5	14,7	4,8	4,4	LONDON				
		20		66,2	-	12,3	5,4	4,9	-	259925	49369	5,3	4,8
		18		62,4	-	9,9	6,3	5,6	22	168792	26102	6,5	5,4
-12 / -13 *	CS	MC	0,80	78,6	17,4	25,4	3,1	3,0	20	114141	16841	6,8	5,6
		22		63,4	3,5	12,4	5,1	4,7	18	99315	14238	7,0	5,6
		20		59,6	-	10,0	6,0	5,4	ROME				
		18		55,9	-	8,1	6,9	6,1	-	134067	24737	5,4	4,8
-7 / -8	CS	MC	1,50	71,6	17,4	19,3	3,7	3,6	22	83930	13166	6,4	5,2
		22		56,1	3,5	10,1	5,6	5,1	20	47597	7119	6,7	5,5
		20		52,2	-	8,5	6,2	5,6	18	41024	5969	6,9	5,5
		18		48,4	-	7,1	6,8	6,1	VALENCIA				
-5 / -6	CS	MC	1,90	67,1	17,4	16,9	4,0	3,8	-	101753	18572	5,5	4,9
		22		51,8	3,5	8,8	5,9	5,4	22	62294	9871	6,3	5,1
		20		48	-	7,4	6,5	5,8	20	30038	4523	6,6	5,4
		18		44,2	-	6,0	7,3	6,4	18	25782	3776	6,8	5,4
0 / -1	CS	MC	3,10	56,4	17,4	12,2	4,6	4,3	TUNIS				
		22		41,4	3,5	6,0	6,9	6,1	-	78359	14071	5,6	4,7
		20		37,6	-	5,1	7,4	6,3	22	46203	7465	6,2	4,6
		18		33,8	-	4,5	7,5	6,3	20	15370	2364	6,5	4,9
2 / 1	CS	MC	3,70	52,2	17,4	10,7	4,9	4,5	18	13043	1945	6,7	4,9
		22		37,3	3,5	5,3	7,0	6,0					
		20		33,6	-	4,7	7,1	6,0					
		18		29,8	-	4,2	7,2	6,0					
7 / 6	CS	MC	5,40	42	17,4	7,5	5,6	5,0					
		22		27,4	3,5	4,3	6,4	5,3					
		20		23,7	-	3,7	6,5	5,3					
		18		20,1	-	3,0	6,7	5,2					
12 / 11	CS	MC	7,80	32,2	17,4	5,8	5,6	4,8					
		22		17,9	3,5	3,0	6,1	4,7					
		20		-	-	-	-	-					
		18		-	-	-	-	-					

SIZE 4 - AIR FLOW 7.200 m³/h (STANDARD) - COOLING

SUPPLY HUMIDITY RATIO = 10 g/kg								
Performance in cooling and in dehumidification								
T_OA	SET	T_SA	P_F	P_R	P_D	P_A	EER_C	EER_S
35 / 24	MC	16,9	65,4	-	21,9	24,6	2,7	2,5
		20		7,5	14,4	23,5	3,1	2,9
	CS	22		12,3	9,64	22,7	3,4	3,2
		24		17,1	4,82	21,9	3,8	3,5
32 / 23	MC	16,2	59,8	-	23,6	24,0	2,5	2,3
		20		9,2	14,4	19,0	3,6	3,4
	CS	22		14,0	9,64	18,3	4,0	3,7
		24		18,8	4,82	17,7	4,4	4,1
30 / 22	MC	15,5	53,1	-	25,3	14,3	3,7	3,3
		20		10,8	14,4	13,2	4,8	4,3
	CS	22		15,7	9,64	12,7	5,4	4,8
		24		20,5	4,82	12,2	6,0	5,3
28 / 21	MC	15,5	45,3	-	25,3	10,1	4,5	3,9
		20		10,8	14,4	9,09	6,2	5,3
	CS	22		15,7	9,64	8,63	7,1	6,0
		24		20,5	4,82	8,17	8,1	6,8
25 / 19	MC	18,2	24,1	-	18,8	4,39	5,5	4,1
		20		4,3	14,4	4,08	7,0	5,0
	CS	22		9,2	9,64	3,73	8,9	6,3

SUPPLY HUMIDITY RATIO = 11 g/kg								
Performance in cooling and in dehumidification								
T_OA	SET	T_SA	P_F	P_R	P_D	P_A	EER_C	EER_S
40 / 25	MC	19,2	64,2	-	16,3	22,8	2,8	2,6
		20		1,9	14,4	22,4	3,0	2,8
	CS	22		6,8	9,64	21,5	3,3	3,1
		24		11,6	4,82	20,6	3,7	3,4
35 / 24	MC	17,8	58,4	-	19,7	17,7	3,3	3,0
		20		5,3	14,4	17,0	3,7	3,4
	CS	22		10,1	9,64	16,4	4,2	3,8
		24		14,9	4,82	15,7	4,7	4,3
32 / 23	MC	17,4	51,3	-	20,7	12,6	4,1	3,6
		20		6,3	14,4	12,0	4,8	4,2
	CS	22		11,1	9,64	11,5	5,4	4,8
		24		15,9	4,82	11,1	6,1	5,3
30 / 22	MC	17,4	43,0	-	20,7	8,19	5,3	4,4
		20		6,3	14,4	7,72	6,4	5,3
	CS	22		11,1	9,64	7,36	7,3	6,1
		24		15,9	4,82	7,00	8,4	6,9
28 / 21	MC	18,8	31,9	-	17,3	5,77	5,5	4,4
		20		2,9	14,4	5,52	6,3	4,9
	CS	22		7,7	9,64	5,09	7,8	6,0
		24		12,5	4,82	4,66	9,5	7,1
25 / 19	MC	20,2	15,5	-	13,9	2,45	6,3	3,9
	CS	22		4,3	9,64	2,19	9,1	5,3

SUPPLY HUMIDITY RATIO = 12 g/kg								
Performance in cooling and in dehumidification								
T_OA	SET	T_SA	P_F	P_R	P_D	P_A	EER_C	EER_S
45 / 28*	MC	19,9	82,9	-	14,7	28,9	2,9	2,7
		20		0,2	14,4	28,8	2,9	2,7
	CS	22		5,1	9,64	27,7	3,2	3,0
		24		9,9	4,82	26,6	3,5	3,2
45 / 26	MC	21,5	62,3	-	10,8	19,4	3,2	3,0
		22		1,2	9,64	19,1	3,3	3,1
	CS	24		6,0	4,82	17,9	3,8	3,5
40 / 25	MC	20,5	55,7	-	13,2	14,0	4,0	3,6
		22		3,6	9,64	13,5	4,4	3,9
	CS	24		8,4	4,82	12,7	5,1	4,5
35 / 24	MC	19,2	49,8	-	16,3	11,2	4,4	3,9
		20		1,9	14,4	11,0	4,7	4,1
	CS	22		6,8	9,64	10,5	5,4	4,7
		24		11,6	4,82	9,98	6,1	5,3
32 / 23	MC	19,2	41,4	-	16,3	7,48	5,5	4,6
		20		1,9	14,4	7,34	5,9	4,9
	CS	22		6,8	9,64	6,95	6,9	5,7
		24		11,6	4,82	6,56	8,1	6,5
30 / 22	MC	21,8	27,1	-	10,1	4,74	5,7	4,3
		22		0,5	9,64	4,68	5,9	4,4
	CS	24		5,3	4,82	4,05	8,0	5,8
28 / 21	MC	22,6	17,3	-	8,20	2,73	6,3	4,0
	CS	24		3,4	4,82	2,23	9,3	5,5

Seasonal energy performances				
T_SA	E_T	E_A	SE_C	SE_S
STOCKHOLM				
-	3.875	724	5,3	3,8
20	4.600	670	6,9	4,7
22	5.333	616	8,7	5,8
24	658	82	8,1	6,5
LONDON				
-	6.343	1.227	5,2	4,0
20	7.552	1.129	6,7	5,0
22	8.695	1.043	8,3	6,2
24	1.878	250	7,5	6,4
ROME				
-	55.474	11.381	4,9	3,9
20	66.712	10.423	6,4	5,0
22	75.449	9.727	7,8	6,0
24	34.983	4.664	7,5	6,4
VALENCIA				
-	71.459	16.008	4,5	3,7
20	85.933	14.531	5,9	4,8
22	96.049	13.677	7,0	5,7
24	58.447	8.593	6,8	5,9

SIZE 4 - AIR FLOW 7.200 m³/h (STANDARD) - HEATING

Performance in Heating								Seasonal energy performances					
T_OA	SET	T_SA	x_SA	P_T	P_D	P_A	COP_C	COP_S	T_SA	E_T	E_A	SE_C	SE_S
-20 / -21 *	MC	20,8	0,20	110,0	1,93	32,9	3,3	3,2	STOCKHOLM				
	CS	20		107,0	-	30,4	3,5	3,3	-	457.548	105.298	4,3	3,8
		18		102,0	-	24,5	4,2	3,8	22	326.756	52.645	6,2	4,9
	MC	25,8		107,0	13,9	36,4	2,9	2,8	20	292.225	42.693	6,8	5,2
-15 / -16 *	CS	22	0,50	96,8	4,82	24,8	3,9	3,6	18	238.675	31.372	7,6	5,6
		20		91,6	-	20,6	4,4	4,1	LONDON				
		18		86,3	-	16,4	5,3	4,7	-	359.432	71.461	5,0	4,4
	MC	28,9		106,0	21,4	38,5	2,8	2,6	22	233.686	33.167	7,0	5,4
-12 / -13 *	CS	22	0,80	87,6	4,82	20,2	4,3	3,9	20	202.132	26.865	7,5	5,5
		20		82,4	-	16,0	5,2	4,6	18	137.508	16.889	8,1	5,9
		18		77,3	-	12,8	6,0	5,2	ROME				
	MC	25,6		87,4	13,5	22,6	3,9	3,6	-	185.637	34.736	5,3	4,6
-7 / -8	CS	22	1,50	77,7	4,82	16,0	4,9	4,4	22	116.202	16.100	7,2	5,4
		20		72,3	-	13,4	5,4	4,8	20	98.822	13.004	7,6	5,4
		18		66,9	-	11,1	6,0	5,3	18	56.782	6.964	8,2	5,8
	MC	28,1		87,9	19,5	23,6	3,7	3,5	VALENCIA				
-5 / -6	CS	22	1,90	71,7	4,82	14,0	5,1	4,6	-	140.938	25.499	5,5	4,7
		20		66,5	-	11,6	5,7	5,1	22	86.250	11.893	7,3	5,3
		18		61,1	-	9,18	6,7	5,7	20	72.556	9.570	7,6	5,2
	MC	30		78,1	24,1	19,5	4,0	3,7	18	35.679	4.389	8,1	5,7
0 / -1	CS	22	3,10	57,3	4,82	9,02	6,4	5,4	TUNIS				
		20		52,1	-	7,33	7,1	5,9	-	108.551	18.551	5,9	4,7
		18		46,9	-	5,65	8,3	6,5	22	63.973	8.779	7,3	4,8
	MC	30		72,2	24,1	16,8	4,3	3,9	20	52.797	7.027	7,5	4,6
2 / 1	CS	22	3,70	51,7	4,82	7,67	6,7	5,6	18	18.040	2.262	8,0	5,1
		20		46,5	-	5,90	7,9	6,2					
		18		41,3	-	4,73	8,7	6,6					
	MC	30		58,2	24,1	11,2	5,2	4,6					
7 / 6	CS	22	5,40	37,9	4,82	4,93	7,7	5,8					
		20		32,9	-	4,22	7,8	5,7					
		18		27,8	-	3,49	8,0	5,5					
	MC	30		44,6	24,1	7,10	6,3	5,2					
12 / 11	CS	22	7,80	24,8	4,82	3,51	7,1	4,9					
		20		19,8	-	2,70	7,3	4,7					

Notes

* System with "Hydronic recovery device for extended operating range" option
T_OA = Dry bulb/wet bulb outdoor air temperature [°C]
SET = Operation mode: MC = Maximum Capacity, CS = Constant Supply, HA = High Air Flow
T_SA = Dry bulb supply air temperature [°C]
X_SA = Supply air humidity ratio [g/kg]
P_F = Overall cooling capacity of the system (kW)
P_T = Heating capacity of the system [kW]
P_R = Post-heating capacity [kW]
P_D = Additional capacity available to the space [kW]
P_A = Electricity absorbed by the thermodynamic circuit [kW]
EER_C = Thermodynamic efficiency of the system in cooling mode
EER_S = Overall efficiency of the system in cooling mode (thermodynamic circuit and fans)
COP_C = Thermodynamic efficiency of the system in heating mode

COP_S = Overall efficiency of the system in heating mode (thermodynamic circuit and fans)

E_T = Seasonal thermal/cooling energy supplied [kWh]

E_A = Overall seasonal electricity absorbed [kWh]

SE_C = Thermodynamic seasonal efficiency of the system

SE_S = Overall seasonal efficiency of the system (thermodynamic circuit and fans)

In heating mode, the performances are considered with maximum air temperature supply T_SA equal to 30°C

The performance refers to a standard ZEPHIR³ unit (not fitted with a 'Steam-powered humidification module' option)

Return air in cooling mode = 26°C DB

Return air in heating mode = 20°C / 12°C

Available static pressure: supply 150 Pa, return 100 Pa

Performance values do not include the effect of fan motor heat

Source: ASHRAE weather data (International weather for energy calculation)

SIZE 4 - AIR FLOW 9.200 m³/h (MAXIMUM) - COOLING

SUPPLY HUMIDITY RATIO = 11 g/kg								
Performance in cooling and in dehumidification								
T_OA	SET	T_SA	P_F	P_R	P_D	P_A	EER_C	EER_S
35 / 24	MC	18,3	73,3	-	23,7	24,8	3,0	2,7
	CS	20		5,2	18,4	24,0	3,3	3,0
		22		11,4	12,3	23,1	3,7	3,3
		24		17,6	6,16	22,1	4,1	3,7
32 / 23	MC	17,6	65,0	-	25,8	18,3	3,6	3,1
	CS	20		7,4	18,4	17,5	4,1	3,6
		22		13,6	12,3	16,8	4,7	4,1
		24		19,7	6,16	16,1	5,3	4,6
30 / 22	MC	17,5	54,6	-	26,1	11,6	4,7	3,9
	CS	20		7,7	18,4	10,9	5,7	4,7
		22		13,9	12,3	10,4	6,6	5,3
		24		20,0	6,16	9,89	7,5	6,1
28 / 21	MC	17,3	45,3	-	26,8	7,71	5,9	4,5
	CS	20		8,3	18,4	7,11	7,5	5,6
		22		14,5	12,3	6,67	9,0	6,6
		24		20,6	6,16	6,22	10,6	7,6
25 / 19	MC	20,8	16,4	-	16,0	2,32	7,1	3,5
	CS	22		3,7	12,3	2,12	9,5	4,4

Seasonal energy performances								
T_SA	E_T	E_A	SE_C	SE_S				
STOCKHOLM								
-	2.782	407	6,8	3,2				
20	536	71	7,5	5,3				
22	3.451	368	9,4	4,1				
24	659	62	10,6	7,1				
LONDON								
-	4.744	723	6,6	3,7				
20	1.546	221	7,0	5,4				
22	5.919	651	9,1	4,8				
24	1.891	195	9,7	7,2				
ROME								
-	45.691	7.416	6,2	3,9				
20	28.766	4.097	7,0	5,4				
22	57.935	6.600	8,8	5,3				
24	35.174	3.620	9,7	7,2				
VALENCIA								
-	62.561	11.172	5,6	3,8				
20	48.798	7.720	6,3	5,0				
22	79.185	9.970	7,9	5,3				
24	59.210	6.899	8,6	6,6				

SUPPLY HUMIDITY RATIO = 12 g/kg								
Performance in cooling and in dehumidification								
T_OA	SET	T_SA	P_F	P_R	P_D	P_A	EER_C	EER_S
40 / 25	MC	20,7	70,8	-	16,3	21,5	3,3	3,0
	CS	22		4,0	12,3	20,7	3,6	3,2
		24		10,2	6,16	19,5	4,2	3,7
35 / 24	MC	19,2	63,5	-	20,9	16,0	4,0	3,4
	CS	20		2,5	18,4	15,7	4,2	3,6
		22		8,6	12,3	15,0	4,8	4,1
		24		14,8	6,16	14,3	5,5	4,7
32 / 23	MC	19,1	53,3	-	21,2	10,5	5,1	4,1
	CS	20		2,8	18,4	10,2	5,5	4,4
		22		8,9	12,3	9,71	6,4	5,1
		24		15,1	6,16	9,18	7,5	5,9
30 / 22	MC	20,2	39,6	-	17,8	6,26	6,3	4,6
	CS	22		5,5	12,3	5,82	7,8	5,5
		24		11,7	6,16	5,35	9,6	6,6
28 / 21	MC	22,3	23,1	-	11,4	3,51	6,6	3,9
	CS	24		5,2	6,16	2,83	10,0	5,4

Seasonal energy performances								
T_SA	E_T	E_A	SE_C	SE_S				
STOCKHOLM								
-	231	35	6,6	3,5				
24	283	28	10,0	4,8				
LONDON								
-	727	114	6,4	4,0				
20	56	10	5,5	4,4				
22	198	27	7	5				
24	902	93	9,7	5,6				
ROME								
-	13.662	2.112	6,5	4,0				
20	336	61	5,5	4,4				
22	4.391	576	7,6	5,4				
24	17.020	1.734	9,8	5,7				
VALENCIA								
-	25.779	4.182	6,2	4,1				
20	3.763	729	5,2	4,2				
22	15.586	2.167	7,2	5,3				
24	32.478	3.503	9,3	5,8				

SUPPLY HUMIDITY RATIO = 13 g/kg								
Performance in cooling and in dehumidification								
T_OA	SET	T_SA	P_F	P_R	P_D	P_A	EER_C	EER_S
45 / 28 *	MC	20,4	101,0	-	17,2	35,5	2,8	2,6
	CS	22		4,9	12,3	34,3	3,1	2,8
		24		11,1	6,16	32,7	3,4	3,1
45 / 26	MC	24	65,6	-	6,16	15,2	4,3	3,7
	CS	24		0,0	6,16	13,9	4,7	4,0
40 / 25	MC	23,8	54,5	-	6,78	9,64	5,7	4,5
	CS	24		0,6	6,16	8,73	6,3	4,9
35 / 24	MC	20,8	51,5	-	16,0	9,23	5,6	4,4
	CS	22		3,7	12,3	8,86	6,2	4,9
		24		9,9	6,16	8,22	7,5	5,8
32 / 23	MC	22,6	36,0	-	10,4	5,54	6,5	4,5
	CS	24		4,3	6,16	4,86	8,3	5,5
30 / 22	MC	24,8	18,70	-	3,70	2,60	7,2	3,7
28 / 21	MC	23,3	17,10	-	8,32	2,33	7,3	3,6

Seasonal energy performances								
T_SA	E_T	E_A	SE_C	SE_S				
STOCKHOLM								
-	171	23	7,3	3,2				
LONDON								
-	503	69	7,3	3,7				
24	40	5	8,3	5,5				
ROME								
-	9.148	1.255	7,3	3,6				
24	242	29	8,3	5,5				
VALENCIA								
-	16.269	2.290	7,1	3,7				
22	662	106	6,2	4,9				
24	2.873	356	8,1	5,6				
TUNIS								
-	34.795	5.528	6,3	3,6				
22	9.114	1.653	5,5	4,3				
24	22.355	3.052	7,3	4,0				

SIZE 4 - AIR FLOW 9.200 m³/h (MAXIMUM) - COOLING

SUPPLY HUMIDITY RATIO = non controllata													
Performance in cooling and in dehumidification								Seasonal energy performances					
T_OA	SET	T_SA	x_SA	P_F	P_D	P_A	EER_C	EER_S	T_SA	E_T	E_A	SE_C	SE_S
45 / 28 *	HA	26	16,2	62,7	-	8,17	7,7	5,6	STOCKHOLM				
45 / 26	HA	26	13,4	56,9	-	10,1	5,6	4,5	-	4.626	762	6,1	3,8
40 / 25	HA	24	13,1	53,6	6,16	9,19	5,8	4,6	LONDON				
35 / 24	HA	22	13,4	45,1	12,3	6,97	6,5	4,8	-	7.313	1.202	6,1	4,1
32 / 23	HA	21	12,7	43,2	15,4	6,77	6,4	4,7	ROME				
30 / 22	HA	20	12,0	40,3	18,4	6,37	6,3	4,6	-	58.161	9.502	6,1	4,2
28 / 21	HA	19	11,4	36,6	21,5	5,88	6,2	4,4	VALENCIA				
25 / 19	HA	18	10,2	30,0	24,6	4,95	6,1	4,1	-	69.905	11.355	6,2	4,2
									TUNIS				
									-	95.300	15.355	6,2	4,0

SIZE 4 - AIR FLOW 9.200 m³/h (MAXIMUM) - HEATING

Performance in Heating								Seasonal energy performances					
T_OA	SET	T_SA	x_SA	P_T	P_D	P_A	COP_C	COP_S	T_SA	E_T	E_A	SE_C	SE_S
-15 / -16 *	MC	19,9	0,50	117,0	-	32,5	3,6	3,3	STOCKHOLM				
	CS	18		110,0	-	26,0	4,2	3,8	-	552.203	129.689	4,3	3,7
	HA	16		103,0	-	20,2	5,1	4,4	22	385.426	65.049	5,9	4,5
-12 / -13 *	MC	22,5	0,80	115,0	7,70	34,5	3,3	3,1	20	371.418	57.222	6,5	4,8
		22		113,0	6,16	32,8	3,4	3,1	18	328.858	45.141	7,3	5,0
	CS	20		106,0	-	25,6	4,1	3,7	16	268.219	33.008	8,1	5,4
	HA	18		97,5	-	20,4	4,8	4,2	LONDON				
-7 / -8	MC	16	1,50	87,8	-	15,8	5,6	4,7	-	453.128	98.757	4,6	4,0
		20,2		93,0	0,62	20,4	4,6	4,1	22	298.517	41.943	7,1	5,2
	CS	20		92,4	-	20,0	4,6	4,1	20	258.506	32.970	7,8	5,4
	HA	18		85,6	-	16,2	5,3	4,6	18	217.769	25.426	8,6	5,4
-5 / -6	MC	16	1,90	78,8	-	12,8	6,2	5,2	16	149.473	16.161	9,2	5,8
		22,3		92,8	7,09	21,2	4,4	3,9	ROME				
	CS	22		91,6	6,16	20,5	4,5	4,0	-	236.140	49.012	4,8	4,1
	HA	20		84,8	-	16,5	5,1	4,5	22	148.407	19.600	7,6	5,3
0 / -1	MC	18	1,90	78,1	-	13,2	5,9	5,0	20	126.386	15.385	8,2	5,3
		16		71,3	-	10,6	6,7	5,5	18	104.015	11.737	8,9	5,2
	CS	20		92,5	24,0	23,5	3,9	3,6	16	60.906	6.463	9,4	5,6
	HA	18		73,2	6,16	13,0	5,6	4,7	VALENCIA				
2 / 1	MC	16	3,10	66,6	-	10,2	6,5	5,3	-	179.630	36.040	5,0	4,2
		22		59,9	-	7,80	7,7	5,9	22	110.126	14.209	7,8	5,3
	CS	20		53,2	-	5,94	9,0	6,4	20	92.785	11.137	8,3	5,2
	HA	18		91,8	30,1	24,3	3,8	3,4	18	75.213	8.394	9,0	5,0
7 / 6	MC	16	3,70	59,5	-	8,20	7,3	5,6	16	38.038	4.026	9,4	5,5
		22		52,8	-	6,24	8,5	6,1	LONDON				
	CS	20		46,2	-	4,66	9,9	6,5	-	138.581	26.150	5,3	4,2
	HA	18		74,4	30,8	16,2	4,6	4,0	22	81.648	10.151	8,0	4,8
12 / 11	MC	16	5,40	48,5	6,16	5,88	8,2	5,8	20	67.503	7.942	8,5	4,6
		22		42,1	-	4,71	8,9	5,9	18	53.228	5.854	9,1	4,2
	CS	20		35,5	-	3,90	9,1	5,6	16	18.901	2.018	9,4	4,7
	HA	18		29,1	-	3,11	9,4	5,3	VALENCIA				

NNNotes

* System with "Hydronic recovery device for extended operating range" option

T_OA = Dry bulb/wet bulb outdoor air temperature [°C]

SET = Operation mode: MC = Maximum Capacity, CS = Constant Supply, HA = High Air Flow

T_SA = Dry bulb supply air temperature [°C]

X_SA = Supply air humidity ratio [g/kg]

P_F = Overall cooling capacity of the system (kW)

P_T = Heating capacity of the system [kW]

P_R = Post-heating capacity [kW]

P_D = Additional capacity available to the space [kW]

P_A = Electricity absorbed by the thermodynamic circuit [kW]

EER_C = Thermodynamic efficiency of the system in cooling mode

EER_S = Overall efficiency of the system in cooling mode (thermodynamic circuit and fans)

COP_C = Thermodynamic efficiency of the system in heating mode

COP_S = Overall efficiency of the system in heating mode (thermodynamic circuit and fans)

E_T = Seasonal thermal/heating energy supplied [kWh]

E_A = Overall seasonal electricity absorbed [kWh]

SE_C = Thermodynamic seasonal efficiency of the system

SE_S = Overall seasonal efficiency of the system (thermodynamic circuit and fans)

In heating mode, the performances are considered with maximum air

temperature supply T_SA equal to 30°C

The performance refers to a standard ZEPHIR³ unit (not fitted with a 'Steam-powered humidification module' option)

Return air in cooling mode = 26°C DB

Return air in heating mode = 20°C / 12°C

Available static pressure: supply 150 Pa, return 100 Pa

Performance values do not include the effect of fan motor heat

Source: ASHRAE weather data (International weather for energy calculation)

SIZE 5 - AIR FLOW 7.500 m³/h (MINIMUM) - COOLING

SUPPLY HUMIDITY RATIO = 9 g/kg								
Performance in cooling and in dehumidification								
T_OA	SET	T_SA	P_F	P_R	P_D	P_A	EER_C	EER_S
35 / 24	MC	13,6	83,2	-	31,1	34,2	2,4	2,3
	CS	20		16,1	15,0	31,9	3,1	3,0
	CS	22		21,1	10,0	31,2	3,3	3,2
	CS	24		26,1	5,02	30,5	3,6	3,4
32 / 23	MC	13,2	75,7	-	32,1	28,4	2,7	2,5
	CS	20		17,1	15,0	26,2	3,5	3,3
	CS	22		22,1	10,0	25,6	3,8	3,6
	CS	24		27,1	5,02	24,9	4,1	3,9
30 / 22	MC	12,8	68,6	-	33,1	23,2	3,0	2,8
	CS	20		18,1	15,0	21,0	4,1	3,9
	CS	22		23,1	10,0	20,4	4,5	4,2
	CS	24		28,1	5,02	19,8	4,9	4,5
28 / 21	MC	13,1	59,5	-	32,4	18,1	3,3	3,0
	CS	20		17,3	15,0	15,8	4,9	4,4
	CS	22		22,4	10,0	15,2	5,4	4,9
	CS	24		27,4	5,02	14,6	6,0	5,4
25 / 19	MC	15,5	37,8	-	26,3	10,1	3,7	3,3
	CS	20		11,3	15,0	8,89	5,5	4,7
	CS	22		16,3	10,0	8,34	6,5	5,5

SUPPLY HUMIDITY RATIO = 10 g/kg								
Performance in cooling and in dehumidification								
T_OA	SET	T_SA	P_F	P_R	P_D	P_A	EER_C	EER_S
40 / 25	MC	15,7	80,9	-	25,8	30,7	2,6	2,5
	CS	20		10,8	15,0	29,2	3,1	3,0
	CS	22		15,8	10,0	28,5	3,4	3,2
	CS	24		20,8	5,02	27,8	3,7	3,5
35 / 24	MC	15,3	73,2	-	26,8	24,8	3,0	2,8
	CS	20		11,8	15,0	23,3	3,6	3,4
	CS	22		16,8	10,0	22,7	4,0	3,7
	CS	24		21,8	5,02	22,1	4,3	4,0
32 / 23	MC	15,3	64,8	-	26,8	19,4	3,3	3,1
	CS	20		11,8	15,0	18,1	4,2	3,9
	CS	22		16,8	10,0	17,6	4,6	4,3
	CS	24		21,8	5,02	17,0	5,1	4,7
30 / 22	MC	15,7	55,3	-	25,8	16,2	3,4	3,1
	CS	20		10,8	15,0	14,9	4,4	4,0
	CS	22		15,8	10,0	14,4	4,9	4,5
	CS	24		20,8	5,02	13,8	5,5	5,0
28 / 21	MC	16,6	45,0	-	23,6	12,5	3,6	3,2
	CS	20		8,5	15,0	11,3	4,7	4,2
	CS	22		13,6	10,0	10,7	5,5	4,8
	CS	24		18,6	5,02	10,0	6,4	5,5
25 / 19	MC	17,1	28,0	-	22,3	5,62	5,0	3,9
	CS	20		7,3	15,0	5,08	6,9	5,4
	CS	22		12,3	10,0	4,71	8,6	6,5

Notes

* System with "Hydronic recovery device for extended operating range" option
T_OA = Dry bulb/wet bulb outdoor air temperature [°C]
SET = Operation mode: MC = Maximum Capacity, CS = Constant Supply, HA = High Air Flow
T_SA = Dry bulb supply air temperature [°C]
X_SA = Supply air humidity ratio [g/kg]
P_F = Overall cooling capacity of the system (kW)
P_T = Heating capacity of the system [kW]
P_R = Post-heating capacity [kW]
P_D = Additional capacity available to the space [kW]
P_A = Electricity absorbed by the thermodynamic circuit [kW]
EER_C = Thermodynamic efficiency of the system in cooling mode
EER_S = Overall efficiency of the system in cooling mode (thermodynamic circuit and fans)
COP_C = Thermodynamic efficiency of the system in heating mode

COP_S = Overall efficiency of the system in heating mode (thermodynamic circuit and fans)

E_T = Seasonal thermal/cooling energy supplied [kWh]

E_A = Overall seasonal electricity absorbed [kWh]

SE_C = Thermodynamic seasonal efficiency of the system

SE_S = Overall seasonal efficiency of the system (thermodynamic circuit and fans)

In heating mode, the performances are considered with maximum air temperature supply T_SA equal to 30°C

The performance refers to a standard ZEPHIR³ unit (not fitted with a 'Steam-powered humidification module' option)

Return air in cooling mode = 26°C DB

Return air in heating mode = 20°C / 12°C

Available static pressure: supply 150 Pa, return 100 Pa

Performance values do not include the effect of fan motor heat

Source: ASHRAE weather data (International weather for energy calculation)

Seasonal energy performances				
T_SA	E_T	E_A	SE_C	SE_S
STOCKHOLM				
-	5.963	1.615	3,7	3,1
20	7.741	1.420	5,4	4,5
22	8.504	1.336	6,4	5,3
24	869	146	6,0	5,3
LONDON				
-	9.610	2.643	3,6	3,2
20	12.459	2.326	5,4	4,6
22	13.649	2.195	6,2	5,3
24	2.478	435	5,7	5,2
ROME				
-	80.685	22.977	3,5	3,1
20	104.361	20.227	5,2	4,5
22	113.462	19.204	5,9	5,2
24	46.146	8.117	5,7	5,2
VALENCIA				
-	101.086	29.979	3,4	3,1
20	130.050	26.550	4,9	4,4
22	140.587	25.353	5,5	4,9
24	77.015	14.389	5,4	4,9

SUPPLY HUMIDITY RATIO = 11 g/kg

Performance in cooling and in dehumidification								Seasonal energy performances					
T_OA	SET	T_SA	P_F	P_R	P_D	P_A	EER_C	EER_S	T_SA	E_T	E_A	SE_C	SE_S
45 / 28 *	MC	16,2	104,0	-	24,6	38,3	2,7	2,6	STOCKHOLM				
		20		9,5	15,0	36,7	3,1	2,9	-	329	67	4,9	3,8
		22		14,6	10,0	35,9	3,3	3,1	20	352	65	5,4	4,2
		24		19,6	5,02	35,1	3,5	3,3	22	402	60	6,7	5,1
45 / 26	MC	18,1	78,6	-	19,8	27,2	2,9	2,7	24	452	54	8,3	6,2
		20		4,8	15,0	26,5	3,1	3,0	LONDON				
		22		9,8	10,0	25,8	3,4	3,2	-	964	208	4,6	3,9
		24		14,8	5,02	25,0	3,7	3,5	20	1.029	201	5,1	4,2
40 / 25	MC	17,5	70,7	-	21,3	21,4	3,3	3,1	22	1.169	186	6,3	5,1
		20		6,3	15,0	20,6	3,7	3,5	24	1.310	171	7,7	6,2
		22		11,3	10,0	20,0	4,1	3,8	ROME				
		24		16,3	5,02	19,4	4,5	4,2	-	17.946	3.902	4,6	3,8
35 / 24	MC	17,9	61,3	-	20,3	17,8	3,4	3,2	20	19.131	3.770	5,1	4,2
		20		5,3	15,0	17,1	3,9	3,6	22	21.742	3.489	6,2	5,1
		22		10,3	10,0	16,5	4,3	4,0	24	24.354	3.203	7,6	6,1
		24		15,3	5,02	15,9	4,8	4,4	VALENCIA				
32 / 23	MC	18,5	51,0	-	18,8	14,2	3,6	3,2	-	31.175	7.225	4,3	3,7
		20		3,8	15,0	13,7	4,0	3,6	20	33.201	6.988	4,8	4,0
		22		8,8	10,0	13,1	4,6	4,1	22	37.445	6.520	5,7	4,8
		24		13,8	5,02	12,5	5,2	4,6	24	41.689	6.040	6,9	5,7
30 / 22	MC	19,1	41,1	-	17,3	10,7	3,8	3,4	TUNIS				
		20		2,3	15,0	10,4	4,2	3,6	-	56.658	14.532	3,9	3,3
		22		7,3	10,0	9,81	4,9	4,3	20	60.622	14.033	4,3	3,7
		24		12,3	5,02	9,17	5,8	5,0	22	67.212	13.282	5,1	4,3
28 / 21	MC	19,1	32,9	-	17,3	6,74	4,9	4,0	24	73.801	12.513	5,9	4,9
		20		2,3	15,0	6,50	5,4	4,4					
		22		7,3	10,0	5,97	6,7	5,4					
		24		12,3	5,02	5,44	8,3	6,5					

SIZE 5 - AIR FLOW 7.500 m³/h (MINIMUM) - HEATING

Performance in Heating								Seasonal energy performances					
T_OA	SET	T_SA	x_SA	P_T	P_D	P_A	COP_C	COP_S	T_SA	E_T	E_A	SE_C	SE_S
-20 / -21 *	MC	26,3	0,20	129,0	15,8	43,0	3,0	2,9	STOCKHOLM				
		22		117,0	5,02	29,2	4,0	3,8	-	484.254	104.701	4,6	4,1
		20		112,0	-	24,5	4,6	4,3	22	340.306	55.133	6,2	5,0
		18		106,0	-	19,7	5,4	4,9	20	304.220	45.317	6,7	5,2
-15 / -16 *	MC	30	0,50	123,0	25,1	42,7	2,9	2,8	18	248.426	35.450	7,0	5,5
		22		101,0	5,02	20,6	4,9	4,5	LONDON				
		20		95,6	-	18,2	5,3	4,8	-	374.858	75.872	4,9	4,4
		18		90,0	-	15,8	5,7	5,1	22	243.351	36.298	6,7	5,3
-12 / -13 *	MC	30	0,80	113,0	25,1	35,0	3,2	3,1	20	210.292	27.621	7,6	5,7
		22		91,5	5,02	18,5	4,9	4,5	18	143.041	18.421	7,8	5,8
		20		86,0	-	16,1	5,3	4,8	ROME				
		18		80,5	-	13,6	5,9	5,2	-	193.329	38.776	5,0	4,4
-7 / -8	MC	30	1,50	103,0	25,1	27,2	3,8	3,6	22	120.961	17.259	7,0	5,4
		22		80,9	5,02	14,2	5,7	5,2	20	102.791	12.532	8,2	5,8
		20		75,3	-	11,9	6,3	5,6	18	59.056	7.269	8,1	5,9
		18		69,8	-	10,6	6,6	5,8	VALENCIA				
-5 / -6	MC	30	1,90	96,9	25,1	23,2	4,2	3,9	-	146.716	29.350	5,0	4,4
		22		74,8	5,02	12,4	6,0	5,4	22	89.738	12.423	7,2	5,4
		20		69,2	-	11,1	6,2	5,5	20	75.467	8.747	8,6	5,9
		18		63,6	-	9,76	6,5	5,6	18	37.105	4.470	8,3	6,0
0 / -1	MC	30	3,10	81,3	25,1	17,3	4,7	4,3	TUNIS				
		22		59,6	5,02	10,1	5,9	5,1	-	112.965	22.548	5,0	4,2
		20		54,3	-	8,71	6,2	5,3	22	66.504	8.706	7,6	5,2
		18		48,8	-	7,29	6,7	5,5	20	54.912	5.766	9,5	5,5
2 / 1	MC	30	3,70	75,3	25,1	14,8	5,1	4,6	18	18.754	2.117	8,9	5,7
		22		53,8	5,02	9,06	5,9	5,1					
		20		48,4	-	7,61	6,4	5,3					
		18		43,0	-	6,11	7,0	5,6					
7 / 6	MC	30	5,40	60,6	25,1	12,3	4,9	4,4					
		22		39,6	5,02	5,92	6,7	5,3					
		20		34,2	-	4,42	7,7	5,8					
		18		28,9	-	3,25	8,9	6,1					
12 / 11	MC	30	7,80	46,4	25,1	9,18	5,1	4,3					
		22		25,7	5,02	3,06	8,4	5,6					
		20		20,6	-	1,82	11,3	6,2					

SIZE 5 - AIR FLOW 9.500 m³/h (STANDARD) - COOLING

SUPPLY HUMIDITY RATIO = 10 g/kg								
Performance in cooling and in dehumidification								
T_OA	SET	T_SA	P_F	P_R	P_D	P_A	EER_C	EER_S
35 / 24	MC	15,6	91,3	-	33,0	33,2	2,8	2,6
	CS	20		14,0	19,0	31,3	3,4	3,1
	CS	22		20,4	12,7	30,4	3,7	3,4
	CS	24		26,7	6,36	29,5	4,0	3,7
32 / 23	MC	15,2	81,6	-	34,3	26,1	3,1	2,9
	CS	20		15,3	19,0	24,4	4,0	3,6
	CS	22		21,6	12,7	23,6	4,4	4,0
	CS	24		28,0	6,36	22,9	4,8	4,3
30 / 22	MC	15,4	70,9	-	33,7	19,0	3,7	3,3
	CS	20		14,6	19,0	17,5	4,9	4,3
	CS	22		21,0	12,7	16,9	5,4	4,8
	CS	24		27,4	6,3	16,2	6,1	5,3
28 / 21	MC	16,3	57,6	-	30,8	14,7	3,9	3,4
	CS	20		11,8	19,0	13,3	5,2	4,4
	CS	22		18,1	12,7	12,6	6,0	5,1
	CS	24		24,5	6,36	11,9	6,9	5,8
25 / 19	MC	17,3	34,4	-	27,6	6,57	5,2	3,9
	CS	20		8,6	19,0	5,96	7,2	5,2
	CS	22		15,0	12,7	5,51	9,0	6,3

Seasonal energy performances				
T_SA	E_T	E_A	SE_C	SE_S
STOCKHOLM				
-	5.461	1.080	5,1	3,6
20	6.798	979	6,9	4,8
22	7.765	908	8,5	5,8
24	821	119	6,9	5,6
LONDON				
-	8.866	1.809	4,9	3,7
20	11.003	1.642	6,7	5,0
22	12.511	1.528	8,2	6,0
24	2.375	357	6,6	5,6
ROME				
-	75.725	16.584	4,6	3,6
20	93.217	15.057	6,2	4,8
22	104.744	14.120	7,4	5,7
24	44.292	6.637	6,7	5,6
VALENCIA				
-	96.817	22.568	4,3	3,5
20	118.459	20.573	5,8	4,6
22	131.807	19.436	6,8	5,4
24	75.346	11.938	6,3	5,4

SUPPLY HUMIDITY RATIO = 11 g/kg								
Performance in cooling and in dehumidification								
T_OA	SET	T_SA	P_F	P_R	P_D	P_A	EER_C	EER_S
40 / 25	MC	18,2	86,9	-	24,8	27,9	3,1	2,9
	CS	20		5,7	19,0	27,1	3,4	3,1
	CS	22		12,1	12,7	26,2	3,8	3,5
	CS	24		18,4	6,36	25,3	4,2	3,8
35 / 24	MC	17,3	79,0	-	27,6	22,9	3,4	3,1
	CS	20		8,6	19,0	21,9	4,0	3,6
	CS	22		15,0	12,7	21,1	4,5	4,0
	CS	24		21,3	6,36	20,4	4,9	4,4
32 / 23	MC	17,6	66,9	-	26,7	17,3	3,9	3,4
	CS	20		7,6	19,0	16,5	4,5	4,0
	CS	22		14,0	12,7	15,9	5,1	4,4
	CS	24		20,4	6,36	15,2	5,7	5,0
30 / 22	MC	18,2	54,5	-	24,8	13,4	4,1	3,5
	CS	20		5,7	19,0	12,8	4,7	4,0
	CS	22		12,1	12,7	12,1	5,5	4,6
	CS	24		18,4	6,36	11,5	6,3	5,3
28 / 21	MC	19,1	41,3	-	21,9	8,96	4,6	3,6
	CS	20		2,9	19,0	8,64	5,1	4,0
	CS	22		9,2	12,7	7,93	6,4	4,9
	CS	24		15,6	6,36	7,23	7,9	5,9
25 / 19	MC	16,6	22,5	-	29,9	3,32	6,8	4,0
	CS	20		10,8	19,0	3,13	10,6	6,1

Seasonal energy performances				
T_SA	E_T	E_A	SE_C	SE_S
STOCKHOLM				
-	3.608	561	6,4	3,7
20	5.172	531	9,7	5,4
22	505	79	6,4	4,7
24	569	72	7,9	5,7
LONDON				
-	5.924	966	6,1	3,9
20	8.278	916	9,0	5,6
22	1.493	243	6,2	4,8
24	1.671	223	7,5	5,8
ROME				
-	51.874	9.394	5,5	3,8
20	67.620	8.954	7,6	5,1
22	27.885	4.543	6,1	4,8
24	31.193	4.187	7	6
VALENCIA				
-	68.240	13.464	5,1	3,7
20	85.256	12.851	6,6	4,8
22	48.888	8.336	5,9	4,7
24	54.264	7.770	7,0	5,6
TUNIS				
-	28.981	5.373	5,4	3,9
22	33.031	5.004	6,6	4,7
24	38.406	4.494	8,5	5,9

SUPPLY HUMIDITY RATIO = 12 g/kg								
Performance in cooling and in dehumidification								
T_OA	SET	T_SA	P_F	P_R	P_D	P_A	EER_C	EER_S
45 / 28*	MC	18,4	117,0	-	24,1	42,8	2,7	2,6
	CS	20		5,1	19,0	41,8	2,9	2,7
	CS	22		11,5	12,7	40,6	3,2	3,0
	CS	24		17,8	6,36	39,4	3,4	3,2
45 / 26	MC	20,4	85,1	-	17,8	25,4	3,4	3,1
	CS	22		5,1	12,7	24,5	3,7	3,4
	CS	24		11,5	6,36	23,3	4,1	3,8
40 / 25	MC	20,8	71,9	-	16,5	18,3	3,9	3,5
	CS	22		3,8	12,7	17,7	4,3	3,8
	CS	24		10,2	6,36	16,6	4,9	4,3
35 / 24	MC	20,2	62,8	-	18,4	15,6	4,0	3,5
	CS	22		5,7	12,7	14,8	4,6	4,0
	CS	24		12,1	6,36	13,9	5,4	4,6
32 / 23	MC	20,5	50,7	-	17,5	11,8	4,3	3,6
	CS	22		4,8	12,7	11,2	5,0	4,1
	CS	24		11,1	6,36	10,4	5,9	4,8
30 / 22	MC	20,7	39,5	-	16,8	7,88	5,0	3,9
	CS	22		4,1	12,7	7,44	5,9	4,5
	CS	24		10,5	6,36	6,74	7,4	5,5
28 / 21	MC	20,4	29,5	-	17,8	4,87	6,1	4,1
	CS	22		5,1	12,7	4,46	7,8	5,1
	CS	24		11,5	6,36	3,93	10,4	6,5

SIZE 5 - AIR FLOW 9.500 m³/h (STANDARD) - HEATING

Performance in Heating								Seasonal energy performances					
T_OA	SET	T_SA	x_SA	P_T	P_D	P_A	COP_C	COP_S	T_SA	E_T	E_A	SE_C	SE_S
-20 / -21 *	MC	20,3	0,20	143,0	0,95	38,9	3,7	3,4	STOCKHOLM				
	CS	18		134,0	-	30,0	4,5	4,1	-	600.841	131.370	4,6	4,0
-15 / -16 *	MC	25,2		139,0	16,5	42,8	3,2	3,0	22	431.378	69.428	6,2	4,9
	CS	22		128,0	6,36	30,7	4,2	3,8	20	385.607	56.949	6,8	5,1
		20		121,0	-	25,5	4,7	4,3	18	314.848	43.505	7,2	5,4
		18		114,0	-	20,3	5,6	4,9	LONDON				
-12 / -13 *	MC	28,1	0,80	137,0	25,7	45,3	3,0	2,8	-	473.725	94.322	5,0	4,3
	CS	22		116,0	6,36	25,1	4,6	4,2	22	308.293	45.411	6,8	5,1
		20		109,0	-	19,9	5,5	4,8	20	266.851	35.359	7,5	5,3
		18		102,0	-	17,2	5,9	5,1	18	181.449	22.827	7,9	5,6
-7 / -8	MC	25,2	1,50	114,0	16,5	26,7	4,3	3,9	ROME				
	CS	22		103,0	6,36	19,3	5,3	4,8	-	244.717	47.423	5,2	4,4
		20		95,4	-	16,4	5,8	5,1	22	153.241	21.808	7,0	5,1
		18		88,3	-	13,6	6,5	5,5	20	130.513	16.409	8,0	5,3
-5 / -6	MC	27,3	1,90	113,0	23,2	27,7	4,1	3,8	18	74.942	9.076	8,3	5,6
	CS	22		94,7	6,36	17,1	5,5	4,9	VALENCIA				
		20		87,6	-	14,2	6,2	5,3	-	185.759	35.625	5,2	4,4
		18		80,6	-	11,4	7,1	5,9	22	113.697	15.795	7,2	5,1
0 / -1	MC	30	3,10	103,0	31,8	23,6	4,4	4,0	20	95.848	11.628	8,2	5,3
	CS	22		75,6	6,36	11,8	6,4	5,3	18	47.094	5.592	8,4	5,6
		20		68,7	-	10,3	6,7	5,4	TUNIS				
		18		61,8	-	8,78	7,0	5,5	-	142.999	26.978	5,3	4,3
2 / 1	MC	30	3,70	95,4	31,8	20,6	4,6	4,2	22	84.275	11.218	7,5	4,8
	CS	22		68,2	6,36	10,8	6,3	5,2	20	69.776	7.914	8,8	4,9
		20		61,4	-	9,22	6,7	5,3	18	23.815	2.657	9,0	5,3
		18		54,5	-	7,64	7,1	5,4					
7 / 6	MC	30	5,40	76,8	31,8	14,4	5,3	4,6					
	CS	22		50,1	6,36	7,57	6,6	5,0					
		20		43,4	-	5,75	7,5	5,4					
		18		36,7	-	4,08	9,0	5,7					
12 / 11	MC	30	7,80	58,7	31,8	11,1	5,3	4,4					
	CS	22		32,6	6,36	3,97	8,2	5,1					
		20		26,2	-	2,63	10,0	5,2					

Notes

* System with "Hydronic recovery device for extended operating range" option
T_OA = Dry bulb/wet bulb outdoor air temperature [°C]
SET = Operation mode: MC = Maximum Capacity, CS = Constant Supply, HA = High Air Flow
T_SA = Dry bulb supply air temperature [°C]
X_SA = Supply air humidity ratio [g/kg]
P_F = Overall cooling capacity of the system (kW)
P_T = Heating capacity of the system [kW]
P_R = Post-heating capacity [kW]
P_D = Additional capacity available to the space [kW]
P_A = Electricity absorbed by the thermodynamic circuit [kW]
EER_C = Thermodynamic efficiency of the system in cooling mode
EER_S = Overall efficiency of the system in cooling mode (thermodynamic circuit and fans)
COP_C = Thermodynamic efficiency of the system in heating mode

COP_S = Overall efficiency of the system in heating mode (thermodynamic circuit and fans)

E_T = Seasonal thermal/cooling energy supplied [kWh]

E_A = Overall seasonal electricity absorbed [kWh]

SE_C = Thermodynamic seasonal efficiency of the system

SE_S = Overall seasonal efficiency of the system (thermodynamic circuit and fans)

In heating mode, the performances are considered with maximum air temperature supply T_SA equal to 30°C

The performance refers to a standard ZEPHIR³ unit (not fitted with a 'Steam-powered humidification module' option)

Return air in cooling mode = 26°C DB

Return air in heating mode = 20°C / 12°C

Available static pressure: supply 150 Pa, return 100 Pa

Performance values do not include the effect of fan motor heat

Source: ASHRAE weather data (International weather for energy calculation)

SIZE 5 - AIR FLOW 11.500 m³/h (MAXIMUM) - COOLING

SUPPLY HUMIDITY RATIO = 11 g/kg								
Performance in cooling and in dehumidification								
T_OA	SET	T_SA	P_F	P_R	P_D	P_A	EER_C	EER_S
35 / 24	MC	17,4	95,0	-	33,1	32,1	3,0	2,7
	CS	20		10,0	23,1	30,7	3,4	3,1
	CS	22		17,7	15,4	29,6	3,8	3,4
	CS	24		25,4	7,70	28,6	4,2	3,8
32 / 23	MC	17,4	81,7	-	33,1	22,6	3,6	3,1
	CS	20		10,0	23,1	21,5	4,3	3,7
	CS	22		17,7	15,4	20,7	4,8	4,1
	CS	24		25,4	7,70	19,9	5,4	4,6
30 / 22	MC	17,7	68,0	-	31,9	16,4	4,1	3,4
	CS	20		8,9	23,1	15,5	5,0	4,1
	CS	22		16,6	15,4	14,8	5,7	4,6
	CS	24		24,3	7,70	14,0	6,6	5,3
28 / 21	MC	18,5	52,0	-	28,8	11,4	4,6	3,5
	CS	20		5,8	23,1	10,8	5,3	4,0
	CS	22		13,5	15,4	10,0	6,5	4,9
	CS	24		21,2	7,70	9,21	7,9	5,8
25 / 19	MC	19,4	24,5	-	25,4	3,46	7,1	3,5
	CS	20		2,3	23,1	3,36	8,0	3,9
	CS	22		10,0	15,4	3,01	11,5	5,3

Seasonal energy performances				
T_SA	E_T	E_A	SE_C	SE_S
STOCKHOLM				
-	3.999	605	6,6	3,3
20	4.385	585	7,5	3,6
22	5.555	527	10,5	4,8
24	732	92	7,9	5,5
LONDON				
-	6.654	1.069	6,2	3,5
20	7.312	1.029	7,1	4,0
22	9.137	934	9,8	5,2
24	2.140	283	7,6	5,6
ROME				
-	60.296	10.911	5,5	3,5
20	66.584	10.440	6,4	4,0
22	80.539	9.580	8,4	5,1
24	39.954	5.280	7,6	5,6
VALENCIA				
-	80.777	16.075	5,0	3,5
20	89.607	15.331	5,8	4,0
22	105.764	14.238	7,4	4,9
24	69.028	9.794	7,0	5,4

SUPPLY HUMIDITY RATIO = 12 g/kg								
Performance in cooling and in dehumidification								
T_OA	SET	T_SA	P_F	P_R	P_D	P_A	EER_C	EER_S
40 / 25	MC	20,5	88,2	-	21,1	25,3	3,5	3,1
	CS	22		5,8	15,4	24,2	3,9	3,4
	CS	24		13,5	7,70	22,9	4,4	3,9
35 / 24	MC	19,3	79,3	-	25,8	19,6	4,0	3,4
	CS	20		2,7	23,1	19,2	4,3	3,6
	CS	22		10,4	15,4	18,3	4,9	4,1
	CS	24		18,1	7,70	17,4	5,6	4,7
32 / 23	MC	20	63,1	-	23,1	14,5	4,4	3,5
	CS	22		7,7	15,4	13,6	5,2	4,1
	CS	24		15,4	7,70	12,7	6,2	4,9
30 / 22	MC	20,9	47,1	-	19,6	9,44	5,0	3,6
	CS	22		4,2	15,4	8,94	5,7	4,1
	CS	24		11,9	7,70	7,81	7,6	5,2
28 / 21	MC	20,8	34,5	-	20,0	5,47	6,3	3,9
	CS	22		4,6	15,4	5,07	7,7	4,6
	CS	24		12,3	7,70	4,41	10,6	5,9

Seasonal energy performances				
T_SA	E_T	E_A	SE_C	SE_S
STOCKHOLM				
-	345	55	6,3	3,6
22	391	51	7,7	4,3
24	468	44	10,6	5,5
LONDON				
-	1.032	174	5,9	3,8
22	1.164	162	7,2	4,5
24	1.379	142	9,7	5,8
ROME				
-	19.233	3.252	5,9	3,8
22	21.620	3.032	7,1	4,5
24	25.625	2.646	9,7	5,8
VALENCIA				
-	34.394	6.275	5,5	3,7
20	984	230	4,3	3,6
22	38.433	5.874	6,5	4,4
24	44.941	5.182	8,7	5,5

SUPPLY HUMIDITY RATIO = 13 g/kg								
Performance in cooling and in dehumidification								
T_OA	SET	T_SA	P_F	P_R	P_D	P_A	EER_C	EER_S
45 / 28 *	MC	20,1	127,0	-	22,7	43,0	3,0	2,7
	CS	22		7,3	15,4	41,4	3,2	3,0
	CS	24		15,0	7,70	39,7	3,6	3,2
45 / 26	MC	23,2	84,2	-	10,8	20,7	4,1	3,5
	CS	24		3,1	7,70	19,1	4,6	3,9
40 / 25	MC	26	59,4	-	-	12,4	4,8	3,7
35 / 24	MC	22,8	57,6	-	12,3	12,3	4,7	3,7
	CS	24		4,6	7,70	11,0	5,7	4,3
32 / 23	MC	22,8	43,9	-	12,3	7,97	5,5	3,8
	CS	24		4,6	7,70	6,99	6,9	4,6
30 / 22	MC	23,1	30,0	-	11,2	4,25	7,1	3,9
	CS	24		3,5	7,70	3,63	9,2	4,7
28 / 21	MC	22,6	20,1	-	13,1	2,16	9,3	3,6

Seasonal energy performances				
T_SA	E_T	E_A	SE_C	SE_S
STOCKHOLM				
-	201	22	9,3	3,2
LONDON				
-	616	73	8,5	3,6
24	149	18	8,3	4,7
ROME				
-	11.476	1.344	8,5	3,6
24	3.270	365	9,0	4,7
VALENCIA				
-	21.201	2.784	7,6	3,7
24	11.785	1.421	8,3	4,7
TUNIS				
-	43.833	7.292	6,0	3,5
22	1.477	455	3,2	3,0
24	36.428	5.326	6,8	4,2

SIZE 5 - AIR FLOW 11.500 m³/h (MAXIMUM) - COOLING

SUPPLY HUMIDITY RATIO = non controllata													
Performance in cooling and in dehumidification								Seasonal energy performances					
T_OA	SET	T_SA	x_SA	P_F	P_D	P_A	EER_C	EER_S	T_SA	E_T	E_A	SE_C	SE_S
45 / 28 *	HA	26	15,7	82,0	-	14,7	5,6	4,4		STOCKHOLM			
45 / 26	HA	26	13,3	72,0	-	16,3	4,4	3,6	-	5.675	1.017	5,6	3,5
40 / 25	HA	24	12,7	69,0	7,70	15,6	4,4	3,6		LONDON			
35 / 24	HA	22	12,8	62,0	15,4	13,8	4,5	3,6	-	9.013	1.636	5,5	3,7
32 / 23	HA	21	12,3	57,5	19,2	12,6	4,6	3,6		ROME			
30 / 22	HA	20	11,7	52,8	23,1	11,4	4,6	3,6	-	72.646	13.665	5,3	3,6
28 / 21	HA	19	11,2	47,8	26,9	9,95	4,8	3,6		VALENCIA			
25/19	HA	18	10,3	36,6	30,8	6,46	5,7	3,7	-	88.200	17.056	5,2	3,6
										TUNIS			
									-	121.627	24.129	5,0	3,4

SIZE 5 - AIR FLOW 11.500 m³/h (MAXIMUM) - HEATING

Performance in Heating								Seasonal energy performances					
T_OA	SET	T_SA	x_SA	P_T	P_D	P_A	COP_C	COP_S	T_SA	E_T	E_A	SE_C	SE_S
-15 / -16 *	MC	19,4	0,50	149,0	-	39,5	3,8	3,4		STOCKHOLM			
	CS	18		138,0	-	29,0	4,8	4,2	-	701.329	155.698	4,5	3,8
	HA	16		129,0	-	23,4	5,5	4,7	22	406.594	63.054	6,4	4,7
-12 / -13 *	MC	22,1	0,80	146,0	8,09	42,0	3,5	3,2	20	429.279	62.135	6,9	4,9
	22			145,0	7,70	41,2	3,5	3,2	18	381.401	53.259	7,2	5,0
	CS	20		133,0	-	29,2	4,6	4,0	16	336.210	42.180	8,0	5,2
	18			124,0	-	23,6	5,3	4,5		LONDON			
	HA	16		116,0	-	18,1	6,4	5,2	-	570.794	118.065	4,8	4,1
-7 / -8	MC	19,7	1,50	120,0	-	24,8	4,8	4,2	22	360.603	51.151	7,0	5,0
	CS	18		107,0	-	17,5	6,1	5,1	20	322.797	42.278	7,6	5,0
	HA	16		98,4	-	14,5	6,8	5,5	18	219.811	27.463	8,0	5,3
-5 / -6	MC	21,7	1,90	119,0	6,55	25,7	4,6	4,1	16	186.745	20.596	9,1	5,4
	20			106,0	-	18,2	5,8	4,9		ROME			
	CS	18		97,6	-	15,1	6,5	5,3	-	296.578	59.034	5,0	4,2
	HA	16		89,1	-	12,0	7,4	5,8	22	184.216	25.306	7,3	4,9
0 / -1	MC	27	3,10	118,0	26,9	28,2	4,2	3,7	20	157.871	19.768	8,0	5,0
	22			91,5	7,70	14,7	6,2	5,0	18	90.800	10.983	8,3	5,3
	CS	20		83,2	-	11,7	7,1	5,5	16	76.057	7.971	9,5	5,4
	18			74,9	-	10,1	7,4	5,5		VALENCIA			
	HA	16		66,6	-	8,45	7,9	5,6	-	225.299	43.815	5,1	4,2
2 / 1	MC	29,2	3,70	118,0	35,4	29,4	4,0	3,6	22	137.520	18.480	7,4	4,9
	22			82,5	7,70	12,3	6,7	5,2	20	115.945	14.072	8,2	4,9
	CS	20		74,2	-	10,6	7,0	5,3	18	57.068	6.797	8,4	5,3
	18			65,9	-	8,86	7,4	5,3	16	47.489	4.850	9,8	5,3
	HA	16		57,8	-	7,18	8,1	5,4		TUNIS			
7 / 6	MC	30	5,40	92,8	38,5	18,2	5,1	4,3	-	173.396	32.323	5,4	4,2
	22			60,6	7,70	8,87	6,8	4,9	22	102.045	13.171	7,7	4,6
	CS	20		52,5	-	7,03	7,5	5,0	20	84.417	9.679	8,7	4,5
	18			44,5	-	5,06	8,8	5,2	18	28.875	3.292	8,8	4,9
	HA	16		36,3	-	3,40	10,7	5,3	16	23.579	2.219	10,6	4,8
12 / 11	MC	30	7,80	71,3	38,5	12,9	5,5	4,4					
	22			39,5	7,70	4,67	8,5	4,9					
	CS	20		31,7	-	3,22	9,8	4,7					

Notes

* System with "Hydronic recovery device for extended operating range" option
T_OA = Dry bulb/wet bulb outdoor air temperature [°C]
SET = Operation mode: MC = Maximum Capacity, CS = Constant Supply, HA = High Air Flow
T_SA = Dry bulb supply air temperature [°C]
X_SA = Supply air humidity ratio [g/kg]
P_F = Overall cooling capacity of the system (kW)
P_T = Heating capacity of the system [kW]
P_R = Post-heating capacity [kW]
P_D = Additional capacity available to the space [kW]
P_A = Electricity absorbed by the thermodynamic circuit [kW]
EER_C = Thermodynamic efficiency of the system in cooling mode
EER_S = Overall efficiency of the system in cooling mode (thermodynamic circuit and fans)
COP_C = Thermodynamic efficiency of the system in heating mode

COP_S = Overall efficiency of the system in heating mode (thermodynamic circuit and fans)

E_T = Seasonal thermal/cooling energy supplied [kWh]

E_A = Overall seasonal electricity absorbed [kWh]

SE_C = Thermodynamic seasonal efficiency of the system

SE_S = Overall seasonal efficiency of the system (thermodynamic circuit and fans)

In heating mode, the performances are considered with maximum air temperature supply T_SA equal to 30°C

The performance refers to a standard ZEPHIR³ unit (not fitted with a 'Steam-powered humidification module' option)

Return air in cooling mode = 26°C DB

Return air in heating mode = 20°C / 12°C

Available static pressure: supply 150 Pa, return 100 Pa

Performance values do not include the effect of fan motor heat

Source: ASHRAE weather data (International weather for energy calculation)

SIZE 6 - AIR FLOW 9.500 m³/h (MINIMUM) - COOLING

SUPPLY HUMIDITY RATIO = 9 g/kg								
Performance in cooling and in dehumidification								
T_OA	SET	T_SA	P_F	P_R	P_D	P_A	EER_C	EER_S
35 / 24	MC	14,6	102,0	-	36,3	36,9	2,8	2,6
	CS	20		17,2	19,1	34,6	3,4	3,3
	CS	22		23,5	12,7	33,7	3,7	3,5
	CS	24		29,9	6,36	32,9	4,0	3,8
32 / 23	MC	14,1	92,5	-	37,9	30,7	3,0	2,8
	CS	20		18,8	19,1	28,5	3,9	3,6
	CS	22		25,1	12,7	27,7	4,2	4,0
	CS	24		31,5	6,36	27,0	4,6	4,3
30 / 22	MC	13,9	82,8	-	38,5	24,4	3,4	3,1
	CS	20		19,4	19,1	22,2	4,6	4,2
	CS	22		25,8	12,7	21,5	5,0	4,6
	CS	24		32,1	6,36	20,8	5,5	5,0
28 / 21	MC	14,9	69,4	-	35,3	19,3	3,6	3,3
	CS	20		16,2	19,1	17,2	5,0	4,5
	CS	22		22,6	12,7	16,4	5,6	5,0
	CS	24		28,9	6,36	15,6	6,3	5,6
25 / 19	MC	15,5	48,0	-	33,7	13,2	3,6	3,2
	CS	20		14,6	19,1	11,6	5,4	4,6
	CS	22		21,0	12,7	10,9	6,3	5,3

SUPPLY HUMIDITY RATIO = 10 g/kg								
Performance in cooling and in dehumidification								
T_OA	SET	T_SA	P_F	P_R	P_D	P_A	EER_C	EER_S
45 / 28 *	MC	17,6	135,0	-	29,6	56,2	2,4	2,3
	CS	20		10,5	19,1	54,1	2,7	2,6
	CS	22		16,9	12,7	52,8	2,9	2,7
	CS	24		23,2	6,36	51,5	3,1	2,9
40 / 25	MC	17,7	95,5	-	26,4	30,4	3,1	2,9
	CS	20		7,3	19,1	29,4	3,5	3,3
	CS	22		13,7	12,7	28,5	3,8	3,6
	CS	24		20,0	6,36	27,6	4,2	3,9
35 / 24	MC	16,6	89,4	-	31,2	27,1	3,3	3,1
	CS	20		12,1	19,1	25,7	3,9	3,7
	CS	22		18,4	12,7	24,9	4,3	4,0
	CS	24		24,8	6,36	24,1	4,7	4,4
32 / 23	MC	16,3	78,4	-	30,9	21,6	3,6	3,3
	CS	20		11,8	19,1	20,3	4,4	4,0
	CS	22		18,1	12,7	19,6	4,9	4,5
	CS	24		24,5	6,36	18,9	5,4	4,9
30 / 22	MC	17	66,0	-	28,6	18,1	3,6	3,3
	CS	20		9,5	19,1	16,9	4,5	4,0
	CS	22		15,9	12,7	16,2	5,1	4,5
	CS	24		22,3	6,36	15,4	5,7	5,1
28 / 21	MC	18,1	52,1	-	25,1	14,0	3,7	3,3
	CS	20		6,0	19,1	13,1	4,4	3,8
	CS	22		12,4	12,7	12,2	5,3	4,5
	CS	24		18,8	6,36	11,3	6,3	5,3
25 / 19	MC	18,7	30,2	-	23,2	6,22	4,9	3,7
	CS	20		4,1	19,1	5,87	5,8	4,3
	CS	22		10,5	12,7	5,33	7,6	5,5

Notes

* System with "Hydronic recovery device for extended operating range" option

T_OA = Dry bulb/wet bulb outdoor air temperature [°C]

SET = Operation mode: MC = Maximum Capacity, CS = Constant Supply, HA = High Air Flow

T_SA = Dry bulb supply air temperature [°C]

X_SA = Supply air humidity ratio [g/kg]

P_F = Overall cooling capacity of the system (kW)

P_T = Heating capacity of the system [kW]

P_R = Post-heating capacity [kW]

P_D = Additional capacity available to the space [kW]

P_A = Electricity absorbed by the thermodynamic circuit [kW]

EER_C = Thermodynamic efficiency of the system in cooling mode

EER_S = Overall efficiency of the system in cooling mode (thermodynamic circuit and fans)

COP_C = Thermodynamic efficiency of the system in heating mode

COP_S = Overall efficiency of the system in heating mode (thermodynamic circuit and fans)

E_T = Seasonal thermal/cooling energy supplied [kWh]

E_A = Overall seasonal electricity absorbed [kWh]

SE_C = Thermodynamic seasonal efficiency of the system

SE_S = Overall seasonal efficiency of the system (thermodynamic circuit and fans)

In heating mode, the performances are considered with maximum air temperature supply T_SA equal to 30°C

The performance refers to a standard ZEPHIR³ unit (not fitted with a 'Steam-powered humidification module' option)

Return air in cooling mode = 26°C DB

Return air in heating mode = 20°C / 12°C

Available static pressure: supply 150 Pa, return 100 Pa

Performance values do not include the effect of fan motor heat

Source: ASHRAE weather data (International weather for energy calculation)

Seasonal energy performances				
T_SA	E_T	E_A	SE_C	SE_S
STOCKHOLM				
-	7.510	2.067	3,6	3,1
20	9.750	1.819	5,4	4,4
22	10.717	1.712	6,3	5,1
24	983	156	6,3	5,4
LONDON				
-	12.039	3.326	3,6	3,2
20	15.563	2.932	5,3	4,6
22	17.071	2.764	6,2	5,3
24	2.829	464	6,1	5,4
ROME				
-	99.435	27.613	3,6	3,2
20	127.074	24.444	5,2	4,5
22	138.602	23.133	6,0	5,2
24	52.770	8.643	6,1	5,4
VALENCIA				
-	123.793	34.954	3,5	3,2
20	156.786	31.142	5,0	4,4
22	170.133	29.613	5,7	5,0
24	89.059	15.309	5,8	5,2

SUPPLY HUMIDITY RATIO = 11 g/kg

Performance in cooling and in dehumidification								Seasonal energy performances					
T_OA	SET	T_SA	P_F	P_R	P_D	P_A	EER_C	EER_S	T_SA	E_T	E_A	SE_C	SE_S
45 / 28 *	MC	17,6	127,0	-	26,7	42,9	3,0	2,8	STOCKHOLM				
		20		7,63	19,1	41,6	3,2	3,1	-	360	85	4,2	3,3
	CS	22		14,0	12,7	40,5	3,5	3,3	22	398	79	5,0	3,8
		24		20,4	6,36	39,3	3,7	3,5	24	462	69	6,7	4,9
45 / 26	MC	20,4	92,1	-	17,8	26,5	3,5	3,2	LONDON				
		22		5,09	12,7	25,5	3,8	3,5	-	1.070	258	4,1	3,4
	CS	24		11,5	6,36	24,3	4,3	3,9	20	62	16	3,9	3,4
40 / 25	MC	19,8	82,2	-	19,7	22,3	3,7	3,4	22	1.185	240	4,9	4,0
		20		0,64	19,1	22,1	3,7	3,4	24	1.363	211	6,4	5,1
	CS	22		7,00	12,7	21,1	4,2	3,9	ROME				
		24		13,4	6,36	20,1	4,8	4,3	-	19.964	4.835	4,1	3,4
35 / 24	MC	19,2	73,0	-	21,6	19,7	3,7	3,4	20	372	96	3,9	3,4
		20		2,54	19,1	19,4	3,9	3,5	22	22.113	4.498	4,9	4,0
	CS	22		8,91	12,7	18,5	4,4	4,0	24	25.421	3.966	6,4	5,1
		24		15,3	6,36	17,6	5,0	4,5	VALENCIA				
32 / 23	MC	19,6	60,8	-	20,4	16,2	3,8	3,3	-	35.290	8.768	4,0	3,4
		20		1,27	19,1	16,0	3,9	3,4	20	4.196	1.081	3,9	3,5
	CS	22		7,63	12,7	15,1	4,5	4,0	22	39.182	8171	4,8	4,0
		24		14,0	6,36	14,2	5,3	4,6	24	44.557	7.317	6,1	4,9
30 / 22	MC	20,3	48,3	-	18,1	12,6	3,8	3,3	TUNIS				
		22		5,41	12,7	11,8	4,6	3,9	-	65.683	17.005	3,9	3,2
	CS	24		11,8	6,36	10,8	5,6	4,7	20	31.251	8.131	3,8	3,4
28 / 21	MC	20,8	36,0	-	16,5	8,51	4,2	3,4	22	73.242	15.884	4,6	3,8
	CS	22		3,82	12,7	7,90	5,0	4,0	24	81.588	14.598	5,6	4,6
		24		10,2	6,36	6,87	6,7	5,2					

SIZE 6 - AIR FLOW 9.500 m³/h (MINIMUM) - HEATING

Performance in Heating								Seasonal energy performances					
T_OA	SET	T_SA	x_SA	P_T	P_D	P_A	COP_C	COP_S	T_SA	E_T	E_A	SE_C	SE_S
-20 / -21 *	MC	25,3	0,2	159,0	16,9	50,3	3,2	3,0	STOCKHOLM				
		22		148,0	6,36	36,9	4,0	3,8	-	612.940	138.686	4,4	3,9
	CS	20		141,0	-	31,4	4,5	4,2	22	431.216	77.050	5,6	4,6
		18		134,0	-	25,7	5,2	4,8	20	385.374	65.264	5,9	4,7
-15 / -16 *	MC	30	0,5	155,0	31,8	54,7	2,8	2,7	LONDON				
		22		128,0	6,36	27,1	4,7	4,3	-	475.036	102.017	4,7	4,1
	CS	20		121,0	-	23,4	5,2	4,7	22	308.042	53.855	5,7	4,6
		18		114,0	-	20,7	5,5	4,9	20	266.517	43.442	6,1	4,8
-12 / -13 *	MC	30	0,8	143,0	31,8	44,5	3,2	3,0	18	226.038	32.047	7,1	5,1
		22		116,0	6,36	24,0	4,8	4,4	ROME				
	CS	20		109,0	-	21,3	5,1	4,6	-	244.993	52.520	4,7	4,1
		18		102,0	-	18,5	5,5	4,9	22	153.105	26.243	5,8	4,6
-7 / -8	MC	29,2	1,5	128,0	29,3	33,9	3,8	3,6	20	130.343	20.492	6,4	4,7
		22		103,0	6,36	18,9	5,4	4,9	18	108.256	14.232	7,6	5,1
	CS	20		95,4	-	15,7	6,1	5,4	VALENCIA				
		18		88,3	-	14,0	6,3	5,5	-	185.925	39.973	4,7	4,1
-5 / -6	MC	30	1,9	123,0	31,8	31,0	4,0	3,7	22	113.602	19.116	5,9	4,6
		22		94,7	6,36	16,2	5,8	5,2	20	95.735	14.595	6,6	4,8
	CS	20		87,7	-	14,5	6,0	5,3	18	78.453	9.751	8,0	5,1
		18		80,6	-	13,1	6,2	5,3	TUNIS				
0 / -1	MC	30	3,1	103,0	31,8	22,7	4,5	4,2	-	143.158	30.985	4,6	3,9
		22		75,6	6,36	13,6	5,6	4,8	22	84.211	13.692	6,2	4,4
	CS	20		68,7	-	12,0	5,7	4,9	20	69.712	10.014	7,0	4,5
		18		61,9	-	10,5	5,9	4,9	18	55.754	6.171	9,0	4,8
2 / 1	MC	30	3,7	95,4	31,8	19,8	4,8	4,4					
		22		68,2	6,36	12,5	5,5	4,7					
	CS	20		61,3	-	10,9	5,6	4,7					
		18		54,5	-	9,2	5,9	4,8					
7 / 6	MC	30	5,4	76,8	31,8	16,2	4,7	4,2					
		22		50,0	6,36	9,2	5,4	4,4					
	CS	20		43,3	-	7,5	5,8	4,6					
		18		36,7	-	5,2	7,0	5,1					
12 / 11	MC	30	7,8	58,8	31,8	12,9	4,6	3,9					
		22		32,6	6,36	4,86	6,7	4,7					
	CS	20		26,2	-	3,26	8,0	5,0					
		18		20,1	-	1,75	11,5	5,3					

SIZE 6 - AIR FLOW 12.000 m³/h (STANDARD) - COOLING

SUPPLY HUMIDITY RATIO = 10 g/kg								
Performance in cooling and in dehumidification								
T_OA	SET	T_SA	P_F	P_R	P_D	P_A	EER_C	EER_S
35 / 24	MC	16,6	112,0	-	37,7	38,4	2,9	2,7
	CS	20		13,7	24,1	36,5	3,4	3,2
	CS	22		21,7	16,0	35,4	3,8	3,5
	CS	24		29,7	8,04	34,3	4,1	3,8
32 / 23	MC	16,1	99,8	-	39,7	30,5	3,3	3,0
	CS	20		15,7	24,1	28,7	4,0	3,6
	CS	22		23,7	16,0	27,7	4,5	4,0
	CS	24		31,7	8,04	26,8	4,9	4,4
30 / 22	MC	15,8	87,6	-	40,9	22,6	3,9	3,4
	CS	20		16,9	24,1	21,0	5,0	4,3
	CS	22		24,9	16,0	20,2	5,6	4,8
	CS	24		32,9	8,04	19,4	6,2	5,3
28 / 21	MC	17	69,7	-	36,1	17,4	4,0	3,4
	CS	20		12,1	24,1	15,9	5,1	4,3
	CS	22		20,1	16,0	15,0	6,0	4,9
	CS	24		28,1	8,04	14,0	7,0	5,7
25 / 19	MC	18,8	37,9	-	28,9	8,10	4,7	3,4
	CS	20		4,8	24,1	7,66	5,6	3,9
	CS	22		12,9	16,0	6,96	7,3	5,0

Seasonal energy performances				
T_SA	E_T	E_A	SE_C	SE_S
STOCKHOLM				
-	6.079	1.324	4,6	3,2
20	6.884	1.247	5,5	3,8
22	8.105	1.138	7,1	4,7
24	978	140	7,0	5,5
LONDON				
-	9.957	2.209	4,5	3,4
20	11.320	2.074	5,5	4,0
22	13.224	1.903	6,9	5,0
24	2.841	421	6,7	5,6
ROME				
-	86.985	20.055	4,3	3,4
20	99.933	18.695	5,3	4,1
22	114.494	17.331	6,6	5,0
24	53.094	7.837	6,8	5,6
VALENCIA				
-	113.017	27.114	4,2	3,3
20	130.675	25.249	5,2	4,1
22	147.534	23.629	6,2	4,9
24	90.725	14.118	6,4	5,4

SUPPLY HUMIDITY RATIO = 11 g/kg								
Performance in cooling and in dehumidification								
T_OA	SET	T_SA	P_F	P_R	P_D	P_A	EER_C	EER_S
40 / 25	MC	19,7	104,0	-	25,3	30,9	3,4	3,1
	CS	20		1,2	24,1	30,7	3,4	3,1
	CS	22		9,2	16,0	29,3	3,9	3,5
	CS	24		17,3	8,04	27,9	4,3	3,9
35 / 24	MC	18,3	95,9	-	30,9	26,1	3,7	3,3
	CS	20		6,8	24,1	25,2	4,1	3,6
	CS	22		14,9	16,0	24,2	4,6	4,0
	CS	24		22,9	8,04	23,2	5,1	4,5
32 / 23	MC	18,5	81,0	-	30,1	20,1	4,0	3,5
	CS	20		6,0	24,1	19,4	4,5	3,9
	CS	22		14,1	16,0	18,5	5,1	4,4
	CS	24		22,1	8,04	17,6	5,9	5,0
30 / 22	MC	19,5	64,1	-	26,1	15,4	4,2	3,5
	CS	20		2,0	24,1	15,2	4,3	3,6
	CS	22		10,0	16,07	14,2	5,2	4,3
	CS	24		18,1	8,04	13,2	6,2	5,0
28 / 21	MC	20,2	47,9	-	23,3	10,9	4,4	3,4
	CS	22		7,2	16,0	9,91	5,6	4,2
	CS	24		15,3	8,04	8,81	7,2	5,3
25 / 19	MC	20,4	21,7	-	22,5	3,04	7,1	3,5
	CS	22		6,4	16,0	2,74	10,3	4,8

Seasonal energy performances				
T_SA	E_T	E_A	SE_C	SE_S
STOCKHOLM				
-	3.560	541	6,6	3,2
22	4.546	488	9,3	4,2
24	632	88	7,2	5,0
LONDON				
-	5.958	963	6,2	3,5
20	285	65	4,4	3,7
22	7.520	872	8,6	4,6
24	1.866	269	6,9	5,2
ROME				
-	54.585	10.051	5,4	3,5
20	6.406	1.469	4,4	3,6
22	66.943	9.127	7,3	4,5
24	34.779	5.025	6,9	5,2
VALENCIA				
-	74.095	14.828	5,0	3,4
20	22.571	5.176	4,4	3,6
22	89.426	13.519	6,6	4,4
24	60.971	9.194	6,6	5,1

SUPPLY HUMIDITY RATIO = 12 g/kg								
Performance in cooling and in dehumidification								
T_OA	SET	T_SA	P_F	P_R	P_D	P_A	EER_C	EER_S
45 / 28*	MC	19,3	145,0	-	26,9	50,3	2,9	2,7
	CS	20		2,8	24,1	49,7	3,0	2,8
	CS	22		10,8	16,0	48,0	3,2	3,0
	CS	24		18,9	8,04	46,3	3,5	3,3
45 / 26	MC	22,3	100,0	-	14,8	26,5	3,8	3,4
	CS	24		6,8	8,04	24,4	4,4	3,9
40 / 25	MC	22,6	84,2	-	13,6	20,4	4,1	3,6
	CS	24		5,6	8,04	18,4	4,9	4,2
35 / 24	MC	21,8	73,1	-	16,8	17,5	4,2	3,5
	CS	24		8,8	8,04	15,6	5,3	4,4
32 / 23	MC	22,3	57,2	-	14,8	13,2	4,3	3,5
	CS	24		6,8	8,04	11,6	5,5	4,3
30 / 22	MC	22,9	41,3	-	12,4	8,57	4,8	3,5
	CS	24		4,4	8,04	7,32	6,2	4,4
28 / 21	MC	22,2	30,4	-	15,2	5,01	6,1	3,7
	CS	24		7,2	8,04	4,04	9,3	5,2

SIZE 6 - AIR FLOW 12.000 m³/h (STANDARD) - HEATING

Performance in Heating								Seasonal energy performances					
T_OA	SET	T_SA	x_SA	P_T	P_D	P_A	COP_C	COP_S	T_SA	E_T	E_A	SE_C	SE_S
-20 / -21 *	MC	19,3	0,20	175,0	-	45,4	3,9	3,6	STOCKHOLM	752.942	166.233	4,5	3,9
	CS	18		169,0	-	38,8	4,4	4,0					
-15 / -16 *	MC	24	0,50	170,0	16,07	49,9	3,4	3,2				5,8	4,6
		22		161,0	8,04	39,3	4,1	3,7					
		20		152,0	-	33,1	4,6	4,1				6,3	4,7
		18		144,0	-	27,1	5,3	4,7					
-12 / -13 *	MC	26,7	0,80	167,0	26,9	52,5	3,2	3,0	LONDON	598.237	122.128	4,9	4,2
		22		146,0	8,04	33,0	4,4	4,0					
		20		138,0	-	26,8	5,1	4,5				6,1	4,7
		18		129,0	-	22,5	5,7	4,9					
-7 / -8	MC	23,8	1,50	138,0	15,2	31,0	4,5	4,0	ROME	309.325	61.752	5,0	4,3
		22		130,0	8,04	25,8	5,0	4,5					
		20		121,0	-	21,4	5,7	4,9				6,2	4,6
		18		112,0	-	18,0	6,2	5,3					
-5 / -6	MC	26	1,90	137,0	24,1	32,2	4,3	3,9	VALENCIA	234.857	46.605	5,0	4,2
		22		119,0	8,04	22,0	5,4	4,7					
		20		111,0	-	18,5	6,0	5,1				6,6	4,7
		18		102,0	-	14,9	6,8	5,6					
0 / -1	MC	30	3,10	130,0	40,1	31,1	4,2	3,8	TUNIS	135.531	18.044	7,5	4,7
		22		95,4	8,04	15,3	6,2	5,2					
		20		86,7	-	13,6	6,4	5,2				7,8	4,6
		18		78,0	-	11,9	6,6	5,2					
2 / 1	MC	30	3,70	121,0	40,1	26,5	4,6	4,1	TUNIS	180.805	35.547	5,1	4,1
		22		86,1	8,04	14,1	6,1	5,0				6,3	4,2
		20		77,4	-	12,3	6,3	5,0				7,2	4,2
		18		68,9	-	10,6	6,5	5,0					
7 / 6	MC	30	5,40	96,9	40,18	18,3	5,3	4,5	TUNIS	106.431	16.896	6,3	4,2
		22		63,2	8,04	10,7	5,9	4,6				7,2	4,2
		20		54,9	-	8,77	6,3	4,6				7,8	4,6
		18		46,3	-	6,80	6,8	4,6					
12 / 11	MC	30	7,80	74,3	40,1	14,9	5,0	4,1	TUNIS	88.037	12.233	8,5	4,1
		22		41,2	8,04	6,27	6,6	4,4				8,5	4,1
		20		33,0	-	4,12	8,0	4,5				8,5	4,1
		18		24,7	-	2,38	10,4	4,4					

Notes

* System with "Hydronic recovery device for extended operating range" option

T_OA = Dry bulb/wet bulb outdoor air temperature [°C]

SET = Operation mode: MC = Maximum Capacity, CS = Constant Supply, HA = High Air Flow

T_SA = Dry bulb supply air temperature [°C]

X_SA = Supply air humidity ratio [g/kg]

P_F = Overall cooling capacity of the system (kW)

P_T = Heating capacity of the system [kW]

P_R = Post-heating capacity [kW]

P_D = Additional capacity available to the space [kW]

P_A = Electricity absorbed by the thermodynamic circuit [kW]

EER_C = Thermodynamic efficiency of the system in cooling mode

EER_S = Overall efficiency of the system in cooling mode (thermodynamic circuit and fans)

COP_C = Thermodynamic efficiency of the system in heating mode

COP_S = Overall efficiency of the system in heating mode (thermodynamic circuit and fans)

E_T = Seasonal thermal/cooling energy supplied [kWh]

E_A = Overall seasonal electricity absorbed [kWh]

SE_C = Thermodynamic seasonal efficiency of the system

SE_S = Overall seasonal efficiency of the system (thermodynamic circuit and fans)

In heating mode, the performances are considered with maximum air

temperature supply T_SA equal to 30°C

The performance refers to a standard ZEPHIR³ unit (not fitted with a 'Steam-powered humidification module' option)

Return air in cooling mode = 26°C DB

Return air in heating mode = 20°C / 12°C

Available static pressure: supply 150 Pa, return 100 Pa

Performance values do not include the effect of fan motor heat

Source: ASHRAE weather data (International weather for energy calculation)

SIZE 6 - AIR FLOW 14.000 m³/h (MAXIMUM) - COOLING

SUPPLY HUMIDITY RATIO = 11 g/kg								
Performance in cooling and in dehumidification								
T_OA	SET	T_SA	P_F	P_R	P_D	P_A	EER_C	EER_S
35 / 24	MC	18,5	111,0	-	35,2	31,9	3,5	3,1
	CS	20		7,03	28,1	31,0	3,8	3,3
	CS	22		16,4	18,8	29,7	4,3	3,7
	CS	24		25,8	9,38	28,5	4,8	4,2
32 / 23	MC	18	96,8	-	37,5	23,5	4,1	3,5
	CS	20		9,38	28,1	22,6	4,7	3,9
	CS	22		18,8	18,8	21,6	5,3	4,4
	CS	24		28,1	9,38	20,6	6,1	5,0
30 / 22	MC	18,8	77,8	-	33,8	17,7	4,4	3,5
	CS	20		5,63	28,1	17,1	4,9	3,9
	CS	22		15,0	18,8	16,1	5,8	4,5
	CS	24		24,4	9,38	15,1	6,8	5,2
28 / 21	MC	19,6	58,6	-	30,0	12,8	4,6	3,4
	CS	20		1,88	28,1	12,5	4,8	3,6
	CS	22		11,3	18,8	11,4	6,1	4,4
	CS	24		20,6	9,38	10,3	7,7	5,4
25 / 19	MC	20,6	24,6	-	25,3	3,46	7,1	3,1
	CS	22		6,56	18,8	3,13	10,0	4,1

Seasonal energy performances				
T_SA	E_T	E_A	SE_C	SE_S
STOCKHOLM				
-	4.079	619	6,6	2,8
20	605	125	4,8	3,4
22	5.124	558	9,2	3,7
24	792	103	7,7	5,0
LONDON				
-	6.878	1.107	6,2	3,2
20	1.808	374	4,8	3,6
22	8.583	998	8,6	4,
24	2.333	313	7,5	5,4
ROME				
-	64.193	11.627	5,5	3,3
20	33.764	6.970	4,8	3,6
22	78.901	10.451	7,5	4,3
24	43.514	5.845	7,4	5,4
VALENCIA				
-	87.852	17.187	5,1	3,3
20	60.021	12.484	4,8	3,7
22	106.990	15.504	6,9	4,3
24	75.865	106.82	7,1	5,3

SUPPLY HUMIDITY RATIO = 12 g/kg								
Performance in cooling and in dehumidification								
T_OA	SET	T_SA	P_F	P_R	P_D	P_A	EER_C	EER_S
40 / 25	MC	21,9	101,0	-	19,2	23,5	4,3	3,6
	CS	22		0,47	18,8	23,4	4,3	3,7
	CS	24		9,84	9,38	21,3	5,2	4,3
35 / 24	MC	20,5	91,3	-	25,8	20,7	4,4	3,6
	CS	22		7,03	18,8	19,7	5,0	4,1
	CS	24		16,4	9,38	18,5	5,8	4,7
32 / 23	MC	21,6	69,9	-	20,6	15,3	4,6	3,6
	CS	22		1,88	18,8	14,9	4,8	3,7
	CS	24		11,3	9,38	13,4	6,1	4,6
30 / 22	MC	22,6	49,5	-	15,9	10,0	5,0	3,5
	CS	24		6,56	9,38	8,52	6,6	4,3
28 / 21	MC	22,5	34,0	-	16,4	5,28	6,4	3,5
	CS	24		7,03	9,38	4,26	9,6	4,7

Seasonal energy performances				
T_SA	E_T	E_A	SE_C	SE_S
STOCKHOLM				
-	340	53	6,4	3,2
24	410	43	9,6	4,2
LONDON				
-	1.034	172	6,0	3,5
22	72	15	4,8	3,7
24	1.234	141	8,7	4,7
ROME				
-	19.275	3.222	6,0	3,5
22	431	89	4,8	3,7
24	22.915	2.649	8,6	4,6
VALENCIA				
-	35.242	6.362	5,5	3,5
22	4.984	1.026	4,9	3,8
24	414.01	5.333	7,8	4,6

SUPPLY HUMIDITY RATIO = 13 g/kg								
Performance in cooling and in dehumidification								
T_OA	SET	T_SA	P_F	P_R	P_D	P_A	EER_C	EER_S
45 / 28 *	MC	20,8	151,0	-	24,4	46,5	3,2	2,9
	CS	22		5,63	18,8	45,2	3,5	3,1
	CS	24		15,0	9,38	42,9	3,9	3,4
45 / 26	MC	28,2	80,9	-	-	17,2	4,7	3,7
40 / 25	MC	28,2	62,6	-	-	12,7	4,9	3,7
35 / 24	MC	25	60,6	-	4,69	12,5	4,8	3,6
32 / 23	MC	25,1	43,0	-	4,22	7,71	5,6	3,6
30 / 22	MC	25	28,8	-	6,09	3,98	7,2	3,4
28 / 21	MC	23,7	19,7	-	10,8	2,09	9,4	3,0

Seasonal energy performances				
T_SA	E_T	E_A	SE_C	SE_S
STOCKHOLM				
-	197	21	9,4	2,6
LONDON				
-	602	70	8,6	8,6
ROME				
-	11.194	1.289	8,7	8,7
VALENCIA				
-	20.675	2.667	7,8	7,6
TUNIS				
-	43.683	7.157	6,1	3,1
22	1.723	497	3,5	3,1
24	1.826	472	3,9	3,4

SIZE 6 - AIR FLOW 14.000 m³/h (MAXIMUM) - COOLING

SUPPLY HUMIDITY RATIO = non controllata													
Performance in cooling and in dehumidification								Seasonal energy performances					
T_OA	SET	T_SA	x_SA	P_F	P_D	P_A	EER_C	EER_S	T_SA	E_T	E_A	SE_C	SE_S
45 / 28 *	HA	26	15,2	105,0	-	19,3	5,4	4,3	STOCKHOLM				
45 / 26	HA	26	12,8	92,7	-	20,3	4,6	3,8	-	7.889	1.713	4,6	3,1
40 / 25	HA	24	12,4	87,8	9,38	19,4	4,5	3,7	LONDON				
35 / 24	HA	22	12,3	80,6	18,8	17,8	4,5	3,6	ROME				
32 / 23	HA	21	11,8	75,2	23,4	16,7	4,5	3,6	VALENCIA				
30 / 22	HA	20	11,3	69,0	28,1	15,3	4,5	3,5	TUNIS				
28 / 21	HA	19	10,9	61,9	32,8	13,7	4,5	3,4	-	119.185	26.098	4,6	3,4
25 / 19	HA	18	9,71	51,2	37,5	11,1	4,6	3,3	-	163.319	35.796	4,6	3,2

SIZE 6 - AIR FLOW 14.000 m³/h (MAXIMUM) - HEATING

Performance in Heating									Seasonal energy performances				
T_OA	SET	T_SA	x_SA	P_T	P_D	P_A	COP_C	COP_S	T_SA	E_T	E_A	SE_C	SE_S
-15 / -16 *	MC	20,2	0,5	179,0	0,94	46,9	3,8	3,4	STOCKHOLM				
	CS	20		178,0	-	45,8	3,9	3,5	-	845.662	186354	4,5	3,8
		18		168,0	-	35,3	4,8	4,1	22	587.176	99478	5,9	4,4
	HA	16		158,0	-	29,1	5,4	4,6	20	567.995	89249	6,4	4,
-12 / -13 *	MC	22,8	0,8	176,0	13,1	49,5	3,6	3,2	LONDON				
	CS	22		172,0	9,38	44,8	3,8	3,4	-	691.252	144.073	4,8	4,0
		20		162,0	-	35,6	4,6	4,0	22	454.691	72.149	6,3	4,6
	HA	18		151,0	-	29,0	5,2	4,4	20	392.910	56.964	6,9	4,7
-7 / -8	MC	16	1,5	141,0	-	22,6	6,2	5,0	18	331.753	44.799	7,4	4,6
	CS	20,6		144,0	2,81	29,3	4,9	4,3	16	227.262	29.659	7,7	4,8
		20		141,0	-	27,5	5,1	4,4	ROME				
	HA	18		130,0	-	21,7	6,0	5,0	-	359.821	72.737	4,9	4,1
-5 / -6	MC	16	1,9	120,0	-	18,0	6,7	5,4	22	226.030	35.448	6,4	4,5
	CS	22,7		143,0	12,7	30,4	4,7	4,1	20	192.158	27.211	7,1	4,5
		22		140,0	9,38	28,3	4,9	4,3	18	158.484	20.566	7,7	4,4
	HA	20		129,0	-	22,5	5,7	4,8	16	9.2576	11.875	7,8	4,7
0 / -1	MC	22,7	1,9	119,0	-	18,6	6,4	5,2	VALENCIA				
	CS	22		108,0	-	14,9	7,2	5,6	-	273.602	54.289	5,0	4,1
		20		142,0	37,5	33,4	4,3	3,8	22	167.691	26.212	6,4	4,4
	HA	18		111,0	9,38	18,3	6,1	4,9	20	141.094	19.601	7,2	4,5
2 / 1	MC	16	3,1	91,1	-	12,9	7,1	5,3	18	114.594	14.382	8,0	4,3
	CS	28		81,1	-	11,1	7,3	5,2	16	57809	7.346	7,9	4,6
		22		101,0	-	14,7	6,9	5,3	ROME				
	HA	20		90,4	-	13,4	6,7	5,1	-	210.932	40.474	5,2	4,0
7 / 6	MC	30	3,7	80,30	-	11,6	6,9	5,0	22	124.269	19.387	6,4	4,0
	CS	22		70,30	-	9,70	7,2	5,0	20	102.679	13.792	7,4	4,0
		20		113,0	46,9	22,7	5,0	4,2	18	81.092	9.533	8,5	3,8
	HA	18		73,8	9,38	11,8	6,3	4,6	16	28.710	3.540	8,1	4,1
12 / 11	MC	16	5,4	54,2	-	7,76	7,0	4,5	TUNIS				
	CS	30		44,2	-	5,44	8,1	4,5	-				
		22		86,7	46,9	16,2	5,4	4,2					
	HA	20		48,1	9,38	7,39	6,5	4,1					

Notes

* System with "Hydronic recovery device for extended operating range" option
T_OA = Dry bulb/wet bulb outdoor air temperature [°C]
SET = Operation mode: MC = Maximum Capacity, CS = Constant Supply, HA = High Air Flow
T_SA = Dry bulb supply air temperature [°C]
X_SA = Supply air humidity ratio [g/kg]
P_F = Overall cooling capacity of the system (kW)
P_T = Heating capacity of the system [kW]
P_R = Post-heating capacity [kW]
P_D = Additional capacity available to the space [kW]
P_A = Electricity absorbed by the thermodynamic circuit [kW]
EER_C = Thermodynamic efficiency of the system in cooling mode
EER_S = Overall efficiency of the system in cooling mode (thermodynamic circuit and fans)
COP_C = Thermodynamic efficiency of the system in heating mode

COP_S = Overall efficiency of the system in heating mode (thermodynamic circuit and fans)

E_T = Seasonal thermal/cooling energy supplied [kWh]

E_A = Overall seasonal electricity absorbed [kWh]

SE_C = Thermodynamic seasonal efficiency of the system

SE_S = Overall seasonal efficiency of the system (thermodynamic circuit and fans)

In heating mode, the performances are considered with maximum air temperature supply T_SA equal to 30°C

The performance refers to a standard ZEPHIR[®] unit (not fitted with a 'Steam-powered humidification module' option)

Return air in cooling mode = 26°C DB

Return air in heating mode = 20°C / 12°C

Available static pressure: supply 150 Pa, return 100 Pa


Performance values do not include the effect of fan motor heat

Source: ASHRAE weather data (International weather for energy calculation)

Page intentionally left blank

**FOR OVER 30 YEARS, WE HAVE BEEN
OFFERING OUR CLIENTS INNOVATIVE
SOLUTIONS, IMPROVING COMFORT
LEVELS WHILE SAVING ENERGY**

www.clivet.com



CLIVET SPA
Via Camp Long 25, Z.I. Villapaiera
32032 Feltre (BL) - Italy
Tel. +39 0439 3131 - Fax +39 0439 313300
info@clivet.it

A Group Company of
 **Midea®**

CPAN-XHE3 Size1 - Size6 - BT12M007GB-13